



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY
REGION 8

1595 Wynkoop Street
DENVER, CO 80202-1129
Phone 800-227-8917
<http://www.epa.gov/region08>

2016 FEB 11 AM 9:25

FILED
EPA REGION VIII
HEARING CLERK

FEB 11 2016

Ref: 8ENF-W

CERTIFIED MAIL

Mr. David Woodward, Chairman and Operator
Warm Springs Water District
P.O. Box 1595
Dubois, Wyoming 82513

Re: Emergency Administrative Order under Section 1431 SDWA, Warm Springs Water District
Public Water System, PWS ID# WY5600861, Docket No. SDWA-08-2016-0001

Dear Mr. Woodward:

This letter is an addendum to the Emergency Administrative Order (Order) issued on January 7, 2016, to the Warm Springs Water District (District), as owner and/or operator of the Warm Springs Water District Public Water System (System).

Paragraph 27 of the Order required the District to submit a plan and schedule to the EPA for actions that have been taken or will be taken to ensure that there is no future loss of pressure to the system. On January 26, 2016, a plan and schedule was submitted by you, Mr. Woodward, on behalf of the District. This Addendum constitutes the EPA's written approval of the schedule for replacement of the well pump and disinfection, flushing, and monitoring of the storage tank and distribution system, pursuant to paragraph 27 of the Order.

The Order is hereby amended to include the deadlines in the following table. These deadlines are an enforceable part of the Order. Any noncompliance with the deadlines will be subject to the same penalties described in the Order.

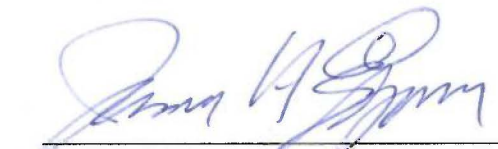
Action	Completion Date
Contacted well service crew and arranged for well crew to pull pump/motor.	January 8, 2016
Board meeting to discuss action plan. Decision to replace failed motor with retired motor from pump removed from service in 2010.	January 11, 2016
Failed pump pulled. Motor failure confirmed. Retired motor and pump assembled and tested by running a trial at the surface.	January 12, 2016
Retired pump/motor installed. Retired pump tested under pressure.	January 13, 2016
Storage tank filled to more than 50% capacity.	January 15, 2016
Storage tank isolated and drained in preparation for disinfection.	January 17, 2016
Storage tank refilled and disinfected with hypochlorite water.	January 20, 2016
Distribution lines flushed and disinfected. Tested free chlorine during flushing.	January 21, 2016

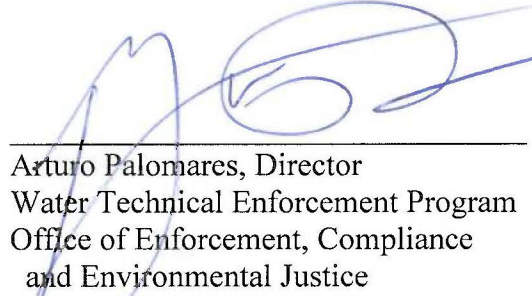
Beginning January 25, 2016, collect daily and weekly total coliform, <i>E. coli</i> and chlorine residual monitoring and testing according to Order. Submit results to the EPA.	Until notified by the EPA that daily and weekly sampling may be discontinued.
---	---

Pursuant to paragraph 2 of the Order, the EPA is authorized to seek penalties if these deadlines are not met. If the District has a reasonable basis to believe it may be unable to meet any deadline in the schedule, it shall notify the EPA well in advance of the scheduled deadline to request an extension. The EPA may, in its discretion, consider granting an extension. In addition, the EPA recommends that the new pump, ordered by the District then received following installation of the retired pump, be kept on site as a backup pump.

If you have any questions or wish to discuss this Order, please contact Jill Minter at minter.jill@epa.gov, or (800) 227-8917, extension 6084, or (303) 312-6084. Any questions from counsel for the District should be directed to Peggy Livingston, Enforcement Attorney, at livingston.peggy@epa.gov or (800) 227-8917, extension 6858, or (303) 312-6858.

Sincerely,


James H. Eppers, Supervisory Attorney
Legal Enforcement Program
Office of Enforcement, Compliance
and Environmental Justice


Arturo Palomares, Director
Water Technical Enforcement Program
Office of Enforcement, Compliance
and Environmental Justice

cc: WY DEQ/DOH (via email)
Ms. Tina Artemis, EPA Regional Hearing Clerk