

FACILITY PERMIT TO OPERATE

**LA COUNTY SANITATION DIST (CALABASAS)
5200-300 LOST HILLS RD
AGOURA, CA 91301**

NOTICE

IN ACCORDANCE WITH RULE 206, THIS PERMIT TO OPERATE OR A COPY THEREOF MUST BE KEPT AT THE LOCATION FOR WHICH IT IS ISSUED.

THIS PERMIT DOES NOT AUTHORIZE THE EMISSION OF AIR CONTAMINANTS IN EXCESS OF THOSE ALLOWED BY DIVISION 26 OF THE HEALTH AND SAFETY CODE OF THE STATE OF CALIFORNIA OR THE RULES OF THE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT. THIS PERMIT SHALL NOT BE CONSTRUED AS PERMISSION TO VIOLATE EXISTING LAWS, ORDINANCES, REGULATIONS OR STATUTES OF ANY OTHER FEDERAL, STATE OR LOCAL GOVERNMENTAL AGENCIES.

Barry R. Wallerstein, D. Env.
EXECUTIVE OFFICER

By _____
Mohsen Nazemi, P.E.
Deputy Executive Officer
Engineering & Compliance

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

TABLE OF CONTENTS

Section	Description	Revision #	Date Issued
A	Facility Information	DRAFT	01/05/2012
B	RECLAIM Annual Emission Allocation	DRAFT	01/05/2012
C	Facility Plot Plan	TO BE DEVELOPED	
D	Facility Description and Equipment Specific Conditions	DRAFT	01/05/2012
E	Administrative Conditions	DRAFT	01/05/2012
F	RECLAIM Monitoring and Source Testing Requirements	DRAFT	01/05/2012
G	Recordkeeping and Reporting Requirements for RECLAIM Sources	DRAFT	01/05/2012
H	Permit To Construct and Temporary Permit to Operate	DRAFT	01/05/2012
I	Compliance Plans & Schedules	DRAFT	01/05/2012
J	Air Toxics	DRAFT	01/05/2012
K	Title V Administration	DRAFT	01/05/2012
 Appendix			
A	NOx and SOx Emitting Equipment Exempt From Written Permit Pursuant to Rule 219	DRAFT	01/05/2012
B	Rule Emission Limits	DRAFT	01/05/2012

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION A: FACILITY INFORMATION

LEGAL OWNER &/OR OPERATOR: LA COUNTY SANITATION DIST (CALABASAS)

LEGAL OPERATOR (if different than owner):

EQUIPMENT LOCATION: 5200-300 LOST HILLS RD
 AGOURA, CA 91301-2340

MAILING ADDRESS: P.O. BOX 4998
 WHITTIER, CA 90607

RESPONSIBLE OFFICIAL: ROBERT C FERRANTE

TITLE: DEPARTMENTAL ENGINEER

TELEPHONE NUMBER: (562) 908-4288

CONTACT PERSON: FRANK CAPONI

TITLE: SUPERVISING ENGINEER

TELEPHONE NUMBER: (562) 908-4288

INITIAL TITLE V PERMIT ISSUED: May 23, 2006

TITLE V PERMIT EXPIRATION DATE: May 22, 2011

TITLE V	RECLAIM
----------------	----------------

YES	NOx: NO SOx: NO CYCLE: 0 ZONE: COASTAL
------------	---

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

SECTION B: RECLAIM ANNUAL EMISSION ALLOCATION

NOT APPLICABLE

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

SECTION C: FACILITY PLOT PLAN

(TO BE DEVELOPED)

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

**Facility Equipment and Requirements
(Section D)**

This section consists of a table listing all permitted equipment at the facility, facility wide requirements, all individual Permits to Construct and Permits to Operate issued to various equipment at the facility, and Rule 219-exempt equipment subject to source-specific requirements. Each permit and Rule 219-exempt equipment will list operating conditions including periodic monitoring requirements, and applicable emission limits and requirements that the equipment is subject to. Also included is the rule origin and authority of each emission limit and permit condition.

**FACILITY PERMIT TO OPERATE
 LA COUNTY SANITATION DIST (CALABASAS)**

PERMITTED EQUIPMENT LIST

THE FOLLOWING IS A LIST OF ALL PERMITS TO CONSTRUCT AND PERMITS TO OPERATE AT THIS FACILITY:

Application No.	Permit to Operate No.	Equipment description	Pg. No.
220691	R-D37812	STORAGE TANK OTHER W/CTL GASOLINE	5
322631	R-F4701	STORAGE TANK MISC MATERIALS	7
322632	R-F4700	STORAGE TANK MISC MATERIALS	8
331544	F10379	AIR STRIPPING	9
337534	F15737	LANDFILL CONDENSATE/LEACHATE/COLLECTION	10
340995	F38574	STORAGE TANK MISC MATERIALS	12
340997	F38575	STORAGE TANK MISC MATERIALS	13
340998	F38576	STORAGE TANK MISC MATERIALS	14
340999	F38577	STORAGE TANK MISC MATERIALS	15
341000	F38578	STORAGE TANK MISC MATERIALS	16
341004	F38579	STORAGE TANK MISC MATERIALS	17
341006	F38580	STORAGE TANK MISC MATERIALS	18
341009	F38581	STORAGE TANK MISC MATERIALS	19
341029	F51198	LANDFILL GAS COLLECTION (>50 WELLS)	20
440826	F77394	FLARE, ENCLOSED LANDFILL/DIGESTER GAS	25
501731	G8396	AIR STRIPPING	31

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

FACILITY WIDE CONDITION(S)

Condition(s):

1. EXCEPT FOR OPEN ABRASIVE BLASTING OPERATIONS, THE OPERATOR SHALL NOT DISCHARGE INTO THE ATMOSPHERE FROM ANY SINGLE SOURCE OF EMISSIONS WHATSOEVER ANY AIR CONTAMINANT FOR A PERIOD OR PERIODS AGGREGATING MORE THAN THREE MINUTES IN ANY ONE HOUR WHICH IS:
 - A. AS DARK OR DARKER IN SHADE AS THAT DESIGNATED NO. 1 ON THE RINGLEMANN CHART, AS PUBLISHED BY THE UNITED STATES BUREAU OF MINES; OR
 - B. OF SUCH OPACITY AS TO OBSCURE AN OBSERVER'S VIEW TO A DEGREE EQUAL TO OR GREATER THAN DOES SMOKE DESCRIBED IN SUBPARAGRAPH (A) OF THIS CONDITION.
[RULE 401]

2. THE OPERATOR SHALL NOT USE FUEL OIL CONTAINING SULFUR COMPOUNDS IN EXCESS OF 0.05 PERCENT BY WEIGHT. ON OR AFTER JUNE 1, 2004, THE OPERATOR SHALL NOT PURCHASE FUEL OIL CONTAINING SULFUR COMPOUNDS IN EXCESS OF 15 PPM BY WEIGHT.
[RULE 431.2]

3. THE OPERATOR SHALL NOT USE LANDFILL GAS CONTAINING SULFUR COMPOUNDS IN EXCESS OF 150 PPMV CALCULATED AS HYDROGEN SULFIDE AVERAGED DAILY.
[RULE 431.1]

4. THIS FACILITY IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

GASEOUS EMISSIONS: 1150.1
GASEOUS EMISSIONS: 40 CFR 63 SUBPART AAAAA

5. THE OWNER/OPERATOR OF A MSW LANDFILL SHALL COMPLY WITH THE FOLLOWING:
 - A. INSTALL AND OPERATE A WIND SPEED AND DIRECTION MONITORING SYSTEM WITH A CONTINUOUS RECORDER. FOR WIND SPEED, USE A 3 CUP ASSEMBLY WITH A RANGE OF 0 TO 50 MILES AN HOUR, WITH A THRESHOLD OF 0.75 MILE PER HOUR OR LESS. FOR WIND DIRECTION, USE A VANE WITH A RANGE OF 0 TO 540 DEGREES AZIMUTH, WITH A THRESHOLD OF PLUS-MINUS 2 DEGREES. AN APPROVED ALTERNATIVE MAY BE USED IN LIEU OF THE ABOVE.
[RULE 1150.1]

 - B. MONITOR AND COLLECT MONTHLY, OR AS PER THE APPROVED 1150.1 ALTERNATIVE, SAMPLES FOR ANALYSIS OF TOC AND TAC FROM THE SUBSURFACE REFUSE BOUNDARY SAMPLING PROBES.
[RULE 1150.1]

 - C. OPERATE THE COLLECTION SYSTEM TO PREVENT THE CONCENTRATION OF TOC MEASURED AS METHANE FROM EXCEEDING 5% BY VOLUME IN THE SUBSURFACE REFUSE BOUNDARY SAMPLING PROBES.
[RULE 1150.1]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

- D. COLLECT MONTHLY, OR AS PER THE APPROVED 1150.1 ALTERNATIVE, INTEGRATED SAMPLES FOR ANALYSIS OF TOC AND TAC FROM THE LANDFILL SURFACE.
[RULE 1150.1]
- E. OPERATE THE COLLECTION SYSTEM TO PREVENT THE CONCENTRATION OF TOC MEASURED AS METHANE FROM EXCEEDING 25 PPMV AS DETERMINED BY INTEGRATED SAMPLES TAKEN ON NUMBERED 50,000 SQUARE FOOT LANDFILL GRIDS OR AS PER THE APPROVED 1150.1 ALTERNATIVE.
[RULE 1150.1]
- F. MONITOR QUARTERLY, OR AS PER THE APPROVED 1150.1 ALTERNATIVE, THE LANDFILL SURFACE FOR TOC EACH QUARTER, OR AS APPROVED, FROM THE SURFACE OF THE LANDFILL.
[RULE 1150.1]
- G. OPERATE THE COLLECTION SYSTEM TO PREVENT THE CONCENTRATION OF TOC MEASURED AS METHANE FROM EXCEEDING 500 PPMV ABOVE BACKGROUND AS DETERMINED BY INSTANTANEOUS MONITORING AT ANY LOCATION ON THE LANDFILL, EXCEPT AT THE OUTLET OF ANY CONTROL DEVICE.
[RULE 1150.1]
- H. OPERATE THE GAS COLLECTION AND CONTROL SYSTEM SO THAT THERE ARE NO LEAKS THAT EXCEED 500 PPMV TOC MEASURED AS METHANE AT ANY COMPONENT UNDER POSITIVE PRESSURE.
[RULE 1150.1]
- I. COLLECT MONTHLY, OR AS PER THE APPROVED 1150.1 ALTERNATIVE, LANDFILL GAS SAMPLES FOR ANALYSIS OF TOC AND TAC FROM THE MAIN GAS COLLECTION HEADER LINE ENTERING THE GAS TREATMENT AND/OR GAS CONTROL SYSTEM.
[RULE 1150.1]
- J. COLLECT MONTHLY, OR AS PER THE APPROVED 1150.1 ALTERNATIVE, AMBIENT AIR SAMPLES FOR ANALYSIS OF TOC AND TAC FROM THE LANDFILL PROPERTY BOUNDARY.
[RULE 1150.1]
- K. OPERATE THE GAS COLLECTION AND CONTROL SYSTEM AT ALL TIMES FOR LANDFILLS WITH ACTIVE COLLECTION SYSTEMS.
[RULE 1150.1]
- L. OPERATE ALL WELLHEADS SO THE GAUGE PRESSURE IS UNDER A CONSTANT VACUUM, EXCEPT DURING WELL HEAD RAISING AND/OR REPAIR AND TEMPORARY SHUTDOWN DUE TO A CATASTROPHIC EVENT.
[RULE 1150.1]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. R-D37812
A/N 220691

Equipment Description:

FUEL STORAGE AND DISPENSING FACILITY CONSISTING OF

1. ONE GASOLINE ABOVEGROUND STORAGE TANK, CONVAULT, 1000 GALLON CAPACITY, EQUIPPED WITH PHASE I VAPOR RECOVERY SYSTEM.
2. ONE GASOLINE DISPENSING NOZZLE, EQUIPPED WITH PHASE II VAPOR RECOVERY SYSTEM.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE OPERATED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. PHASE I VAPOR RECOVERY SYSTEMS SHALL BE IN FULL OPERATION WHENEVER FUEL IS BEING TRANSFERRED INTO STORAGE TANKS.
[RULE 461]
4. PHASE II RECOVERY SYSTEMS SHALL BE IN FULL OPERATION WHENEVER FUEL IS BEING TRANSFERRED INTO MOTOR VEHICLES AS DEFINED IN RULE 461.
[RULE 461]
5. ALL PHASE I AND PHASE II VAPOR RECOVERY EQUIPMENT AT THIS FACILITY SHALL BE INSTALLED, OPERATED AND MAINTAINED TO MEET ALL CALIFORNIA AIR RESOURCES BOARD CERTIFICATION REQUIREMENTS.
[RULE 461]

**THIS PERMIT TO OPERATE NO. R-D37812 SUPERSEDES PERMIT TO OPERATE NO. D37812
ISSUED ON 4/25/91.**

Periodic Monitoring:

6. THE OPERATOR SHALL HAVE A PERSON THAT HAS BEEN TRAINED IN ACCORDANCE WITH RULE 461(d)(5) CONDUCT AN ANNUAL INSPECTION IN ACCORDANCE WITH 461(d)(1)(B) OF THE GASOLINE TRANSFER AND DISPENSING EQUIPMENT. THE INSPECTION SHALL BE IN ACCORDANCE WITH RULE 461, ATTACHMENT C. THE OPERATOR SHALL KEEP RECORDS OF THE INSPECTION AND THE REPAIRS IN ACCORDANCE TO RULE 461 AND SECTION K OF THIS PERMIT.
[RULE 3004 (a)(4)]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

Emissions and Requirements:

7. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

VOC: RULE 461

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. R-F4701
A/N 322631**

Equipment Description:

PORTABLE TANK NO. 1, BAKER, CONDENSATE/LEACHATE STORAGE, 20,000 GALLON CAPACITY, 12'-4"
H. BY 37' L. BY 8' W., MAXIMUM.

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TTMS.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

THIS PERMIT TO CONSTRUCT/OPERATE R-F4701 SUPERSEDES PERMIT TO CONSTRUCT/OPERATE F4701 ISSUED 1/08/1997.

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. R-F4700
A/N 322632**

Equipment Description:

PORTABLE TANK NO. 2, BAKER, CONDENSATE/LEACHATE STORAGE, 20,000 GALLON CAPACITY, 12'-4"
H. BY 37' L. BY 8' W., MAXIMUM

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

THIS PERMIT TO CONSTRUCT/OPERATE R-F4700 SUPERSEDES PERMIT TO CONSTRUCT/OPERATE F4700 ISSUED 1/08/1997.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. F10379
A/N 331544

Equipment Description:

AIR STRIPPER SYSTEM NO. 2, AT EQUIPMENT YARD, FOR TREATMENT OF LANDFILL LIQUIDS - CANYON WATER, LCRS, AND UNDERDRAIN WATER CONSISTING OF:

1. CANYON WATER STORAGE TANK, 10,000 GALLON CAPACITY.
2. CANYON WATER STORAGE TANK, 6500 GALLON CAPACITY.
3. AIR STRIPPER, PACKED COLUMN TYPE, 1'-6" DIA. BY 20'-0" H., 150 CFM, 15 GPM.
4. EFFLUENT STORAGE TANK, 5000 GALLONS.

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL NOT BE OPERATED UNLESS THE EXHAUST AIR FROM THE AIR STRIPPER AND THE CANYON WATER STORAGE TANK(S) ARE VENTED TO THE FLARING STATION WHERE AT LEAST ONE OF THE FLARES IS IN FULL USE AND HAS A VALID PERMIT FROM THE AQMD.
[RULE 402, 1303(a)(1)-BACT, 1401]
- 4) THE TOTAL VOLUME OF WATER FED TO THE AIR STRIPPER SHALL NOT EXCEED 57,600 GALLONS PER DAY.
[RULE 1303(b)(2)-OFFSET]
- 5) A FLOWMETER SHALL BE MAINTAINED ON THE TREATED WATER LINE LEAVING THE AIR STRIPPER. TOTAL WATER THROUGHPUT IN GALLONS SHALL BE REPORTED DAILY AND MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1303(b)(2)-OFFSET]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F15737
A/N 337534**

Equipment Description:

LANDFILL GAS CONDENSATE/LCRS STORAGE AND COLLECTION SYSTEM CONSISTING OF:

1. ONE LCRS COLLECTION TANK, 1000 GALLON CAPACITY, WITH TWO TRANSFER PUMPS.
2. ONE LCRS COLLECTION TANK, 1100 GALLON CAPACITY, WITH TWO TRANSFER PUMPS.
3. ONE LCRS COLLECTION TANK, 6500 GALLON CAPACITY, WITH TWO TRANSFER PUMPS.
4. ONE CONDENSATE COLLECTION TANK, 500 GALLON CAPACITY, WITH TWO TRANSFER PUMPS.
5. TWO (2) CONDENSATE COLLECTION TANKS, EACH 4000 GALLON CAPACITY, EACH WITH TWO TRANSFER PUMPS.
6. SIX (6) CONDENSATE STORAGE TANKS, EACH 6500 GALLON CAPACITY.
7. BASKET STRAINER

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) COLLECTION AND STORAGE TANKS SHALL BE VENTED TO THE LANDFILL GAS SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE AND LCRS COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

- 6) ALL CONNECTIONS, VALVES AND OPENINGS SHALL BE PROPERLY SEALED OR CLOSED SO AS TO PREVENT RAW LANDFILL GAS AND/OR CONDENSATE/LCRS VAPORS FROM ENTERING INTO THE ATMOSPHERE
[RULE 402, 1303(a)(1)-BACT]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38574
A/N 340995**

Equipment Description:

PORTABLE TANK NO. 3, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. F38575
A/N 340997

Equipment Description:

PORTABLE TANK NO. 4, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38576
A/N 340998**

Equipment Description:

PORTABLE TANK NO. 5, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38577
A/N 340999**

Equipment Description:

PORTABLE TANK NO. 6, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38578
A/N 341000**

Equipment Description:

PORTABLE TANK NO. 7, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38579
A/N 341004**

Equipment Description:

PORTABLE TANK NO. 8, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. F38580
A/N 341006

Equipment Description:

PORTABLE TANK NO. 9, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO OPERATE

**Permit No. F38581
A/N 341009**

Equipment Description:

PORTABLE TANK NO. 10, BAKER, CONDENSATE/LEACHATE STORAGE, UP TO 20,000 GALLON CAPACITY

Conditions:

- 1) OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
- 2) THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
- 3) THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
- 4) THIS EQUIPMENT SHALL BE VENTED TO THE LANDFILL GAS COLLECTION OR FLARING SYSTEM.
[RULE 402, 1303(a)(1)-BACT]
- 5) ALL CONDENSATE COLLECTED AND/OR TREATED SHALL BE DISPOSED OF PROPERLY.
[RULE 402]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. F51198
A/N 341029

Equipment Description:

LANDFILL GAS COLLECTION SYSTEM CONSISTING OF:

1. TWO HUNDRED THIRTY-THREE (233) VERTICAL LANDFILL GAS COLLECTION WELLS, PILE DRIVEN.
2. TWO HUNDRED SEVENTY-FOUR (274) VERTICAL LANDFILL GAS COLLECTION WELLS, AUGER DRILLED.
3. FORTY-FOUR (44) HORIZONTAL GAS COLLECTION WELLS, VARIOUS DIAMETERS.
4. GAS TRANSMISSION HEADER AND LATERAL PIPING SYSTEM, SERVING THE VERTICAL AND HORIZONTAL WELLS TO DIRECT THE LANDFILL GAS TO THE FLARE SYSTEM.
5. ONE 8" DIAMETER HEADER, PVC PIPE CONSTRUCTION, APPROXIMATELY 350 FEET IN LENGTH, INTERCONNECTING THE EXISTING LANDFILL GAS COLLECTION SYSTEM WITH THE LEACHATE COLLECTION AND REMOVAL SYSTEM (LCRS).
6. ONE THOUSAND (1000) VERTICAL LANDFILL GAS COLLECTION WELLS, PILE DRIVEN OR AUGER DRIVEN, AT LOCATIONS TO BE DETERMINED.
2. HORIZONTAL GAS COLLECTION TRENCHES, PERIPHERAL OR PARALLEL, UP TO 200,000 LINEAR FEET, AT LOCATIONS TO BE DETERMINED.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

4. DURING WELL DRILLING, AN APPROVED EMISSION CONTROL BOX SHALL BE PLACED OVER THE WELL HOLE TO COLLECT LANDFILL GAS. THE COLLECTED GAS SHALL EITHER BE DIRECTED TO AN OPERATING FLARE SYSTEM WHICH HAS A VALID PERMIT ISSUED BY THE SCAQMD, OR VENTED TO A CARBON ADSORPTION UNIT WHICH HAS SUFFICIENT CAPACITY TO REMOVE NMOC'S AND ODORS WHEN THERE IS NO OPERATIONAL GAS COLLECTION/FLARING SYSTEM AVAILABLE NEARBY.
[RULE 402, 1150.1]
5. WELL DRILLING, DRIVING AND/OR TRENCHING SHALL NOT BE CONDUCTED BETWEEN THE HOURS OF 6 P.M. AND 7 A.M. OR ON SATURDAYS, SUNDAYS OR LEGAL HOLIDAYS, UNLESS OTHERWISE APPROVED BY THE SCAQMD.
[RULE 402, 1150]
6. WELL DRILLING, DRIVING, AND/OR TRENCHING SHALL NOT BE CONDUCTED ON DAYS WHEN THE SCAQMD FORECASTS FIRST, SECOND OR THIRD STAGE EPISODES FOR AREA NO. 6 OR WHEN THE SCAQMD REQUIRES COMPANIES IN AREA NO. 6 TO IMPLEMENT THEIR FIRST, SECOND OR THIRD STAGE EPISODE PLANS UNLESS OTHERWISE APPROVED BY THE SCAQMD. EPISODE FORECASTS FOR THE FOLLOWING DAY CAN BE OBTAINED BY CALLING (800) 242-4666.
[RULE 402, 1150]
7. WELL DRILLING, DRIVING AND/OR TRENCHING SHALL NOT BE CONDUCTED WHEN THE WIND SPEED IS GREATER THAN 15 M.P.H. AVERAGE (OVER 15 MINUTES) OR THE WIND SPEED INSTANTANEOUSLY EXCEEDS 25 M.P.H.
[RULE 402, 403, 1150]
8. EACH WELL SHALL BE COMPLETED AND CAPPED THE SAME DAY ITS CONSTRUCTION COMMENCES UNLESS THE WELL HOLE IS COMPLETELY SEALED AND THE WELL CASING IS CONNECTED TO THE GAS COLLECTION HEADER TO PREVENT ANY LANDFILL GAS FROM ESCAPING INTO THE ATMOSPHERE.
[RULE 402, 1150.1]
9. THE CONSTRUCTION OF ANY PIPING OR WELL TRENCH WHICH EXPOSES LANDFILL TRASH TO THE ATMOSPHERE SHALL BE STAGED SUCH THAT NO MORE THAN ONE HUNDRED (100) LINEAR FEET OF TRENCH PER EXCAVATION SITE IS EXPOSED AT ANY TIME PRIOR TO BACKFILLING. THE NUMBER OF EXCAVATION SITES SHALL NOT EXCEED TWO.
[RULE 402, 1150]
10. WELL HOLES, TRENCHES, AND EXPOSED LANDFILL TRASH SHALL BE COMPLETELY COVERED TO PREVENT ANY EMISSIONS OF LANDFILL GAS TO THE ATMOSPHERE WHENEVER WORK IS NOT ACTIVELY IN PROGRESS. THE COVER SHALL INCLUDE, BUT MAY NOT BE LIMITED TO A MINIMUM OF 6 INCHES OF CLEAN DIRT, APPROVED FOAM, OR HEAVY-DUTY PLASTIC SHEETING. FOAM BY ITSELF SHALL NOT BE USED AS A NIGHT COVER IF IT IS RAINING OR RAIN IS PREDICTED BY THE NATIONAL WEATHER SERVICE PRIOR TO THE NEXT SCHEDULED WORKING DAY.
[RULE 402, 1150]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

11. FOR PURPOSES OF THIS PERMIT, THE FOLLOWING ARE CONSIDERED CONSTRUCTION SPOILS: LANDFILL TRASH; MATERIAL THAT IS MIXED WITH LANDFILL TRASH; MATERIAL THAT HAS BEEN IN CONTACT WITH LANDFILL TRASH; OR ODOROUS MATERIAL THAT IS REMOVED FROM WELL HOLES OR TRENCHES.
[RULE 1150]
12. CONSTRUCTION SPOILS AND ALL WORKING AREAS BEING ACTIVELY USED FOR TRUCK AND CONSTRUCTION EQUIPMENT TRAFFICKING SHALL BE MAINTAINED IN A MOIST CONDITION TO MINIMIZE DUST AND EMISSIONS.
[RULE 402, 403, 1150]
13. ALL CONSTRUCTION SPOILS SHALL BE TRANSPORTED TO THE ACTIVE WORKING FACE OF THE LANDFILL WITHIN ONE HOUR OF GENERATION OR AS DEEMED NECESSARY BY SCAQMD PERSONNEL.
[RULE 402, 1150]
14. DURING TRANSPORT OF THE CONSTRUCTION SPOILS, NO MATERIAL SHALL EXTEND ABOVE THE SIDES OR REAR OF THE VEHICLE HAULING THE MATERIAL.
[RULE 1150]
15. THE EXTERIOR OF THE VEHICLE (INCLUDING THE TIRES) HAULING THE CONSTRUCTION SPOILS SHALL BE CLEANED OFF PRIOR TO LEAVING THE WORK SITE.
[RULE 1150]
16. IF A DISTINCT ODOR LEVEL (LEVEL III OR GREATER) RESULTING FROM THE CONSTRUCTION IS DETECTED AT OR BEYOND THE PROPERTY LINE, ALL WORK SHALL CEASE UNTIL THE ODOR SOURCES ARE DETERMINED AND ELIMINATED. ODOR LEVELS SHALL BE DETERMINED BY SCAQMD PERSONNEL OR ON-SITE SAFETY COORDINATOR IN THE ABSENCE OF SCAQMD PERSONNEL.
[RULE 402, 1150]
17. DURING CONSTRUCTION, IF A CONSIDERABLE NUMBER OF COMPLAINTS ARE RECEIVED, ALL WORK SHALL CEASE AND APPROVED MITIGATION MEASURES SHALL BE IMPLEMENTED IMMEDIATELY. WORK SHALL NOT RESUME UNTIL THE EMISSIONS CAUSING THE COMPLAINTS ARE MITIGATED AND THE APPROVAL TO RESUME WORK IS RECEIVED FROM THE SCAQMD.
[RULE 402, 1150]
18. MITIGATION MEASURES, OTHER THAN THOSE INDICATED IN THESE CONDITIONS, WHICH ARE DEEMED APPROPRIATE BY SCAQMD PERSONNEL AS NECESSARY TO PROTECT THE COMFORT, REPOSE, HEALTH OR SAFETY OF THE PUBLIC SHALL BE IMPLEMENTED UPON REQUEST.
[RULE 402, 1150]
19. EACH HORIZONTAL GAS COLLECTION WELL SHALL BE CONNECTED TO AN OPERATING LANDFILL GAS HEADER OR THE ENDS OF THE WELL SHALL BE SEALED WITH BLIND FLANGES OR OTHER TYPES OF SEALS APPROVED BY THE SCAQMD AS SOON AS THE WELL IS INSTALLED.
[RULE 1150, 1150.1]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

20. EACH VERTICAL AND HORIZONTAL WELL HEAD SHALL BE EQUIPPED WITH A SHUT-OFF VALVE AND A SAMPLING PORT.
[RULE 1150.1]
21. UNTIL CONNECTED TO AN OPERATING LANDFILL GAS COLLECTION SYSTEM, EACH COMPLETED WELL SHALL BE CAPPED AND ITS GAS CONTROL VALVE CLOSED TO AVOID VENTING LANDFILL GAS TO THE ATMOSPHERE.
[RULE 1150, 1150.1]
22. EACH WELL SHALL BE SECURELY SEALED TO PREVENT ANY EMISSIONS OF LANDFILL GAS FROM AROUND THE WELL CASING.
[RULE 402, 1150, 1150.1]
23. ALL OPENINGS OF THIS SYSTEM SHALL BE PROPERLY COVERED AND SEALED TO PREVENT ANY VAPORS FROM ENTERING INTO THE ATMOSPHERE.
[RULE 402, 1150, 1150.1]
24. ALL GASES COLLECTED BY THIS SYSTEM SHALL BE VENTED TO A COMBUSTION OR PROCESSING FACILITY WHICH IS IN FULL USE, CAN ADEQUATELY PROCESS THE VOLUME OF GAS COLLECTED, AND HAS BEEN ISSUED A VALID PERMIT TO CONSTRUCT OR OPERATE BY THE SCAQMD.
[RULE 1150.1, 1303(a)(1)-BACT]
25. THE OPERATION OF THIS EQUIPMENT SHALL NOT RESULT IN THE RELEASE OF ANY RAW LANDFILL GAS INTO THE ATMOSPHERE.
[RULE 402, 1150.1]
26. THE SCAQMD SHALL BE NOTIFIED IN WRITING AT LEAST ONE (1) WEEK IN ADVANCE WHEN AN ADDITIONAL WELL OR SET OF WELLS AND THEIR ASSOCIATED PIPING WILL BE INSTALLED. THE PROPOSED WELL LOCATIONS AND CONNECTING PIPING SHALL BE IDENTIFIED ON A DRAWING WHICH SHOWS AND DESCRIBES THE ENTIRE GAS COLLECTION SYSTEM. ESTIMATED GAS COLLECTION VOLUME, WELL DEPTHS, PIPE LENGTHS, DIAMETERS AND LAYOUTS SHALL BE SUPPLIED TO THE SCAQMD IN THIS ADVANCE NOTIFICATION.
[RULE 1150.1]
27. SHORT NOTICE CONSTRUCTION PROJECTS IN RESPONSE TO NOTICE-TO-COMPLY OR MITIGATION OF EXCEEDANCES PURSUANT TO RULE 1150.1 ARE EXEMPT FROM ONE (1) WEEK ADVANCE WRITTEN NOTICES. TELEPHONE, ELECTRONIC MAIL OR OTHER MEANS OF ADVANCED NOTIFICATION SHALL BE SUFFICIENT FOR PROJECT START-UP. SUCH COMMUNICATIONS SHALL INCLUDE THE LOCATIONS OF THE PROPOSED WELLS, WELL DIMENSIONS AND A BRIEF DESCRIPTION OF THE PROJECT. WRITTEN NOTIFICATION SHALL BE PROVIDED TO THE SCAQMD AS SOON AS POSSIBLE, BUT NOT LATER THAN 30 DAYS OF THE PROJECT STARTUP DATE.
[RULE 1150.1]
28. WITHIN 30 DAYS AFTER CONSTRUCTION OF A GROUP OF WELLS AND THEIR ASSOCIATED PIPING IS COMPLETE, THE PERMITTEE SHALL SUBMIT AS-BUILT DRAWINGS IN DUPLICATE TO THE SCAQMD, ATTN: TOXICS AND WASTE MANAGEMENT.
[RULE 1150.1]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

29. EACH VERTICAL WELL SHALL BE CONNECTED TO AN OPERATING LANDFILL GAS HEADER AS SOON AS POSSIBLE BUT NOT LATER THAN SEVEN (7) DAYS AFTER THE WELL IS INSTALLED.
[RULE 1150.1]

Emissions and Requirements:

30. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

GASEOUS EMISSIONS: RULE 1150.1

GASEOUS EMISSIONS: 40 CFR 63 SUBPART AAAAA

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO OPERATE

Permit No. F77394
A/N 440826

Equipment Description:

LANDFILL GAS FLARING SYSTEM CONSISTING OF:

1. SIX FLARES (NOS. 1-6), CUSTOM MADE HEX BURNER DESIGN, EACH 8 FT. DIAMETER BY 16 FT. HIGH, 1000 SCFM CAPACITY, WITH PROPANE PILOT IGNITER, UV FLAME SCANNER, AUTOMATIC AIR LOUVERS, AUTOMATIC SHUTDOWN VALVE, AND TEMPERATURE CONTROLLER.
2. THREE FLARES (NOS. 7-9), CUSTOM MADE HEX BURNER DESIGN, EACH 8 FT. 4 INCH OUTER DIAMETER BY 32 FT. HIGH, 1500 SCFM CAPACITY, WITH PROPANE PILOT IGNITER, UV FLAME SCANNER, AUTOMATIC AIR LOUVERS, AUTOMATIC SHUTDOWN VALVE, TEMPERATURE CONTROLLER AND LIQUID INJECTION.
3. NINE FLAME ARRESTORS
4. PARTICULATE FILTER, 24 INCH, CAPABLE OF HANDLING 8700 SCFM GAS FLOW.
5. TWO BLOWERS (FOR FLARES NO. 1-6), EACH 5700 CFM CAPACITY, 60 HP, ONE AS BACKUP.
6. THREE BLOWERS (FOR FLARES NO. 7-9), EACH 1500 CFM CAPACITY, 100 HP.
7. LIQUID INJECTION SYSTEM (FOR FLARES 7-9), CONDENSATE TYPE, CONSISTING OF TRANSFER AND INJECTION PUMPS, BASKET STRAINER, AND ASSOCIATED PIPING AND INJECTION NOZZLES.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

4. FOUR (4) SAMPLING PORTS SHALL BE PROVIDED IN EACH FLARE STACK AT LEAST THREE (3) FEET UPSTREAM OF THE FLARE OUTLET. EACH SAMPLING PORT SHALL CONSIST OF A FOUR-INCH NIPPLE. ALL PORTS SHALL BE PROPERLY CENTERED. AN EQUIVALENT METHOD OF EMISSION SAMPLING MAY BE USED UPON APPROVAL BY THE EXECUTIVE OFFICER. ADEQUATE AND SAFE ACCESS TO ALL SOURCE TEST PORTS SHALL BE PROVIDED.
[RULE 217]
5. A SAMPLING PORT SHALL BE INSTALLED AT THE INLET GAS LINE TO THE FLARE TO ALLOW THE COLLECTION OF A LANDFILL GAS SAMPLE.
[RULE 217, 431.1, 1150.1]
6. THE FLARE SHALL BE EQUIPPED WITH A CONTINUOUS TEMPERATURE INDICATOR AND RECORDER WHICH MEASURES AND RECORDS THE GAS TEMPERATURE IN THE FLARE STACK. THE TEMPERATURE INDICATOR AND RECORDER SHALL OPERATE WHENEVER THE FLARE IS IN OPERATION. THE TEMPERATURE SHALL BE MEASURED AT A LOCATION ABOVE THE FLAME ZONE, AT LEAST 0.6 SECOND DOWNSTREAM OF THE BURNER AND NOT LESS THAN THREE (3) FEET FROM THE TOP OF THE STACK.
[RULE 1150.1, 1303(a)(1)-BACT, 40CFR60.756(b)(1)]
7. WHENEVER THE FLARE(S) IS(ARE) IN OPERATION, A TEMPERATURE OF NOT LESS THAN 1400 DEGREES F, 15 MINUTE AVERAGE, AS MEASURED BY THE TEMPERATURE INDICATOR AND RECORDER, SHALL BE MAINTAINED EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN. STARTUP IS DEFINED AS THE PERIOD FROM FLARE IGNITION TO THE TIME WHEN 1400 DEGREES F IS ACHIEVED, NOT TO EXCEED 30 MINUTES. SHUTDOWN IS THE PERIOD FROM WHEN THE GAS VALVE BEGINS TO BE SHUT AND COMPLETELY SHUTS OFF, NOT TO EXCEED 30 MINUTES.
[RULE 1303(a)(1)-BACT]
8. THE FLARE STATION SHALL BE EQUIPPED WITH AN AUTOMATIC SHUT-DOWN SYSTEM WITH A FAILURE ALARM, WHICH HAS BEEN APPROVED BY THE EXECUTIVE OFFICER, TO AUTOMATICALLY ISOLATE EACH FLARE FROM THE LANDFILL GAS SUPPLY LINE, SHUT OFF THE BLOWERS (WHEN FAILURE OF THE ENTIRE FLARING STATION OCCURS) AND IMMEDIATELY NOTIFY A RESPONSIBLE PARTY REGARDING THE SHUT-DOWN.
[RULE 1303(a)(1)-BACT]
9. THE SAFETY SYSTEM SHALL BE TESTED PERIODICALLY FOR PROPER OPERATION AND THE RESULTS RECORDED.
[RULE 1303(a)(1)-BACT]
10. A FLOW INDICATING AND RECORDING DEVICE(S) SHALL BE MAINTAINED IN THE LANDFILL GAS SUPPLY LINE TO THE FLARE STATION AND IN EACH LANDFILL GAS SUPPLY LINE TO FLARES 7 THRU 9 TO MEASURE THE QUANTITY OF LANDFILL GAS (IN SCFM) BEING BURNED.
[RULE 1150.1, 1303(b)(2)-OFFSET, 40CFR 60.756(b)(2)(i)]
11. A FLOW INDICATING AND RECORDING DEVICE SHALL BE INSTALLED TO MEASURE AND RECORD THE QUANTITY OF LANDFILL GAS (IN SCFM) BEING BURNED IN THE FLARE STATION.
[RULE 1150.1, 1303(b)(2)-OFFSET, 40CFR 60.756(b)(2)(i)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

12. THE VOLUME OF LANDFILL GAS BURNED IN EACH FLARE (NOS. 1-6) SHALL NOT EXCEED 1000 STANDARD CUBIC FEET PER MINUTE.
[RULE 1303(b)(2)-OFFSET]
13. THE VOLUME OF LANDFILL GAS BURNED IN EACH FLARE (NOS. 7-9) SHALL NOT EXCEED 1500 STANDARD CUBIC FEET PER MINUTE.
[RULE 1303(b)(2)-OFFSET]
14. THE TOTAL VOLUME OF LANDFILL GAS BURNED IN THE FLARE STATION SHALL NOT EXCEED 8700 STANDARD CUBIC FEET PER MINUTE.
[RULE 1303(b)(2)-OFFSET]
15. ALL LANDFILL GAS COLLECTED SHALL BE DIRECTED TO THE FLARE FOR COMBUSTION OR OTHER APPROVED DISPOSAL METHOD.
[RULE 1150.1, 1303(a)(1)-BACT, 1401, 40 CFR 63 SUBPART AAAA]
16. FLOW INDICATING AND RECORDING DEVICES SHALL BE INSTALLED AND MAINTAINED TO MEASURE AND RECORD THE LIQUID CONDENSATE INJECTION RATE INTO EACH OF FLARES 7, 8, AND 9.
[RULE 1303(b)(2)-OFFSET]
17. THE VOLUME FLOW OF LIQUID CONDENSATE INJECTED INTO EACH OF FLARES 7, 8, AND 9 SHALL NOT EXCEED 2.5 GPM PER FLARE.
[RULE 1303(b)(2)-OFFSET]
18. THE TOTAL VOLUME OF LIQUID INJECTED EACH OF FLARES 7, 8, AND 9 SHALL NOT EXCEED 1500 GALLONS PER DAY (GPD) PER FLARE.
[RULE 1303(b)(2)-OFFSET]
19. A CONTINUOUS EXHAUST TEMPERATURE MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED PURSUANT TO THE OPERATION AND MAINTENANCE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.7. SUCH A SYSTEM SHALL HAVE AN ACCURACY OF WITHIN +/- 1% OF THE TEMPERATURE BEING MONITORED AND SHALL BE INSPECTED, MAINTAINED, AND CALIBRATED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS USING AN APPLICABLE SCAQMD OR EPA APPROVED METHOD.
[40 CFR 64]
20. FOR THE PURPOSE OF THIS CONDITION, A DEVIATION SHALL BE DEFINED AS WHEN THE EXHAUST TEMPERATURE LESS THAN 1400 DEGREES FAHRENHEIT AVERAGED OVER 15 MINUTES OCCURS DURING NORMAL OPERATION EXCEPT DURING STARTUPS OR SHUTDOWNS. THE EXHAUST TEMPERATURE SHALL BE RECORDED AT LEAST EVERY 15 MINUTES, AND HOURLY AVERAGES SHALL BE CALCULATED FROM SUCH DATA POINTS. THE OPERATOR SHALL REVIEW THE RECORDS OF EXHAUST TEMPERATURE ON A DAILY BASIS TO DETERMINE IF A DEVIATION OCCURS OR SHALL INSTALL AN ALARM SYSTEM TO ALERT THE OPERATOR WHEN A DEVIATION OCCURS.
[40 CFR 64]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

21. ALL DEVIATIONS SHALL BE REPORTED TO THE SCAQMD ON A SEMI-ANNUAL BASIS PURSUANT TO THE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.9 AND CONDITION NOS. 22 AND 23 IN SECTION K. OF THIS PERMIT.
[40 CFR 64]
22. FOR EACH SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K, WHENEVER A DEVIATION OCCURS FROM THE EXHAUST TEMPERATURE, THE OPERATOR SHALL TAKE IMMEDIATE CORRECTIVE ACTION, AND KEEP RECORDS OF THE DURATION AND CAUSE (INCLUDING UNKNOWN CAUSE, IF APPLICABLE) OF THE DEVIATION AND THE CORRECTIVE ACTION TAKEN.
[40 CFR 64]
23. A SEMI-ANNUAL MONITORING REPORT SHALL BE SUBMITTED TO SCAQMD, WHICH SHALL INCLUDE BUT MAY NOT BE LIMITED TO THE TOTAL OPERATING TIME OF THIS EQUIPMENT AND THE TOTAL ACCUMULATED DURATION OF ALL DEVIATIONS FOR EACH SEMI-ANNUAL REPORTING PERIOD.
[40 CFR 64]
24. THE OWNER OR OPERATOR SHALL SUBMIT AN APPLICATION WITH A QUALITY IMPROVEMENT PLAN (QIP) IN ACCORDANCE WITH 40 CFR PART 64.8 TO SCAQMD IF AN ACCUMULATION OF DEVIATIONS FOR PARAMETERS MONITORED EXCEEDS 5% DURATION OF THIS EQUIPMENT'S TOTAL OPERATING TIME FOR ANY SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K OF THIS PERMIT. THE REQUIRED QIP SHALL BE SUBMITTED TO THE SCAQMD WITHIN 90 CALENDAR DAYS AFTER THE DUE DATE OF THE SEMI-ANNUAL MONITORING REPORT.
[40 CFR 64]
25. ALL RECORDS SHALL BE KEPT FOR A PERIOD OF AT LEAST FIVE (5) YEARS IN A FORMAT ACCEPTABLE TO SCAQMD AND IN COMPLIANCE WITH 40 CFR PART 64.9 AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1150.1, RULE 1303(b)(2)- OFFSET, 40 CFR 64]
26. ALL RECORDING DEVICES SHALL BE SYNCHRONIZED WITH RESPECT TO THE TIME OF DAY.
[RULE 1303(b)(2)-OFFSET]
27. THE FLARE SHALL BE EQUIPPED WITH A SUFFICIENT NUMBER OF VIEW PORTS TO ALLOW VISUAL INSPECTION OF THE BURNER WITHIN THE FLARE AT ALL TIMES. SAFE AND ADEQUATE ACCESS SHALL BE PROVIDED FOR ALL VIEW PORTS UPON REQUEST BY AQMD PERSONNEL.
[RULE 217, 1303(a)(1)-BACT]
28. THE FLARE SHALL BE DESIGNED AND OPERATED SO THAT THE FLAME IN THE FLARE REMAINS BELOW THE HEIGHT OF THE FLARE'S OPERATING THERMOCOUPLE AT ALL TIMES.
[RULE 1303(a)(1)-BACT]
29. THE MAXIMUM FLARE SKIN TEMPERATURE AT ANY LOCATION SHALL NOT EXCEED 250 DEGREES F.
[RULE 217]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

30. OPERATION OF THIS EQUIPMENT SHALL NOT RESULT IN THE RELEASE OF RAW LANDFILL GAS INTO THE ATMOSPHERE. ANY BREAKDOWN OR MALFUNCTION WHICH RESULTS IN EMISSIONS OF RAW LANDFILL GAS SHALL BE REPORTED TO THE SCAQMD IN ACCORDANCE WITH RULE 430 REQUIREMENTS, AND IMMEDIATE REMEDIAL MEASURES SHALL BE UNDERTAKEN TO CORRECT THE PROBLEM AND PREVENT FURTHER EMISSIONS INTO THE ATMOSPHERE.
[RULE 402, 430, 1150.1]

31. WITHIN FORTY-FIVE (45) DAYS OF ANNIVERSARY OF INITIAL SOURCE TEST, UNLESS OTHERWISE APPROVED BY THE EXECUTIVE OFFICER, THE APPLICANT SHALL CONDUCT ANNUAL PERFORMANCE TESTS ON A REPRESENTATIVE NUMBER OF FLARES, IN ACCORDANCE WITH SCAQMD APPROVED TEST PROCEDURES, AND FURNISH THE SCAQMD WRITTEN RESULTS OF SUCH PERFORMANCE TESTS WITHIN SIXTY (60) DAYS AFTER TESTING. WRITTEN NOTICE OF THE PERFORMANCE TESTS SHALL BE PROVIDED TO THE SCAQMD TEN (10) DAYS PRIOR TO TESTING SO THAT AN OBSERVER MAY BE PRESENT. ALL SOURCE TESTING AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE SCAQMD FOR APPROVAL AT LEAST THIRTY (30) DAYS PRIOR TO START OF TESTS. THE TESTS SHALL INCLUDE, BUT MAY NOT BE LIMITED TO, A TEST OF THE INLET GAS TO THE FLARE(S) AND THE FLARE(S) EXHAUST FOR:

- A. METHANE
- B. TOTAL NON-METHANE HYDROCARBONS
- C. OXIDES OF NITROGEN (EXHAUST ONLY)
- D. CARBON MONOXIDE (EXHAUST ONLY)
- E. TOTAL PARTICULATES (EXHAUST ONLY)
- F. HYDROGEN SULFIDE (INLET ONLY)
- G. C 1 THROUGH C3 SULFUR COMPOUNDS (SPECIATED) (INLET ONLY)
- H. CARBON DIOXIDE
- I. TOXIC AIR CONTAMINANTS
- J. OXYGEN
- K. NITROGEN
- L. MOISTURE CONTENT
- M. TEMPERATURE
- N. FLOW RATE

- OR -

SOURCE TESTS SHALL BE CONDUCTED ON A REPRESENTATIVE NUMBER OF FLARES IN ACCORDANCE WITH AN APPROVED RULE 1150.1 COMPLIANCE PLAN.
[RULE 1150.1, 1303(a)(1)-BACT, 1303(b)(2)-OFFSET, 1401, 40 CFR 63 SUBPART AAAA]

32. EMISSIONS RESULTING FROM EACH FLARE (NOS. 1-6) SHALL NOT EXCEED THE FOLLOWING:

POLLUTANT	LBS./HR
NOX, AS N02	0.86
SOX, AS SO2	1.5
CO	0.34
PM	1.0
NMHC, AS METHANE	0.74

[RULE 1303(b)(2)-OFFSET]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

33. EMISSIONS RESULTING FROM EACH FLARE (NOS. 7-9), WITHOUT LIQUID INJECTION, SHALL NOT EXCEED THE FOLLOWING:

POLLUTANT	LBS./HR
NOX, AS N02	1.05
SOX ,AS SO2	2.3
CO	0.51
PMIO	0.95
NMHC, AS METHANE	0.37

[RULE 1303(b)(2)-OFFSET]

34. EMISSIONS RESULTING FROM EACH FLARE (NOS. 7-9), WITH LIQUID INJECTION, SHALL NOT EXCEED THE FOLLOWING:

POLLUTANT	LBS./HR
NOX, AS N02	1.55
SOX, AS S02	2.3
CO	0.51
PMIO	4.44
NMHC, AS METHANE	0.37

[RULE 1303(b)(2)-OFFSET]

35. OXIDES OF NITROGEN EMISSIONS SHALL NOT EXCEED 0.06 POUNDS PER MILLION BTU'S INLET GAS.
[RULE 1303(a)(1)-BACT]

Emissions and Requirements:

36. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

NMOC: 20 PPMV OR 98 WEIGHT PERCENT REDUCTION, RULE 1150.1
NMOC: 20 PPMV OR 98 WEIGHT PERCENT REDUCTION, 40 CFR 63 SUBPART AAAA
CO: 2000 PPM, RULE 407
PM: 0.1 GR/SCF, RULE 409
PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

PERMIT TO CONSTRUCT/OPERATE

**Permit No. G8396
A/N 501731**

Equipment Description:

AIR STRIPPER SYSTEM NO. 1, AT SCALE AREA, FOR TREATMENT OF LANDFILL LIQUIDS – BARRIER (#1, 2 & 5) CANYON WATER, LCRS, UNDERDRAIN WATER, AND LANDFILL GAS CONDENSATE LIQUID, CONSISTING OF:

1. INFLUENT WATER STORAGE TANK, 10,000 GALLONS CAPACITY AND PIPED TO LANDFILL GAS CONDENSATE COLLECTION TANKS (F15737).
2. AIR STRIPPER (NO. 1), PACKED COLUMN TYPE, 3' DIA. BY 35'-0" H., 90 GPM CAPACITY, WITH 700 CFM AIR BLOWER, WITH DIRECT FEED FROM COLLECTION TANKS (F15737) FOR BATCH TREATMENT, AND VENTING TO LANDFILL GAS COLLECTION SYSTEM (F51198).
3. AIR STRIPPER (BACKUP/TEMPORARY), PACKED BED COLUMN TYPE, 30 GPM, WITH 400 CFM AIR BLOWER.
4. TREATED EFFLUENT STORAGE TANK, 5000 GALLONS.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS PERMIT SHALL EXPIRE IF CONSTRUCTION OF THE EQUIPMENT IS NOT COMPLETED WITHIN ONE YEAR FROM MAY 11, 2010 UNLESS AN EXTENSION IS GRANTED BY THE EXECUTIVE OFFICER.
[RULE 205]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

4. THIS EQUIPMENT SHALL ONLY BE USED TO TREAT LANDFILL LIQUIDS SHOWN UNDER THE EQUIPMENT DESCRIPTION.
[RULE 204]
5. THIS EQUIPMENT SHALL NOT BE OPERATED UNLESS THE EXHAUST AIR FROM THE AIR STRIPPER (S) AND THE VENTING OF THE INFLUENT WATER STORAGE TANK ARE VENTED TO THE LFG COLLECTION SYSTEM, AND TO THE AIR POLLUTION CONTROL EQUIPMENT WHICH IS IN FULL USE AND HAS A VALID PERMIT FROM THE AQMD.
[RULE 402, 1303(a)(1)-BACT, 1401]
6. FLOW METER SHALL BE INSTALLED AND MAINTAINED FOR THE AIR STRIPPER TO MEASURE AND RECORD THE RESPECTIVE LANDFILL LIQUIDS FEED RATE (GPM) AND AIR FLOW RATE (CFM). WHEN IN OPERATION, FLOW RATE READINGS (GPM AND CFM) SHALL BE RECORDED ONCE A DAY, EVERY BUSINESS DAY, MONDAY THROUGH FRIDAY.
[RULE 204]
7. THIS EQUIPMENT SHALL TREAT NO MORE THAN 129,600 GALLONS OF LANDFILL LIQUIDS, INCLUDING DIRECT BATCH OR BLENDED WATER TREATMENT OF THE LFG CONDENSATE, IN ANY ONE DAY.
[RULE 1303 (b) (2)-OFFSET, 1304, 1401]
8. SEMI-ANNUALLY GRAB SAMPLES OF AIR STRIPPER LIQUIDS INFLUENT WATER SHALL BE COLLECTED AND ANALYZED FOR ORGANIC COMPOUNDS PRESENT. RESULTS FOR INFLUENT SAMPLES' ANALYSIS SHALL BE KEPT ON FILE.
[RULE 3004 (a) (2)]
9. THE BACKUP/TEMPORARY AIR STRIPPER SHALL ONLY OPERATE IF ANY PRIMARY STRIPPER (NO. 1 OR 2) IS OUT OF SERVICE.
[RULE 204]
10. ALL RECORDS SHALL BE KEPT FOR A PERIOD OF AT LEAST FIVE YEARS AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 3004 (a) (2)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, COATING EQUIPMENT, PORTABLE, ARCHITECTURAL COATINGS.

Periodic Monitoring:

1. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):

FOR ARCHITECTURAL APPLICATIONS WHERE NO THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN SEMI-ANNUAL RECORDS OF ALL COATINGS CONSISTING OF:

- A. COATING TYPE,
- B. VOC CONTENT AS SUPPLIED IN GRAMS PER LITER (g/l) OF MATERIALS FOR LOW-SOLIDS COATINGS'
- C. VOC CONTENT AS SUPPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.

FOR OTHER ARCHITECTURAL APPLICATIONS WHERE THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN DAILY RECORDS FOR EACH COATING CONSISTING OF:

- A. COATING TYPE,
- B. VOC CONTENT AS APPLIED IN GRAMS PER LITER (g/l) OF MATERIALS USED FOR LOW-SOLIDS COATINGS'
- C. VOC CONTENT AS APPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.
[RULE 3004 (a) (4)]

Emissions and Requirements:

2. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

VOC: RULE 1113, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, HAND WIPING OPERATIONS.

Emissions and Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, WOOD CHIPPING/GRINDING OPERATIONS.

Emissions and Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

RULE 1133
RULE 1133.1

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION E: ADMINISTRATIVE CONDITIONS

The operating conditions in this section shall apply to all permitted equipment at this facility unless superseded by condition(s) listed elsewhere in this permit.

1. The permit shall remain effective unless this permit is suspended, revoked, modified, reissued, denied, or it is expired for nonpayment of permit processing or annual operating fees. [201, 203, 209, 301]
 - a. The permit must be renewed annually by paying annual operating fees, and the permit shall expire if annual operating fees are not paid pursuant to requirements of Rule 301(d). [301(d)]
 - b. The Permit to Construct listed in Section H shall expire one year from the Permit to Construct issuance date, unless a Permit to Construct extension has been granted by the Executive Officer or unless the equipment has been constructed and the operator has notified the Executive Officer prior to the operation of the equipment, in which case the Permit to Construct serves as a temporary Permit to Operate. [202, 205]
 - c. The Title V permit shall expire as specified under Section K of the Title V permit. The permit expiration date of the Title V facility permit does not supercede the requirements of Rule 205. [205, 3004]
2. The operator shall maintain all equipment in such a manner that ensures proper operation of the equipment. [204]
3. This permit does not authorize the emissions of aircontaminants in excess of those allowed by Division 26 of the Health and Safety Code of the State of California or the Rules and Regulations of the AQMD. This permit cannot be considered as permission to violate existing laws, ordinances, regulations, or statutes of other governmental agencies. [204]
4. The operator shall not use equipment identified in this facility permit as being connected to air pollution control equipment unless they are so vented to the identified air pollution control equipment which is in full use and which has been included in this permit. [204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION E: ADMINISTRATIVE CONDITIONS

5. The operator shall not use any equipment having air pollution control device(s) incorporated within the equipment unless the air pollution control device is in full operation. [204]
6. The operator shall maintain records to demonstrate compliance with rules or permit conditions that limit equipment operating parameters, or the type or quantity of material processed. These records shall be made available to AQMD personnel upon request and be maintained for at least five years. [204]
7. The operator shall maintain and operate all equipment to ensure compliance with all emission limits as specified in this facility permit. Compliance with emission limits shall be determined according to the following specifications, unless otherwise specified by AQMD rules or permit conditions: [204]
 - a. For internal combustion engines and gas turbines, measured concentrations shall be corrected to 15 percent stack-gas oxygen content on a dry basis and be averaged over a period of 15 consecutive minutes; [1110.2, 1134]
 - b. For other combustion devices, measured concentrations shall be corrected to 3 percent stack-gas oxygen content on a dry basis and be averaged over a period of 15 consecutive minutes; [1146, 1146.1, 204]
 - c. For non-combustion sources, compliance with emission limits shall be determined and averaged over a period of 60 minutes; [204]
 - d. For the purpose of determining compliance with Rule 407, carbon monoxide (CO) shall be measured on a dry basis and be averaged over 15 consecutive minutes, and sulfur compounds which would exist as liquid or gas at standard conditions shall be calculated as sulfur dioxide (SO₂) and be averaged over 15 consecutive minutes; [407]
 - e. For the purpose of determining compliance with Rule 409, combustion contaminant emission measurements shall be corrected to 12 percent of carbon dioxide (CO₂) at standard conditions and averaged over a minimum of 15 consecutive minutes. [409]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION E: ADMINISTRATIVE CONDITIONS

- f. For the purpose of determining compliance with Rule 475, combustion contaminant emission measurements shall be corrected to 3 percent of oxygen (O₂) at standard conditions and averaged over 15 consecutive minutes or any other averaging time specified by the Executive Officer. [475]
8. The operator shall, when a source test is required by AQMD, provide a source test protocol to AQMD no later than 60 days before the proposed test date. The test shall not commence until the protocol is approved by AQMD. The test protocol shall contain the following information: [204, 304]
 - a. Brief description of the equipment tested.
 - b. Brief process description, including maximum and normal operating temperatures, pressures, throughput, etc.
 - c. Operating conditions under which the test will be performed.
 - d. Method of measuring operating parameters, such as fuel rate and process weight. Process schematic diagram showing the ports and sampling locations, including the dimensions of the ducts and stacks at the sampling locations, and distances of flow disturbances, (e.g. elbows, tees, fans, dampers) from the sampling locations (upstream and downstream).
 - e. Brief description of sampling and analytical methods used to measure each pollutant, temperature, flow rates, and moisture.
 - f. Description of calibration and quality assurance procedures.
 - g. Determination that the testing laboratory qualifies as an "independent testing laboratory" under Rule 304 (conflict of interest).
9. The operator shall submit a report no later than 60 days after conducting a source test, unless otherwise required by AQMD rules or equipment-specific conditions. The report shall contain the following information: [204]
 - a. The results of the source test.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION E: ADMINISTRATIVE CONDITIONS

- b. Brief description of the equipment tested.
 - c. Operating conditions under which the test was performed.
 - d. Method of measuring operating parameters, such as fuel rate and process weight. Process schematic diagram showing the ports and sampling locations, including the dimensions of the ducts and stacks at the sampling locations, and distances of flow disturbances, (e.g. elbows, tees, fans, dampers) from the sampling locations (upstream and downstream).
 - e. Field and laboratory data forms, strip charts and analyses.
 - f. Calculations for volumetric flow rates, emission rates, control efficiency, and overall control efficiency.
10. The operator shall, when a source test is required, provide and maintain facilities for sampling and testing. These facilities shall comply with the requirements of AQMD Source Test Method 1.1 and 1.2. [217]
11. Whenever required to submit a written report, notification or other submittal to the Executive Officer, AQMD, or the District, the operator shall mail or deliver the material to: Deputy Executive Officer, Engineering and Compliance, AQMD, 21865 E. Copley Drive, Diamond Bar, CA 91765-4182. [204]

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

SECTION F: RECLAIM MONITORING AND SOURCE TESTING REQUIREMENTS

NOT APPLICABLE

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

**SECTION G: RECORDKEEPING AND REPORTING REQUIREMENTS FOR
RECLAIM SOURCES**

NOT APPLICABLE

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

This section consists of a table listing all equipment with Permits to Construct and copies of all individual Permits to Construct issued to various equipment at the facility. Each permit will list operating conditions including periodic monitoring requirements and applicable emission limits and requirements that the equipment is subject to. Also included is the rule origin and authority of each emission limit and permit condition.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMITTED EQUIPMENT LIST

THE FOLLOWING IS A LIST OF ALL PERMITS TO CONSTRUCT AND PERMITS TO OPERATE AT THIS FACILITY:

Application No.	Permit to Operate No.	Equipment description	Pg. No.
458588	-	LANDFILL GAS CONTROL AND LANDFILL GAS TO ENERGY SYSTEM NO. 1 (GAS TURBINE)	3
458589	-	LANDFILL GAS CONTROL AND LANDFILL GAS TO ENERGY SYSTEM NO. 2 (GAS TURBINE)	9
458590	-	LANDFILL GAS CONTROL AND LANDFILL GAS TO ENERGY SYSTEM NO. 3 (GAS TURBINE)	15

NOTE: EQUIPMENT LISTED ABOVE THAT HAVE NO CORRESPONDING PERMIT TO OPERATE NUMBER ARE ISSUED PERMITS TO CONSTRUCT. THE ISSUANCE OR DENIAL OF THEIR PERMITS TO OPERATE IS SUBJECT TO ENGINEERING FINAL REVIEW. ANY OTHER APPLICATIONS THAT ARE STILL BEING PROCESSED AND HAVE NOT BEEN ISSUED PERMITS TO CONSTRUCT OR PERMITS TO OPERATE WILL NOT BE FOUND IN THIS TITLE V PERMIT.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO CONSTRUCT

Granted: 11/27/2007
A/N 458588

Equipment Description:

LANDFILL GAS CONTROL AND GAS-TO-ENERGY SYSTEM, NO. 1, CONSISTING OF:

1. LANDFILL GAS (LFG) TREATMENT SYSTEM, SKID MOUNTED, 2500 SCFM @ 33% METHANE OR 51.6 MMBTU/HR CAPACITY, CONSISTING OF:
 - A. MOISTURE SEPARATOR.
 - B. COMPRESSOR, APPROXIMATELY 700 HP.
 - C. HEAT EXCHANGER(S) AND GAS CHILLER.
 - D. TWO SORBENT BEDS, IN SERIES, EACH CONTAINING SILICA GEL OR EQUIVALENT MEDIA.
 - E. COALESCING FILTER FOR PARTICULATE MATTER REMOVAL, 0.3 MICRONS.
2. GAS TURBINE, SOLAR, MERCURY 50, LANDFILL GAS (LFG) AND NATURAL GAS AUGMENTATION, MAXIMUM 51.6 MILLION BTU PER HOUR INPUT RATING, SIMPLE CYCLE, WITH ELECTRIC START MOTOR, TEN-STAGE AXIAL FLOW COMPRESSOR, ULTRA LEAN PREMIX (ULP) ANNULAR COMBUSTOR, A RECUPERATOR, AUTOMATIC PILOT AND FUEL CONTROL SYSTEM, PROGRAMMABLE CONTROLLER, AND DRIVING A 4.6 MEGAWATT (MW) ELECTRIC GENERATOR.
3. EXHAUST STACK, 4' DIA. X 25' HIGH.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. THE OWNER OR OPERATOR OF THIS EQUIPMENT SHALL PROVIDE TO SCAQMD THE LANDFILL GAS TREATMENT SYSTEM AND GAS TURBINE FINAL DESIGN DRAWINGS, P & I DIAGRAMS, CONTROL DIAGRAMS, EQUIPMENT SPECIFICATIONS (MAKE, MODEL, DIMENSIONS, SIZE AND MAXIMUM CAPACITY) AT LEAST 30 DAYS PRIOR TO INSTALLATION OF THE EQUIPMENT.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

5. THIS EQUIPMENT SHALL ONLY BE FIRED WITH LANDFILL GAS OR A BLEND OF LANDFILL GAS AND NATURAL GAS FUEL. FOR THIS FUEL BLEND, THE HEAT INPUT FROM NATURAL GAS SHALL NOT EXCEED 25% OF THE TOTAL HEAT INPUT TO THE TURBINE ON AN ANNUAL BASIS. NATURAL GAS SHALL ONLY BE USED FOR START-UP AND FOR ADEQUATE PERFORMANCE OF THE TURBINE AS A LANDFILL GAS CONTROL DEVICE IN CASE THE QUALITY OF THE LANDFILL GAS IS NOT SUFFICIENT IN MEETING THE MANUFACTURER'S MINIMUM SPECIFICATIONS.
[RULE 204, 1303(b)(2) OFFSET]
6. FLOW INDICATING AND RECORDING DEVICES SHALL BE INSTALLED AND MAINTAINED IN THE LANDFILL GAS AND NATURAL GAS SUPPLY LINE TO THE GAS TURBINE TO MEASURE AND RECORD THE QUANTITY OF LANDFILL GAS AND NATURAL GAS (IN SCFM) SUPPLIED.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
7. WEEKLY READINGS OF THE BTU CONTENT OF LANDFILL GAS AT THE INLET TO THE GAS TURBINE SHALL BE TAKEN USING AN INSTRUMENT APPROVED BY THE SCAQMD. ALL RESULTS SHALL BE RECORDED.
[RULE 1303(b)(2)-OFFSET, 3004(a)(4)]
8. THE TOTAL COMBINED VOLUME AND HEAT INPUT OF LANDFILL GAS BURNED IN THE GAS TURBINES AND FLARES SHALL NOT EXCEED 8700 SCFM AND 178.2 MMBTU PER HOUR RESPECTIVELY. RECORDS OF LFG FLOW RATE, BTU CONTENT, AND TOTAL HEAT INPUT SHALL BE KEPT AND MAINTAINED ON FILE.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 1309.1, 3004(a)(4)]
9. THE TOTAL HEAT INPUT OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE SHALL NOT EXCEED 51.6 MMBTU PER HOUR. A LOG SHALL BE KEPT INDICATING THE TOTAL HEATING VALUE OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE BASED ON THE RECORDED FLOW RATE (SCFM) FOR EACH FUEL AND THE LATEST WEEKLY BTU CONTENT READING.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
10. A CONTINUOUS COMBUSTION CHAMBER TEMPERATURE MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED PURSUANT TO THE OPERATION AND MAINTENANCE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.7. SUCH A SYSTEM SHALL HAVE AN ACCURACY OF WITHIN $\pm 1\%$ OF THE TEMPERATURE BEING MONITORED AND SHALL BE INSPECTED, MAINTAINED, AND CALIBRATED ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS USING AN APPLICABLE SCAQMD OR EPA APPROVED METHOD.
[40 CFR 64]
11. FOR THE PURPOSE OF THIS CONDITION, A DEVIATION SHALL BE DEFINED AS WHEN THE COMBUSTION CHAMBER TEMPERATURE LESS THAN 1100 DEGREES FAHRENHEIT OR GREATER 1300 DEGREES FAHRENHEIT OCCURS AVERAGED OVER ONE HOUR DURING OPERATION EXCEPT DURING START UP AND SHUTDOWN EVENTS LASTING FOR A MAXIMUM OF ONE HOUR. MULTIPLE START UP AND SHUTDOWN EVENTS CAN OCCUR CONSECUTIVELY.
[40 CFR 64]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

12. THE COMBUSTION CHAMBER TEMPERATURE SHALL BE RECORDED AT LEAST EVERY 15 MINUTES, AND THE HOURLY AVERAGE SHALL BE COMPUTED FROM SUCH DATA POINTS. THE OPERATOR SHALL REVIEW THE RECORDS OF TEMPERATURE ON A DAILY BASIS TO DETERMINE IF A DEVIATION OCCURRED OR SHALL INSTALL AN ALARM SYSTEM TO ALERT THE OPERATOR WHEN A DEVIATION OCCURS.
[40 CFR 64]
13. ALL DEVIATIONS SHALL BE REPORTED TO THE SCAQMD ON A SEMI-ANNUAL BASIS PURSUANT TO THE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.9 AND CONDITION NOS. 22 AND 23 IN SECTION K OF THIS PERMIT.
[40 CFR 64]
14. FOR EACH SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K, WHENEVER A DEVIATION OCCURS FROM THE TEMPERATURE, THE OPERATOR SHALL TAKE IMMEDIATE CORRECTIVE ACTION, AND KEEP RECORDS OF THE DURATION AND CAUSE (INCLUDING UNKNOWN CAUSE, IF APPLICABLE) OF THE DEVIATION AND THE CORRECTIVE ACTION TAKEN.
[40 CFR 64]
15. A SEMI-ANNUAL MONITORING REPORT SHALL BE SUBMITTED TO SCAQMD, WHICH SHALL INCLUDE BUT MAY NOT BE LIMITED TO THE TOTAL OPERATING TIME OF THIS EQUIPMENT AND THE TOTAL ACCUMULATED DURATION OF ALL DEVIATIONS FOR EACH SEMI-ANNUAL REPORTING PERIOD.
[40 CFR 64]
16. THE OWNER OR OPERATOR SHALL SUBMIT AN APPLICATION WITH A QUALITY IMPROVEMENT PLAN (QIP) IN ACCORDANCE WITH 40 CFR PART 64.8 TO THE SCAQMD IF AN ACCUMULATION OF DEVIATIONS EXCEEDS 5% DURATION OF THIS EQUIPMENT'S TOTAL OPERATING TIME FOR ANY SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K OF THIS PERMIT. THE REQUIRED QIP SHALL BE SUBMITTED TO THE SCAQMD WITHIN 90 CALENDAR DAYS AFTER THE DUE DATE OF THE SEMI-ANNUAL MONITORING REPORT.
[40 CFR 64]
17. THE OPERATOR SHALL INSPECT AND MAINTAIN ALL COMPONENTS OF THIS EQUIPMENT ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
[RULE 3004(a)(4)]
18. THE OPERATOR SHALL KEEP ALL RECORDS FOR A PERIOD OF AT LEAST FIVE (5) YEARS IN A FORMAT ACCEPTABLE TO THE SCAQMD AND IN COMPLIANCE WITH 40 CFR PART 64.9 AND SHALL BE MADE AVAILABLE TO SCAQMD PERSONNEL UPON REQUEST.
[RULE 1150.1, 40CFR PART 64]
19. ALL RECORDING DEVICES SHALL BE SYNCHRONIZED WITH RESPECT TO THE TIME OF THE DAY.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

20. LANDFILL GAS NOT UTILIZED BY THIS EQUIPMENT SHALL BE DIRECTED TO COMBUSTION OR PROCESSING FACILITY WHICH IS IN FULL USE, CAN ADEQUATELY PROCESS THE VOLUME OF GAS COLLECTED AND HAS BEEN ISSUED A VALID PERMIT BY THE SCAQMD.
[RULE 1303(a)(1)-BACT]
21. OPERATION OF THIS EQUIPMENT SHALL NOT RESULT IN THE RELEASE OF RAW LANDFILL GAS INTO THE ATMOSPHERE. ANY BREAKDOWN OR MALFUNCTION WHICH RESULTS IN EMISSIONS OF LANDFILL GAS SHALL BE REPORTED TO THE SCAQMD WITHIN ONE HOUR AFTER OCCURRENCE, OR WITHIN ONE HOURS OF THE TIME THE OPERATING PERSONNEL KNEW OR REASONABLY SHOULD HAVE KNOWN OF THE OCCURRENCE, AND IMMEDIATE REMEDIAL MEASURES SHALL BE UNDERTAKEN TO CORRECT THE PROBLEM AND PREVENT FURTHER EMISSIONS INTO THE ATMOSPHERE.
[RULE 402, 430, 1150.1]
22. THIS EQUIPMENT SHALL BE OPERATED IN COMPLIANCE WITH SCAQMD RULE 431.1.
[RULE 431.1]
23. ADEQUATE NUMBER OF SAMPLING PORTS AND WELDED NIPPLES WITH CAPS, WITH ITS SAFE ACCESS SHALL BE INSTALLED AND MAINTAINED IN THE EXHAUST STACK IN ACCORDANCE WITH RULE 217 AND SCAQMD'S APPROVAL.
[RULE 217]
24. A CONTINUOUS EMISSION MONITORING SYSTEM (CEMS), APPROVED BY THE EXECUTIVE OFFICER, SHALL BE INSTALLED, OPERATED AND MAINTAINED TO MEASURE THE EXHAUST CONCENTRATION FOR NO_x AND O₂, ON A DRY BASIS. IN ADDITION, THE SYSTEM SHALL CONVERT THE ACTUAL NO_x CONCENTRATION TO A CORRECTED NO_x CONCENTRATION AT 15% O₂ AND CONTINUOUS RECORD THE STACK NO_x CONCENTRATION AT 15% O₂. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF SCAQMD RULE 218. PRIOR TO INSTALLATION, THIS MONITORING SYSTEM SHALL BE APPROVED IN WRITING BY THE EXECUTIVE OFFICER.
[RULE 218, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
25. WITHIN 180 DAYS AFTER INITIAL START-UP AND ANNUALLY (WITHIN 45 DAYS OF ANNIVERSARY OF INITIAL TEST), THEREAFTER, THE OPERATOR SHALL CONDUCT PERFORMANCE TESTS IN ACCORDANCE WITH THE APPROVED TEST PROCEDURES. WRITTEN RESULTS OF SUCH PERFORMANCE TESTS SHALL BE SUBMITTED WITHIN 60 DAYS AFTER TESTING. NOTICE SHALL BE PROVIDED TO THE SCAQMD 10 DAYS PRIOR TO THE TESTING SO THAT AN OBSERVER MAY BE PRESENT. ALL SOURCE TESTING AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE AQMD FOR APPROVAL AT LEAST 30 DAYS PRIOR TO START OF THE TESTS. THE TESTS SHALL INCLUDE, BUT MAY NOT BE LIMITED TO, A TEST OF THE INLET LANDFILL GAS/NATURAL GAS BLEND AND THE GAS TURBINE EXHAUST FOR:
 - A. METHANE AND TOTAL NON-METHANE HYDROCARBONS
 - B. CARBON MONOXIDE (EXHAUST ONLY)
 - C. OXIDES OF NITROGEN (EXHAUST ONLY)
 - D. CARBON DIOXIDE
 - E. TOTAL PARTICULATES (EXHAUST ONLY)
 - F. C1 THROUGH C3 SULFUR COMPOUNDS (SPECIATED, INLET ONLY)
 - G. FORMALDEHYDE (EXHAUST ONLY)

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

- H. TOXIC AIR CONTAMINANTS (INLET AND EXHAUST) INCLUDING, BUT NOT LIMITED TO, BENZENE, CHLOROBENZENE, 1,2-DICHLOROETHANE, 1,1-DICHLOROETHENE, DICHLOROMETHANE, TETRACHLOROETHYLENE, TETRACHLOROMETHANE, TOLUENE, 1,1,1-TRICHLOROETHANE, TRICHLOROETHYLENE, TRICHLOROMETHANE, VINYL CHLORIDE, AND XYLENE ISOMERS.
- I. OXYGEN AND NITROGEN
- J. MOISTURE CONTENT
- K. TEMPERATURE
- L. FLOW RATE
- M. VOLATILE ORGANIC COMPOUNDS (VOCS) CONTROL EFFICIENCY, WT% (BASED ON INLET AND EXHAUST VOCS)

THE REPORT SHALL PRESENT THE EMISSIONS DATA IN UNITS OF POUNDS PER HOUR (LB/HR), POUNDS PER MILLION BTU (LB/MMBTU), AND PARTS PER MILLION (PPMV) ON A DRY BASIS AT 15% O₂ (CO, NO_x, AND TNMOC). THE REPORT SHALL ALSO PROVIDE GAS TURBINE'S DEMONSTRATED EFFICIENCY AT FULL LOAD, IN BTU/KW-HR, CORRECTED TO THE HIGHER HEATING VALUE (HHV) OF THE FUEL.

[RULE 1150.1, 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 40 CFR 63 SUBPART AAAA, 3004(a)(4)]

26. EMISSIONS FROM THE GAS TURBINE SHALL NOT EXCEED THE FOLLOWING:

CONTAMINANT	LBS/DAY
NO _x (AS NO ₂)	127
PM ₁₀	21
TNMOC (AS CH ₄)	12.7
SOX (AS SO ₂)	79

[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]

27. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF OXIDES OF NITROGEN SHALL NOT EXCEED 25 PPMV, CALCULATED AT 15% O₂, DRY BASIS, AND NO LATER THAN TWO YEARS FROM COMMENCING OPERATION, SHALL NOT EXCEED 18.75 PPMV, AT 15% O₂.
[RULE 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]
28. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF CARBON MONOXIDE SHALL NOT EXCEED 130 PPMV, CALCULATED AT 15% O₂, DRY BASIS.
[RULE 1303(a)(1)-BACT]
29. THE GAS TURBINE'S CO AND NO_x EMISSIONS, BASED ON MEASURED AND MONITORED RESULTS, DURING A TWO-YEAR TEST PROGRAM, SHALL BE USED TO ESTABLISH LOWER CO AND NO_x LIMITS OF THE PERMIT TO OPERATE.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

30. THE OWNER OR OPERATOR SHALL CALCULATE THE MAXIMUM INDIVIDUAL CANCER RISK (MICR), ACUTE HAZARD INDEX (HIA) AND CHRONIC HAZARD INDEX (HIC), BASED ON THE SOURCE TESTS RESULTS, USING AQMD PUBLISHED "RISK ASSESSMENT PROCEDURES FOR RULES 1401 AND 212" (VERSION 7.0), TO DETERMINE THE COMPLIANCE WITH RULE 1401. RESULTS SHALL BE SUBMITTED TO AQMD WITHIN 90 DAYS AFTER THE INITIAL TESTING IS COMPLETED.
[RULE 1401]
31. ALL RECORDS SHALL BE KEPT FOR A PERIOD OF AT LEAST FIVE YEARS AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 204, 3004(a)(4)]

Emissions Requirements:

32. THIS EQUIPMENT IS SUBJECT TO THE FOLLOWING APPLICABLE EMISSION LIMITS
- CO: 2000 PPMV, DRY, 15 MIN. AVG., RULE 407
 - CO: 130 PPMV, @ 15% O₂, RULE 1303 BACT
 - NOx: 25 PPMV, @ 15% O₂, RULE 1303 BACT
 - PM: 0.1 GRAINS/DSCF, AT 12% CO₂, RULE 409
 - TNMOC: 20 PPMV, AS HEXANE, @ 3% O₂, OR 98% (BY WT) DESTRUCTION EFFICIENCY, RULE 1150.1, 40 CFR 63 SUBPART AAAA
 - SOX: 0.2%, RULE 53
 - SOX: 0.015%V @ 15% O₂, DRY BASIS OR 0.8%W (8000 PPMW) H₂S IN FUEL, NSPS, 40CFR60, SUBPART GG

Periodic Monitoring:

33. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE NOX EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 7.1. THE TEST SHALL BE CONDUCTED WHEN THE EQUIPMENT IS OPERATING UNDER NORMAL CONDITIONS TO DEMONSTRATE COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT. FOR THE PURPOSE OF DETERMINING COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT, THE EMISSIONS SHALL BE MEASURED AND AVERAGED OVER A 60 MINUTE TIME PERIOD.
[RULE 3004(a)(4)]
34. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE CO EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 10.1. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT.
[RULE 3004(a)(4)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO CONSTRUCT

Granted as of 11/27/2007
A/N 458589

Equipment Description:

LANDFILL GAS CONTROL AND GAS-TO-ENERGY SYSTEM, NO. 2, CONSISTING OF:

1. LANDFILL GAS (LFG) TREATMENT SYSTEM, SKID MOUNTED, 2500 SCFM @ 33% METHANE OR 51.6 MMBTU/HR CAPACITY, CONSISTING OF:
 - A. MOISTURE SEPARATOR.
 - B. COMPRESSOR, APPROXIMATE 700 HP.
 - C. HEAT EXCHANGER(S) AND GAS CHILLER.
 - D. TWO SORBENT BEDS, IN SERIES, EACH CONTAINING SILICA GEL OR EQUIVALENT MEDIA.
 - E. COALESCING FILTER FOR PARTICULATE MATTER REMOVAL, 0.3 MICRONS.
2. GAS TURBINE, SOLAR, MERCURY 50, LANDFILL GAS (LFG) AND NATURAL GAS AUGMENTATION, MAXIMUM 51.6 MILLION BTU PER HOUR INPUT RATING, SIMPLE CYCLE, WITH ELECTRIC START MOTOR, TEN-STAGE AXIAL FLOW COMPRESSOR, ULTRA LEAN PREMIX (ULP) ANNULAR COMBUSTOR, A RECUPERATOR, AUTOMATIC PILOT AND FUEL CONTROL SYSTEM, PROGRAMMABLE CONTROLLER, AND DRIVING A 4.6 MEGAWATT (MW) ELECTRIC GENERATOR.
3. EXHAUST STACK, 4' DIA. X 25' HIGH.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. THE OWNER OR OPERATOR OF THIS EQUIPMENT SHALL PROVIDE TO SCAQMD THE LANDFILL GAS TREATMENT SYSTEM AND GAS TURBINE FINAL DESIGN DRAWINGS, P & I DIAGRAMS, CONTROL DIAGRAMS, EQUIPMENT SPECIFICATIONS (MAKE, MODEL, DIMENSIONS, SIZE AND MAXIMUM CAPACITY) AT LEAST 30 DAYS PRIOR TO INSTALLATION OF THE EQUIPMENT.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

5. THIS EQUIPMENT SHALL ONLY BE FIRED WITH LANDFILL GAS OR A BLEND OF LANDFILL GAS AND NATURAL GAS FUEL. FOR THIS FUEL BLEND, THE HEAT INPUT FROM NATURAL GAS SHALL NOT EXCEED 25% OF THE TOTAL HEAT INPUT TO THE TURBINE ON AN ANNUAL BASIS. NATURAL GAS SHALL ONLY BE USED FOR START-UP AND FOR ADEQUATE PERFORMANCE OF THE TURBINE AS A LANDFILL GAS CONTROL DEVICE IN CASE THE QUALITY OF THE LANDFILL GAS IS NOT SUFFICIENT IN MEETING THE MANUFACTURER'S MINIMUM SPECIFICATIONS.
[RULE 204, 1303(b)(2) OFFSET]
6. FLOW INDICATING AND RECORDING DEVICES SHALL BE INSTALLED AND MAINTAINED IN THE LANDFILL GAS AND NATURAL GAS SUPPLY LINE TO THE GAS TURBINE TO MEASURE AND RECORD THE QUANTITY OF LANDFILL GAS AND NATURAL GAS (IN SCFM) SUPPLIED.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
7. WEEKLY READINGS OF THE BTU CONTENT OF LANDFILL GAS AT THE INLET TO THE GAS TURBINE SHALL BE TAKEN USING AN INSTRUMENT APPROVED BY THE SCAQMD. ALL RESULTS SHALL BE RECORDED.
[RULE 1303(b)(2)-OFFSET, 3004(a)(4)]
8. THE TOTAL COMBINED VOLUME AND HEAT INPUT OF LANDFILL GAS BURNED IN THE GAS TURBINES AND FLARES SHALL NOT EXCEED 8700 SCFM AND 178.2 MMBTU PER HOUR RESPECTIVELY. RECORDS OF LFG FLOW RATE, BTU CONTENT, AND TOTAL HEAT INPUT SHALL BE KEPT AND MAINTAINED ON FILE.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 1309.1, 3004(a)(4)]
9. THE TOTAL HEAT INPUT OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE SHALL NOT EXCEED 51.6 MMBTU PER HOUR. A LOG SHALL BE KEPT INDICATING THE TOTAL HEATING VALUE OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE BASED ON THE RECORDED FLOW RATE (SCFM) FOR EACH FUEL AND THE LATEST WEEKLY BTU CONTENT READING.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
10. A CONTINUOUS COMBUSTION CHAMBER TEMPERATURE MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED PURSUANT TO THE OPERATION AND MAINTENANCE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.7. SUCH A SYSTEM SHALL HAVE AN ACCURACY OF WITHIN $\pm 1\%$ OF THE TEMPERATURE BEING MONITORED AND SHALL BE INSPECTED, MAINTAINED, AND CALIBRATED ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS USING AN APPLICABLE SCAQMD OR EPA APPROVED METHOD.
[40 CFR 64]
11. FOR THE PURPOSE OF THIS CONDITION, A DEVIATION SHALL BE DEFINED AS WHEN THE COMBUSTION CHAMBER TEMPERATURE LESS THAN 1100 DEGREES FAHRENHEIT OR GREATER 1300 DEGREES FAHRENHEIT OCCURS AVERAGED OVER ONE HOUR DURING OPERATION EXCEPT DURING START UP AND SHUTDOWN EVENTS LASTING FOR A MAXIMUM OF ONE HOUR. MULTIPLE START UP AND SHUTDOWN EVENTS CAN OCCUR CONSECUTIVELY.
[40 CFR 64]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

12. THE COMBUSTION CHAMBER TEMPERATURE SHALL BE RECORDED AT LEAST EVERY 15 MINUTES, AND THE HOURLY AVERAGE SHALL BE COMPUTED FROM SUCH DATA POINTS. THE OPERATOR SHALL REVIEW THE RECORDS OF TEMPERATURE ON A DAILY BASIS TO DETERMINE IF A DEVIATION OCCURRED OR SHALL INSTALL AN ALARM SYSTEM TO ALERT THE OPERATOR WHEN A DEVIATION OCCURS.
[40 CFR 64]
13. ALL DEVIATIONS SHALL BE REPORTED TO THE SCAQMD ON A SEMI-ANNUAL BASIS PURSUANT TO THE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.9 AND CONDITION NOS. 22 AND 23 IN SECTION K OF THIS PERMIT.
[40 CFR 64]
14. FOR EACH SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K, WHENEVER A DEVIATION OCCURS FROM THE TEMPERATURE, THE OPERATOR SHALL TAKE IMMEDIATE CORRECTIVE ACTION, AND KEEP RECORDS OF THE DURATION AND CAUSE (INCLUDING UNKNOWN CAUSE, IF APPLICABLE) OF THE DEVIATION AND THE CORRECTIVE ACTION TAKEN.
[40 CFR 64]
15. A SEMI-ANNUAL MONITORING REPORT SHALL BE SUBMITTED TO SCAQMD, WHICH SHALL INCLUDE BUT MAY NOT BE LIMITED TO THE TOTAL OPERATING TIME OF THIS EQUIPMENT AND THE TOTAL ACCUMULATED DURATION OF ALL DEVIATIONS FOR EACH SEMI-ANNUAL REPORTING PERIOD.
[40 CFR 64]
16. THE OWNER OR OPERATOR SHALL SUBMIT AN APPLICATION WITH A QUALITY IMPROVEMENT PLAN (QIP) IN ACCORDANCE WITH 40 CFR PART 64.8 TO THE SCAQMD IF AN ACCUMULATION OF DEVIATIONS EXCEEDS 5% DURATION OF THIS EQUIPMENT'S TOTAL OPERATING TIME FOR ANY SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K OF THIS PERMIT. THE REQUIRED QIP SHALL BE SUBMITTED TO THE SCAQMD WITHIN 90 CALENDAR DAYS AFTER THE DUE DATE OF THE SEMI-ANNUAL MONITORING REPORT.
[40 CFR 64]
17. THE OPERATOR SHALL INSPECT AND MAINTAIN ALL COMPONENTS OF THIS EQUIPMENT ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
[RULE 3004(a)(4)]
18. THE OPERATOR SHALL KEEP ALL RECORDS FOR A PERIOD OF AT LEAST FIVE (5) YEARS IN A FORMAT ACCEPTABLE TO THE SCAQMD AND IN COMPLIANCE WITH 40 CFR PART 64.9 AND SHALL BE MADE AVAILABLE TO SCAQMD PERSONNEL UPON REQUEST.
[RULE 1150.1, 40CFR PART 64]
19. ALL RECORDING DEVICES SHALL BE SYNCHRONIZED WITH RESPECT TO THE TIME OF THE DAY.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

20. LANDFILL GAS NOT UTILIZED BY THIS EQUIPMENT SHALL BE DIRECTED TO COMBUSTION OR PROCESSING FACILITY WHICH IS IN FULL USE, CAN ADEQUATELY PROCESS THE VOLUME OF GAS COLLECTED AND HAS BEEN ISSUED A VALID PERMIT BY THE SCAQMD.
[RULE 1303(a)(1)-BACT]
21. OPERATION OF THIS EQUIPMENT SHALL NOT RESULT IN THE RELEASE OF RAW LANDFILL GAS INTO THE ATMOSPHERE. ANY BREAKDOWN OR MALFUNCTION WHICH RESULTS IN EMISSIONS OF LANDFILL GAS SHALL BE REPORTED TO THE SCAQMD WITHIN ONE HOUR AFTER OCCURRENCE, OR WITHIN ONE HOURS OF THE TIME THE OPERATING PERSONNEL KNEW OR REASONABLY SHOULD HAVE KNOWN OF THE OCCURRENCE, AND IMMEDIATE REMEDIAL MEASURES SHALL BE UNDERTAKEN TO CORRECT THE PROBLEM AND PREVENT FURTHER EMISSIONS INTO THE ATMOSPHERE.
[RULE 402, 430, 1150.1]
22. THIS EQUIPMENT SHALL BE OPERATED IN COMPLIANCE WITH SCAQMD RULE 431.1.
[RULE 431.1]
23. ADEQUATE NUMBER OF SAMPLING PORTS AND WELDED NIPPLES WITH CAPS, WITH ITS SAFE ACCESS SHALL BE INSTALLED AND MAINTAINED IN THE EXHAUST STACK IN ACCORDANCE WITH RULE 217 AND SCAQMD'S APPROVAL.
[RULE 217]
24. A CONTINUOUS EMISSION MONITORING SYSTEM (CEMS), APPROVED BY THE EXECUTIVE OFFICER, SHALL BE INSTALLED, OPERATED AND MAINTAINED TO MEASURE THE EXHAUST CONCENTRATION FOR NO_x AND O₂, ON A DRY BASIS. IN ADDITION, THE SYSTEM SHALL CONVERT THE ACTUAL NO_x CONCENTRATION TO A CORRECTED NO_x CONCENTRATION AT 15% O₂ AND CONTINUOUS RECORD THE STACK NO_x CONCENTRATION AT 15% O₂. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF SCAQMD RULE 218. PRIOR TO INSTALLATION, THIS MONITORING SYSTEM SHALL BE APPROVED IN WRITING BY THE EXECUTIVE OFFICER.
[RULE 218, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
25. WITHIN 180 DAYS AFTER INITIAL START-UP AND ANNUALLY (WITHIN 45 DAYS OF ANNIVERSARY OF INITIAL TEST), THEREAFTER, THE OPERATOR SHALL CONDUCT PERFORMANCE TESTS IN ACCORDANCE WITH THE APPROVED TEST PROCEDURES. WRITTEN RESULTS OF SUCH PERFORMANCE TESTS SHALL BE SUBMITTED WITHIN 60 DAYS AFTER TESTING. NOTICE SHALL BE PROVIDED TO THE SCAQMD 10 DAYS PRIOR TO THE TESTING SO THAT AN OBSERVER MAY BE PRESENT. ALL SOURCE TESTING AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE AQMD FOR APPROVAL AT LEAST 30 DAYS PRIOR TO START OF THE TESTS. THE TESTS SHALL INCLUDE, BUT MAY NOT BE LIMITED TO, A TEST OF THE INLET LANDFILL GAS/NATURAL GAS BLEND AND THE GAS TURBINE EXHAUST FOR:
 - A. METHANE AND TOTAL NON-METHANE HYDROCARBONS
 - B. CARBON MONOXIDE (EXHAUST ONLY)
 - C. OXIDES OF NITROGEN (EXHAUST ONLY)
 - D. CARBON DIOXIDE
 - E. TOTAL PARTICULATES (EXHAUST ONLY)
 - F. C1 THROUGH C3 SULFUR COMPOUNDS (SPECIATED, INLET ONLY)
 - G. FORMALDEHYDE (EXHAUST ONLY)

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

- H. TOXIC AIR CONTAMINANTS (INLET AND EXHAUST) INCLUDING, BUT NOT LIMITED TO, BENZENE, CHLOROBENZENE, 1,2-DICHLOROETHANE, 1,1-DICHLOROETHENE, DICHLOROMETHANE, TETRACHLOROETHYLENE, TETRACHLOROMETHANE, TOLUENE, 1,1,1-TRICHLOROETHANE, TRICHLOROETHYLENE, TRICHLOROMETHANE, VINYL CHLORIDE, AND XYLENE ISOMERS.
- I. OXYGEN AND NITROGEN
- J. MOISTURE CONTENT
- K. TEMPERATURE
- L. FLOW RATE
- M. VOLATILE ORGANIC COMPOUNDS (VOCS) CONTROL EFFICIENCY, WT% (BASED ON INLET AND EXHAUST VOCS)

THE REPORT SHALL PRESENT THE EMISSIONS DATA IN UNITS OF POUNDS PER HOUR (LB/HR), POUNDS PER MILLION BTU (LB/MMBTU), AND PARTS PER MILLION (PPMV) ON A DRY BASIS AT 15% O₂ (CO, NO_x, AND TNMOC). THE REPORT SHALL ALSO PROVIDE GAS TURBINE'S DEMONSTRATED EFFICIENCY AT FULL LOAD, IN BTU/KW-HR, CORRECTED TO THE HIGHER HEATING VALUE (HHV) OF THE FUEL.

[RULE 1150.1, 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 40 CFR 63 SUBPART AAAA, 3004(a)(4)]

26. EMISSIONS FROM THE GAS TURBINE SHALL NOT EXCEED THE FOLLOWING:

CONTAMINANT	LBS/DAY
NO _x (AS NO ₂)	127
PM ₁₀	21
TNMOC (AS CH ₄)	12.7
SOX (AS SO ₂)	79

[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]

27. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF OXIDES OF NITROGEN SHALL NOT EXCEED 25 PPMV, CALCULATED AT 15% O₂, DRY BASIS, AND NO LATER THAN TWO YEARS FROM COMMENCING OPERATION, SHALL NOT EXCEED 18.75 PPMV, AT 15% O₂.
[RULE 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]
28. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF CARBON MONOXIDE SHALL NOT EXCEED 130 PPMV, CALCULATED AT 15% O₂, DRY BASIS.
[RULE 1303(a)(1)-BACT]
29. THE GAS TURBINE'S CO AND NO_x EMISSIONS, BASED ON MEASURED AND MONITORED RESULTS, DURING A TWO-YEAR TEST PROGRAM, SHALL BE USED TO ESTABLISH LOWER CO AND NO_x LIMITS OF THE PERMIT TO OPERATE.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

30. THE OWNER OR OPERATOR SHALL CALCULATE THE MAXIMUM INDIVIDUAL CANCER RISK (MICR), ACUTE HAZARD INDEX (HIA) AND CHRONIC HAZARD INDEX (HIC), BASED ON THE SOURCE TESTS RESULTS, USING AQMD PUBLISHED "RISK ASSESSMENT PROCEDURES FOR RULES 1401 AND 212" (VERSION 7.0), TO DETERMINE THE COMPLIANCE WITH RULE 1401. RESULTS SHALL BE SUBMITTED TO AQMD WITHIN 90 DAYS AFTER THE INITIAL TESTING IS COMPLETED.
[RULE 1401]
31. ALL RECORDS SHALL BE KEPT FOR A PERIOD OF AT LEAST FIVE YEARS AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 204, 3004(a)(4)]

Emissions Requirements:

32. THIS EQUIPMENT IS SUBJECT TO THE FOLLOWING APPLICABLE EMISSION LIMITS
- CO: 2000 PPMV, DRY, 15 MIN. AVG., RULE 407
CO: 130 PPMV, @ 15% O₂, RULE 1303 BACT
NO_x: 25 PPMV, @ 15% O₂, RULE 1303 BACT
PM: 0.1 GRAINS/DSCF, AT 12% CO₂, RULE 409
TNMOC: 20 PPMV, AS HEXANE, @ 3% O₂, OR 98% (BY WT) DESTRUCTION EFFICIENCY, RULE 1150.1, 40 CFR 63 SUBPART AAAA
SOX: 0.2%, RULE 53
SOX: 0.015%V @ 15% O₂, DRY BASIS OR 0.8%W (8000 PPMW) H₂S IN FUEL, NSPS, 40CFR60, SUBPART GG

Periodic Monitoring:

33. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE NO_x EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 7.1. THE TEST SHALL BE CONDUCTED WHEN THE EQUIPMENT IS OPERATING UNDER NORMAL CONDITIONS TO DEMONSTRATE COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT. FOR THE PURPOSE OF DETERMINING COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT, THE EMISSIONS SHALL BE MEASURED AND AVERAGED OVER A 60 MINUTE TIME PERIOD.
[RULE 3004(a)(4)]
34. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE CO EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 10.1. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT.
[RULE 3004(a)(4)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

PERMIT TO CONSTRUCT

Granted as of 11/27/2007
A/N 458590

Equipment Description:

LANDFILL GAS CONTROL AND GAS-TO-ENERGY SYSTEM, NO. 3, CONSISTING OF:

1. LANDFILL GAS (LFG) TREATMENT SYSTEM, SKID MOUNTED, 2500 SCFM @ 33% METHANE OR 51.6 MMBTU/HR CAPACITY, CONSISTING OF:
 - A. MOISTURE SEPARATOR.
 - B. COMPRESSOR, APPROXIMATE 700 HP.
 - C. HEAT EXCHANGER(S) AND GAS CHILLER.
 - D. TWO SORBENT BEDS, IN SERIES, EACH CONTAINING SILICA GEL OR EQUIVALENT MEDIA.
 - E. COALESCING FILTER FOR PARTICULATE MATTER REMOVAL, 0.3 MICRONS.
2. GAS TURBINE, SOLAR, MERCURY 50, LANDFILL GAS (LFG) AND NATURAL GAS AUGMENTATION, MAXIMUM 51.6 MILLION BTU PER HOUR INPUT RATING, SIMPLE CYCLE, WITH ELECTRIC START MOTOR, TEN-STAGE AXIAL FLOW COMPRESSOR, ULTRA LEAN PREMIX (ULP) ANNULAR COMBUSTOR, A RECUPERATOR, AUTOMATIC PILOT AND FUEL CONTROL SYSTEM, PROGRAMMABLE CONTROLLER, AND DRIVING A 4.6 MEGAWATT (MW) ELECTRIC GENERATOR.
3. EXHAUST STACK, 4' DIA. X 25' HIGH.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. THE OWNER OR OPERATOR OF THIS EQUIPMENT SHALL PROVIDE TO SCAQMD THE LANDFILL GAS TREATMENT SYSTEM AND GAS TURBINE FINAL DESIGN DRAWINGS, P & I DIAGRAMS, CONTROL DIAGRAMS, EQUIPMENT SPECIFICATIONS (MAKE, MODEL, DIMENSIONS, SIZE AND MAXIMUM CAPACITY) AT LEAST 30 DAYS PRIOR TO INSTALLATION OF THE EQUIPMENT.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

5. THIS EQUIPMENT SHALL ONLY BE FIRED WITH LANDFILL GAS OR A BLEND OF LANDFILL GAS AND NATURAL GAS FUEL. FOR THIS FUEL BLEND, THE HEAT INPUT FROM NATURAL GAS SHALL NOT EXCEED 25% OF THE TOTAL HEAT INPUT TO THE TURBINE ON AN ANNUAL BASIS. NATURAL GAS SHALL ONLY BE USED FOR START-UP AND FOR ADEQUATE PERFORMANCE OF THE TURBINE AS A LANDFILL GAS CONTROL DEVICE IN CASE THE QUALITY OF THE LANDFILL GAS IS NOT SUFFICIENT IN MEETING THE MANUFACTURER'S MINIMUM SPECIFICATIONS.
[RULE 204, 1303(b)(2) OFFSET]
6. FLOW INDICATING AND RECORDING DEVICES SHALL BE INSTALLED AND MAINTAINED IN THE LANDFILL GAS AND NATURAL GAS SUPPLY LINE TO THE GAS TURBINE TO MEASURE AND RECORD THE QUANTITY OF LANDFILL GAS AND NATURAL GAS (IN SCFM) SUPPLIED.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
7. WEEKLY READINGS OF THE BTU CONTENT OF LANDFILL GAS AT THE INLET TO THE GAS TURBINE SHALL BE TAKEN USING AN INSTRUMENT APPROVED BY THE SCAQMD. ALL RESULTS SHALL BE RECORDED.
[RULE 1303(b)(2)-OFFSET, 3004(a)(4)]
8. THE TOTAL COMBINED VOLUME AND HEAT INPUT OF LANDFILL GAS BURNED IN THE GAS TURBINES AND FLARES SHALL NOT EXCEED 8700 SCFM AND 178.2 MMBTU PER HOUR RESPECTIVELY. RECORDS OF LFG FLOW RATE, BTU CONTENT, AND TOTAL HEAT INPUT SHALL BE KEPT AND MAINTAINED ON FILE.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 1309.1, 3004(a)(4)]
9. THE TOTAL HEAT INPUT OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE SHALL NOT EXCEED 51.6 MMBTU PER HOUR. A LOG SHALL BE KEPT INDICATING THE TOTAL HEATING VALUE OF LANDFILL GAS AND NATURAL GAS FUEL BLEND BURNED IN THE GAS TURBINE BASED ON THE RECORDED FLOW RATE (SCFM) FOR EACH FUEL AND THE LATEST WEEKLY BTU CONTENT READING.
[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
10. A CONTINUOUS COMBUSTION CHAMBER TEMPERATURE MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED PURSUANT TO THE OPERATION AND MAINTENANCE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.7. SUCH A SYSTEM SHALL HAVE AN ACCURACY OF WITHIN $\pm 1\%$ OF THE TEMPERATURE BEING MONITORED AND SHALL BE INSPECTED, MAINTAINED, AND CALIBRATED ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS USING AN APPLICABLE SCAQMD OR EPA APPROVED METHOD.
[40 CFR 64]
11. FOR THE PURPOSE OF THIS CONDITION, A DEVIATION SHALL BE DEFINED AS WHEN THE COMBUSTION CHAMBER TEMPERATURE LESS THAN 1100 DEGREES FAHRENHEIT OR GREATER 1300 DEGREES FAHRENHEIT OCCURS AVERAGED OVER ONE HOUR DURING OPERATION EXCEPT DURING START UP AND SHUTDOWN EVENTS LASTING FOR A MAXIMUM OF ONE HOUR. MULTIPLE START UP AND SHUTDOWN EVENTS CAN OCCUR CONSECUTIVELY.
[40 CFR 64]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

12. THE COMBUSTION CHAMBER TEMPERATURE SHALL BE RECORDED AT LEAST EVERY 15 MINUTES, AND THE HOURLY AVERAGE SHALL BE COMPUTED FROM SUCH DATA POINTS. THE OPERATOR SHALL REVIEW THE RECORDS OF TEMPERATURE ON A DAILY BASIS TO DETERMINE IF A DEVIATION OCCURRED OR SHALL INSTALL AN ALARM SYSTEM TO ALERT THE OPERATOR WHEN A DEVIATION OCCURS.
[40 CFR 64]
13. ALL DEVIATIONS SHALL BE REPORTED TO THE SCAQMD ON A SEMI-ANNUAL BASIS PURSUANT TO THE REQUIREMENTS SPECIFIED IN 40 CFR PART 64.9 AND CONDITION NOS. 22 AND 23 IN SECTION K OF THIS PERMIT.
[40 CFR 64]
14. FOR EACH SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K, WHENEVER A DEVIATION OCCURS FROM THE TEMPERATURE, THE OPERATOR SHALL TAKE IMMEDIATE CORRECTIVE ACTION, AND KEEP RECORDS OF THE DURATION AND CAUSE (INCLUDING UNKNOWN CAUSE, IF APPLICABLE) OF THE DEVIATION AND THE CORRECTIVE ACTION TAKEN.
[40 CFR 64]
15. A SEMI-ANNUAL MONITORING REPORT SHALL BE SUBMITTED TO SCAQMD, WHICH SHALL INCLUDE BUT MAY NOT BE LIMITED TO THE TOTAL OPERATING TIME OF THIS EQUIPMENT AND THE TOTAL ACCUMULATED DURATION OF ALL DEVIATIONS FOR EACH SEMI-ANNUAL REPORTING PERIOD.
[40 CFR 64]
16. THE OWNER OR OPERATOR SHALL SUBMIT AN APPLICATION WITH A QUALITY IMPROVEMENT PLAN (QIP) IN ACCORDANCE WITH 40 CFR PART 64.8 TO THE SCAQMD IF AN ACCUMULATION OF DEVIATIONS EXCEEDS 5% DURATION OF THIS EQUIPMENT'S TOTAL OPERATING TIME FOR ANY SEMI-ANNUAL REPORTING PERIOD SPECIFIED IN CONDITION NO. 23 IN SECTION K OF THIS PERMIT. THE REQUIRED QIP SHALL BE SUBMITTED TO THE SCAQMD WITHIN 90 CALENDAR DAYS AFTER THE DUE DATE OF THE SEMI-ANNUAL MONITORING REPORT.
[40 CFR 64]
17. THE OPERATOR SHALL INSPECT AND MAINTAIN ALL COMPONENTS OF THIS EQUIPMENT ON AN ANNUAL BASIS IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
[RULE 3004(a)(4)]
18. THE OPERATOR SHALL KEEP ALL RECORDS FOR A PERIOD OF AT LEAST FIVE (5) YEARS IN A FORMAT ACCEPTABLE TO THE SCAQMD AND IN COMPLIANCE WITH 40 CFR PART 64.9 AND SHALL BE MADE AVAILABLE TO SCAQMD PERSONNEL UPON REQUEST.
[RULE 1150.1, 40CFR PART 64]
19. ALL RECORDING DEVICES SHALL BE SYNCHRONIZED WITH RESPECT TO THE TIME OF THE DAY.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

20. LANDFILL GAS NOT UTILIZED BY THIS EQUIPMENT SHALL BE DIRECTED TO COMBUSTION OR PROCESSING FACILITY WHICH IS IN FULL USE, CAN ADEQUATELY PROCESS THE VOLUME OF GAS COLLECTED AND HAS BEEN ISSUED A VALID PERMIT BY THE SCAQMD.
[RULE 1303(a)(1)-BACT]
21. OPERATION OF THIS EQUIPMENT SHALL NOT RESULT IN THE RELEASE OF RAW LANDFILL GAS INTO THE ATMOSPHERE. ANY BREAKDOWN OR MALFUNCTION WHICH RESULTS IN EMISSIONS OF LANDFILL GAS SHALL BE REPORTED TO THE SCAQMD WITHIN ONE HOUR AFTER OCCURRENCE, OR WITHIN ONE HOURS OF THE TIME THE OPERATING PERSONNEL KNEW OR REASONABLY SHOULD HAVE KNOWN OF THE OCCURRENCE, AND IMMEDIATE REMEDIAL MEASURES SHALL BE UNDERTAKEN TO CORRECT THE PROBLEM AND PREVENT FURTHER EMISSIONS INTO THE ATMOSPHERE.
[RULE 402, 430, 1150.1]
22. THIS EQUIPMENT SHALL BE OPERATED IN COMPLIANCE WITH SCAQMD RULE 431.1.
[RULE 431.1]
23. ADEQUATE NUMBER OF SAMPLING PORTS AND WELDED NIPPLES WITH CAPS, WITH ITS SAFE ACCESS SHALL BE INSTALLED AND MAINTAINED IN THE EXHAUST STACK IN ACCORDANCE WITH RULE 217 AND SCAQMD'S APPROVAL.
[RULE 217]
24. A CONTINUOUS EMISSION MONITORING SYSTEM (CEMS), APPROVED BY THE EXECUTIVE OFFICER, SHALL BE INSTALLED, OPERATED AND MAINTAINED TO MEASURE THE EXHAUST CONCENTRATION FOR NO_x AND O₂, ON A DRY BASIS. IN ADDITION, THE SYSTEM SHALL CONVERT THE ACTUAL NO_x CONCENTRATION TO A CORRECTED NO_x CONCENTRATION AT 15% O₂ AND CONTINUOUS RECORD THE STACK NO_x CONCENTRATION AT 15% O₂. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF SCAQMD RULE 218. PRIOR TO INSTALLATION, THIS MONITORING SYSTEM SHALL BE APPROVED IN WRITING BY THE EXECUTIVE OFFICER.
[RULE 218, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 3004(a)(4)]
25. WITHIN 180 DAYS AFTER INITIAL START-UP AND ANNUALLY (WITHIN 45 DAYS OF ANNIVERSARY OF INITIAL TEST), THEREAFTER, THE OPERATOR SHALL CONDUCT PERFORMANCE TESTS IN ACCORDANCE WITH THE APPROVED TEST PROCEDURES. WRITTEN RESULTS OF SUCH PERFORMANCE TESTS SHALL BE SUBMITTED WITHIN 60 DAYS AFTER TESTING. NOTICE SHALL BE PROVIDED TO THE SCAQMD 10 DAYS PRIOR TO THE TESTING SO THAT AN OBSERVER MAY BE PRESENT. ALL SOURCE TESTING AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE AQMD FOR APPROVAL AT LEAST 30 DAYS PRIOR TO START OF THE TESTS. THE TESTS SHALL INCLUDE, BUT MAY NOT BE LIMITED TO, A TEST OF THE INLET LANDFILL GAS/NATURAL GAS BLEND AND THE GAS TURBINE EXHAUST FOR:
 - A. METHANE AND TOTAL NON-METHANE HYDROCARBONS
 - B. CARBON MONOXIDE (EXHAUST ONLY)
 - C. OXIDES OF NITROGEN (EXHAUST ONLY)
 - D. CARBON DIOXIDE
 - E. TOTAL PARTICULATES (EXHAUST ONLY)
 - F. C1 THROUGH C3 SULFUR COMPOUNDS (SPECIATED, INLET ONLY)
 - G. FORMALDEHYDE (EXHAUST ONLY)

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

- H. TOXIC AIR CONTAMINANTS (INLET AND EXHAUST) INCLUDING, BUT NOT LIMITED TO, BENZENE, CHLOROBENZENE, 1,2-DICHLOROETHANE, 1,1-DICHLOROETHENE, DICHLOROMETHANE, TETRACHLOROETHYLENE, TETRACHLOROMETHANE, TOLUENE, 1,1,1-TRICHLOROETHANE, TRICHLOROETHYLENE, TRICHLOROMETHANE, VINYL CHLORIDE, AND XYLENE ISOMERS.
- I. OXYGEN AND NITROGEN
- J. MOISTURE CONTENT
- K. TEMPERATURE
- L. FLOW RATE
- M. VOLATILE ORGANIC COMPOUNDS (VOCS) CONTROL EFFICIENCY, WT% (BASED ON INLET AND EXHAUST VOCS)

THE REPORT SHALL PRESENT THE EMISSIONS DATA IN UNITS OF POUNDS PER HOUR (LB/HR), POUNDS PER MILLION BTU (LB/MMBTU), AND PARTS PER MILLION (PPMV) ON A DRY BASIS AT 15% O₂ (CO, NO_x, AND TNMOC). THE REPORT SHALL ALSO PROVIDE GAS TURBINE'S DEMONSTRATED EFFICIENCY AT FULL LOAD, IN BTU/KW-HR, CORRECTED TO THE HIGHER HEATING VALUE (HHV) OF THE FUEL.

[RULE 1150.1, 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET, 40 CFR 63 SUBPART AAAA, 3004(a)(4)]

26. EMISSIONS FROM THE GAS TURBINE SHALL NOT EXCEED THE FOLLOWING:

CONTAMINANT	LBS/DAY
NO _x (AS NO ₂)	127
PM ₁₀	21
TNMOC (AS CH ₄)	12.7
SOX (AS SO ₂)	79

[RULE 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]

27. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF OXIDES OF NITROGEN SHALL NOT EXCEED 25 PPMV, CALCULATED AT 15% O₂, DRY BASIS, AND NO LATER THAN TWO YEARS FROM COMMENCING OPERATION, SHALL NOT EXCEED 18.75 PPMV, AT 15% O₂.
[RULE 1303(a)(1)-BACT, 1303(b)(1)-MODELING, 1303(b)(2)-OFFSET]
28. EXCEPT DURING PERIODS OF STARTUP AND SHUTDOWN NOT TO EXCEED 30 MINUTES PER INCIDENT, EMISSIONS OF CARBON MONOXIDE SHALL NOT EXCEED 130 PPMV, CALCULATED AT 15% O₂, DRY BASIS.
[RULE 1303(a)(1)-BACT]
29. THE GAS TURBINE'S CO AND NO_x EMISSIONS, BASED ON MEASURED AND MONITORED RESULTS, DURING A TWO-YEAR TEST PROGRAM, SHALL BE USED TO ESTABLISH LOWER CO AND NO_x LIMITS OF THE PERMIT TO OPERATE.
[RULE 204]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

30. THE OWNER OR OPERATOR SHALL CALCULATE THE MAXIMUM INDIVIDUAL CANCER RISK (MICR), ACUTE HAZARD INDEX (HIA) AND CHRONIC HAZARD INDEX (HIC), BASED ON THE SOURCE TESTS RESULTS, USING AQMD PUBLISHED "RISK ASSESSMENT PROCEDURES FOR RULES 1401 AND 212" (VERSION 7.0), TO DETERMINE THE COMPLIANCE WITH RULE 1401. RESULTS SHALL BE SUBMITTED TO AQMD WITHIN 90 DAYS AFTER THE INITIAL TESTING IS COMPLETED.
[RULE 1401]
31. ALL RECORDS SHALL BE KEPT FOR A PERIOD OF AT LEAST FIVE YEARS AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 204, 3004(a)(4)]

Emissions Requirements:

32. THIS EQUIPMENT IS SUBJECT TO THE FOLLOWING APPLICABLE EMISSION LIMITS
- CO: 2000 PPMV, DRY, 15 MIN. AVG., RULE 407
 - CO: 130 PPMV, @ 15% O₂, RULE 1303 BACT
 - NO_x: 25 PPMV, @ 15% O₂, RULE 1303 BACT
 - PM: 0.1 GRAINS/DSCF, AT 12% CO₂, RULE 409
 - TNMOC: 20 PPMV, AS HEXANE, @ 3% O₂, OR 98% (BY WT) DESTRUCTION EFFICIENCY, RULE 1150.1, 40 CFR 63 SUBPART AAAA
 - SOX: 0.2%, RULE 53
 - SOX: 0.015%V @ 15% O₂, DRY BASIS OR 0.8%W (8000 PPMW) H₂S IN FUEL, NSPS, 40CFR60, SUBPART GG

Periodic Monitoring:

33. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE NO_x EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 7.1. THE TEST SHALL BE CONDUCTED WHEN THE EQUIPMENT IS OPERATING UNDER NORMAL CONDITIONS TO DEMONSTRATE COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT. FOR THE PURPOSE OF DETERMINING COMPLIANCE WITH RULE 1303 CONCENTRATION LIMIT, THE EMISSIONS SHALL BE MEASURED AND AVERAGED OVER A 60 MINUTE TIME PERIOD.
[RULE 3004(a)(4)]
34. THE OPERATOR SHALL DETERMINE COMPLIANCE WITH THE CO EMISSION LIMIT(S) BY CONDUCTING A SOURCE TEST AT LEAST ONCE EVERY FIVE YEARS USING AQMD METHOD 100.1 OR 10.1. THE OPERATOR SHALL COMPLY WITH ALL GENERAL TESTING, REPORTING, AND RECORDKEEPING REQUIREMENTS IN SECTIONS E AND K OF THIS PERMIT.
[RULE 3004(a)(4)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION I: PLANS AND SCHEDULES

This section lists all plans approved by AQMD for the purposes of meeting the requirements of applicable AQMD rules specified below. The operator shall comply with all conditions specified in the approval of these plans.

Documents pertaining to the plan applications listed below are available for public review at AQMD Headquarters. Any changes to plan applications will require permit modification in accordance with Title V permit revision procedures.

List of approved plans:

Application	Rule
337645	431.1
423770	1150.1
526755	3003

NOTE: This section does not list compliance schedules pursuant to the requirements of Regulation XXX - Title V Permits; Rule 3004(a)(10)(C). For equipment subject to a variance, order for abatement, or alternative operating condition granted pursuant to Rule 518.2, equipment specific conditions are added to the equipment in Section D or H of the permit.



South Coast Air Quality Management District

21865 E. Copley Drive, Diamond Bar, CA 91765-4182
(909) 396-2000 • www.aqmd.gov

April 2, 2003

Frank R. Caponi
County Sanitation Districts of Los Angeles County
1955 Workman Mill Road
Whittier, California 90607-4998

RE: Rule 431.1 Alternative Monitoring Plan for the Calabasas Landfill
Facility ID: 42514 Application No. 337645

Dear Mr. Caponi;

On February 26, 1998, the County Sanitation Districts of Los Angeles County (LACSD) submitted an Alternative Monitoring Plan (AMP) to demonstrate compliance with South Coast Air Quality Management District (AQMD) Rule 431.1 at the Calabasas Landfill. An updated data package was also submitted on November 7, 2001. The AMP has been approved by AQMD, CARB and EPA provided that the following conditions are met:

- 1) The colorimetric tubes (TUBES) for analyzing H₂S as TS shall be used in accordance with manufacturer's instructions. Testing with TUBES shall be conducted by personnel properly trained in its operation. The TUBES shall be used within their shelf life.
- 2) Based on the concentration of Total Sulfur (TS) in the landfill gas (as measured by a TUBE), tiered sampling and reporting requirements as outlined in the following table shall be implemented.

ACTION LEVEL	LACSD PROPOSED MONITORING	AQMD MODIFIED TIERS	SAMPLING REQUIREMENT
Tier I	TS < 100 ppm	TS < 100 ppm	- Quarterly using Method 307-91 - Monthly using TUBE
Tier II	100 ppm ≤ TS < 135 ppm	100 ppm ≤ TS < 120 ppm	- Monthly using Method 307-91 - Weekly using TUBE
Tier III	TS ≥ 135 ppm	TS ≥ 120 ppm	- Weekly using Method 307-91 - Daily using TUBE
Tier IV	TS ≥ 150 ppm	TS ≥ 150 ppm	- Potential RULE 431.1 Violation - Inform AQMD immediately following R430 Breakdown Provisions - Daily using Method 307-91

...making the air that we breathe...

Since this AMP is approved, fuel gas determination and reporting for sulfur content, as described in Rule 431.1(g)(10) and outlined in your approved Rule 1150.1 Compliance Plan, no longer serves as a surrogate method of compliance with Rule 431.1.

If you have any further questions, please contact me at (909) 396-2684.

Sincerely,



Charles Tupac
Air Quality Analysis and Compliance Supervisor
Toxics and Waste Management Team

CT:sc

cc: David Jones, Compliance
File



South Coast Air Quality Management District

21865 E. Copley Drive, Diamond Bar, CA 91765-4182
(909) 396-2000 • <http://www.aqmd.gov>

June 9, 2000

LA CO, SANITATION DISTRICTS
P O BOX 4998
WHITTIER, CA 90607-4998

Attention: FRANK CAPONI

RULE 1150.1 COMPLIANCE PLAN

Reference is made to your Application for a Rule 1150.1 Compliance Plan for the following landfill.

Facility ID:	42514	Sector:	PA
Application No:	343045	Phone No:	(562) 699-7411
Common Name:	Calabasas		
Location Address:	5200-300 LOST HILLS RD		
City:	AGOURA	, CA	91301-2340

South Coast Air Quality Management District (AQMD) has reviewed your application and approved the following alternatives to Rule 1150.1 requirements for your landfill. Rule 1150.1 Compliance Plans may be submitted by each owner or operator responsible for that section of the rule directly under their control, or by the owner or operator responsible for the entire landfill. Compliance under the alternative provision is achieved if only one owner or operator with responsibility submits a compliance plan for the applicable section of the rule. Only one alternative to each rule requirement shall be allowed for multiple Compliance Plans issued to one landfill. The approved alternative shall be written into each Compliance Plan. The AQMD reserves the right to deny any or all of these alternatives if it is determined that the alternative(s) allow emissions from the landfill that would not have occurred if the owner or operator was complying with the rule requirements.

Where no Rule 1150.1 alternatives are specified below, compliance with provisions of Rule 1150.1 is required. You are further advised that other governmental agencies may require approval for the operation of this landfill and it is the responsibility of the

applicant to obtain approval from each agency. This compliance plan will remain in force until either a new plan is filed and approved or the applicant is notified by the Executive Officer of revisions to this plan. The AQMD shall not be responsible or liable for any losses resulting from measures required or taken pursuant to the requirements of this approved Rule 1150.1 Compliance Plan.

If you have any questions regarding this matter, please phone Linda Dejbakhsh, Air Quality Engineer at (909) 396-2614.

Sincerely,



Larry M. Bowen
Senior Manager

cc: Gale Jones
Air Quality Inspector

Issue Number: 1

(Adopted April 5, 1985)(Amended April 10, 1998)
(Amended March 17, 2000)

**RULE 1150.1. CONTROL OF GASEOUS EMISSIONS FROM
MUNICIPAL SOLID WASTE LANDFILLS**

TABLE OF CONTENTS

(a)	Purpose
(b)	Applicability
(c)	Definitions
(d)	Active Landfill Design and Operation Requirements
(e)	Active Landfill Sampling and Monitoring Requirements
(f)	Active Landfill Recordkeeping and Reporting Requirements
(g)	Active Landfill Compliance Schedule
(h)	Inactive Landfill Requirements
(i)	Alternatives
(j)	Test Methods
(k)	Exemptions
(l)	Loss of Exemption
	Attachment A
1.0	Subsurface Refuse Boundary Sampling Probes
2.0	Integrated Landfill Surface Sampling
3.0	Instantaneous Landfill Surface Monitoring
4.0	Landfill Gas Sample From Gas Collection System
5.0	Ambient Air Samples At The Landfill Property Boundary
Figure 1	Portable Integrated Bag Sampler
Figure 2	Typical Landfill Walk Pattern
Figure 3	Quality Control Sheet
Figure 4	Bag Sample Custody Form
Table 1	Carcinogenic and Toxic Air Contaminants (Core Group)
Table 2	Carcinogenic and Toxic Air Contaminants (Supplemental Group)
	Attachment B
	Attachment C

**The reference numbers in the left hand margin of the rule refer to sections of
40 CFR, Part 60, Subpart WWW (NSPS)**

**RULE 1150.1. CONTROL OF GASEOUS EMISSIONS FROM MUNICIPAL
SOLID WASTE LANDFILLS**

(a) Purpose

The rule is intended to limit Municipal Solid Waste (MSW) landfill emissions to prevent public nuisance and possible detriment to public health caused by exposure to such emissions.

(b) Applicability

This rule applies to each active and inactive MSW landfill.

(c) Definitions

Terms used but not defined in this rule have the meaning given them in 40 CFR, Part 60, Section 60.751 (Definitions):

- (1) ADMINISTRATOR means the Executive Officer of the South Coast Air Quality Management District (District).
- (2) ACTIVE LANDFILL means an MSW landfill that has received waste on or after November 8, 1987.
- (3) BACKGROUND means the local ambient concentration of total organic compounds (TOC) measured as methane determined by holding the instrument probe approximately 5 to 6 feet above the landfill surface.
- (4) CLOSED LANDFILL means a disposal facility that has ceased accepting waste and was closed in accordance with all applicable federal, state and local statutes, regulations, and ordinances in effect at the time of closure.
- (5) INACTIVE LANDFILL means an MSW landfill where solid waste had been disposed of before November 8, 1987 and no more subsequent solid waste disposal activity has been conducted within the disposal facility.
- (6) MSW LANDFILL means an entire disposal facility in a contiguous geographical space where solid waste is placed in or on land. An MSW landfill may be either active or inactive.
- (7) OPERATOR means the person:
 - (A) Operating the MSW landfill, or
 - (B) Operating the MSW landfill gas collection or control system.
- (8) OWNER means the person holding Title to the property.

- (9) PERIMETER means the outer boundary of the entire waste disposal property.
- (10) PROFESSIONAL ENGINEER means an engineer holding a valid certificate issued by the State of California Board of Registration for Professional Engineers and Land Surveyors or a state offering reciprocity with California.
- (11) TOXIC AIR CONTAMINANT (TAC) means an air contaminant which has been identified as a hazardous air pollutant pursuant to Section 7412 of Title 42 of the United States Code; or has been identified as a TAC by the Air Resources Board pursuant to Health and Safety Code Section 39655 through 39662, or which may cause or contribute to an increase in mortality or an increase in serious illness, or potential hazard to human health.

(d) Active Landfill Design and Operation Requirements

The MSW landfill owner or operator shall comply with the provisions of paragraphs (d)(1) through (d)(11):

- (1) If a valid Permit to Construct or Permit to Operate for the collection and control system that meets the requirements of subparagraphs (d)(1)(A) through (d)(1)(C) has not been issued by the District by the adoption date of this rule, submit a site-specific collection and control system design plan. The design plan shall be prepared by a Professional Engineer and sent to the Executive Officer with applications for Permits to Construct or Permits to Operate no later than one year after the adoption of this rule. The Executive Officer shall review the collection and control system design and either approve it, disapprove it, or request that additional information be submitted.

752(b)(2)(i)
752(b)(2)(i)(D)

- (A) The collection and control system shall be designed to handle the maximum expected gas flow rate from the entire area of the landfill that requires control, to minimize migration of subsurface gas to comply with paragraph (d)(4), and to collect gas at an extraction rate to comply with paragraphs (d)(5) and (d)(6). For the purposes of calculating the maximum expected gas generation flow rate from the landfill, one of the equations in 40 CFR, Part 60, Section 60.755(a)(1) shall be used. Another method may be used

752(b)(2)(ii)(A)(1), (3), (4)
755(a)(1)
758(b)(1)(i)

to determine the maximum gas generation flow rate, if the method has been approved by the Executive Officer.

- (B) If a valid Permit to Construct or Permit to Operate has not been issued by the District for the collection and control system, the collection and control system design plan shall either conform with specifications for active collection systems in 40 CFR, Part 60, Section 60.759 or include a demonstration to the Executive Officer's satisfaction of the sufficiency of the alternative provisions describing the design and operation of the collection system, the operating parameters that would indicate proper performance, and appropriate monitoring procedures. Alternatives to this rule shall be submitted as specified in subdivision (i).

752(b)(2)(i)(C)
756(e)

- (C) The design plan shall provide for the control of collected MSW landfill emissions through the use of a collection and control system meeting the applicable requirements in clauses (d)(1)(C)(i) and (d)(1)(C)(ii):

752(b)(2)(iii)

- (i) Route all the collected gas to a control system designed and operated to either reduce NMOC by at least 98 percent by weight or reduce the outlet NMOC concentration to less than 20 parts per million by volume (ppmv), dry basis as hexane at 3 percent oxygen. The required reduction efficiency or ppmv shall be established by an initial source test, required under 40 CFR, Part 60, Section 60.8 and annually thereafter using the test methods specified in paragraph (j)(1). The annual source test shall be conducted no later than 45 days after the anniversary date of the initial source test.

ALTERNATIVE: THE FOLLOWING FREQUENCY SHALL BE USED FOR SOURCE TESTING IDENTICAL FLARES LISTED ON ONE PERMIT TO OPERATE AND FOR SOURCE TESTING IDENTICAL BOILERS WHERE IDENTICAL MEANS, BUT IS NOT LIMITED TO: MAKE AND MODEL, BURNERS, OPERATIONAL SETTINGS, MAINTENANCE AND FUELS.

SINGLE BACKUP FLARE- AFTER EVERY 4000 HOURS OF OPERATION.

MULTIPLE BACKUP FLARES - ONE FLARE AFTER EVERY 4000 HOURS OF CUMULATIVE BACKUP OPERATION FOR ALL FLARES LISTED ON THE PERMIT TO OPERATE. ALTERNATE TESTING OF THE FLARES SUCH THAT EACH FLARE IS TESTED.

NON-BACKUP FLARES AND BOILERS: AT LEAST ONE FLARE AND BOILER EVERY YEAR AND THEN ALTERNATE ALL OTHERS SUCH THAT EACH IS SOURCE TESTED AT LEAST ONCE EVERY THREE YEARS.

(I) If a boiler or process heater is used as the control device, the landfill gas stream shall be introduced into the flame zone. Where the landfill gas is the primary fuel for the boiler or process heater, introduction of the landfill gas stream into the flame zone is not required.

(II) The control device shall be operated within the operating parameter ranges established during the initial or most recent compliant source test. The operating parameters to be monitored are specified under paragraph (e)(6).

(ii) Route the collected gas to a treatment system that processes the collected gas for subsequent sale or use. All emissions from any atmospheric vent from the gas treatment system shall be subject to the requirements of clause (d)(1)(C)(i).

(2) Install and operate the collection and control system no later than 18 months after the submittal of the design plan.

752(b)(2)(ii)

(3) If the District has not issued prior written approval for subsurface refuse boundary sampling probes, design and install subsurface refuse boundary sampling probes as specified in Section 1.1, Attachment A, to determine

whether landfill gas migration exists. Installation of the refuse boundary probes shall be no later than 18 months after the submittal of the collection and control design plan as specified in paragraph (d)(1).

ALTERNATIVE: THE SUBSURFACE REFUSE BOUNDARY PROBES APPROVED IN THE PAST OR SUBMITTED WITH THIS APPLICATION, ARE APPROVED. ALL FUTURE DESIGNS AND INSTALLATIONS NOT MEETING THE RULE REQUIREMENTS, SHALL BE SUBMITTED FOR AQMD PRE-CONSTRUCTION APPROVAL WITH A COMPLIANCE PLAN APPLICATION.

- (4) Operate the collection system to prevent the concentration of TOC measured as methane from exceeding five percent by volume in the subsurface refuse boundary sampling probes constructed for the purposes of detecting lateral migration of landfill gas away from the waste mass, as determined from collected samples.
- (5) Operate the collection system to prevent the concentration of TOC measured as methane from exceeding 50 ppmv as determined by integrated samples taken on numbered 50,000 square foot landfill grids.
- (6) Operate the collection system to prevent the concentration of TOC measured as methane from exceeding 500 ppmv above background as determined by instantaneous monitoring at any location on the landfill, except at the outlet of any control device.
- (7) Operate the control or treatment system at all times when the collected gas is routed to the system. In the event the collection, treatment or control system is inoperable, the gas conveying system shall be shut down and all valves in the collection, treatment and control system contributing to venting of the gas to the atmosphere shall be closed no later than one hour after such breakdown or no later than one hour after the time the owner or operator knew or reasonably should have known of its occurrence.
- (8) Operate the collection, treatment and control system until all the exemption criteria under subdivision (k) has been met and the reports specified in subparagraph (f)(2)(D) have been submitted to the Executive Officer.
- (9) Design, install and operate a wind speed and direction monitoring system with a continuous recorder of the requirements in subparagraphs (d)(9)(A) and (d)(9)(B), at a site which is representative of the wind speed and

direction in the areas being sampled. The wind velocity shall be recorded throughout the sampling period. The wind direction transmitter shall be oriented to true north using a compass. The monitor shall be installed according to the criteria set forth in 40 CFR, Part 50.

- (A) For wind speed use a 3 cup assembly, with a range of 0 to 50 miles per hour, with a threshold of 0.75 mile per hour or less.
- (B) For wind direction use a vane, with a range of 0 to 540 degrees azimuth, with a threshold of plus-minus 2 degrees.

ALTERNATIVE: NO PERMANENT METEOROLOGICAL STATION REQUIRED. THE WIND SPEED SHALL BE MEASURED WITH AN APPROVED HAND-HELD ANEMOMETER DURING INTEGRATED SURFACE MONITORING.

- (10) Comply with the requirements of Section 21140 – Final Cover, of California Code of Regulations Title 27, Subchapter 5 – Closure and Post-Closure Maintenance, upon closure of a MSW landfill unit, incorporated herein as Attachment B.
 - (11) Comply with the requirement of Section 20200 – State Water Resources Conservation Board (SWRCB) Applicability and Classification Criteria of California Code of Regulations Title 27, Article 2 – SWRCB, Waste Classification and Management, with respect to the disposal of liquids and semi-solid waste at Class III landfills, incorporated herein as Attachment C.
- (e) **Active Landfill Sampling and Monitoring Requirements**
The MSW landfill owner or operator shall comply with the provisions of paragraphs (e)(1) through (e)(6), after installation of the landfill gas control system:
- (1) Monitor and collect samples for analysis as specified in Section 1.0, Attachment A, to determine the concentrations of TOC and TAC each month from the subsurface refuse boundary sampling probes, to assure continued compliance. Any measurement of 5 percent TOC by volume or greater shall be recorded as an exceedance and the actions specified in subparagraphs (e)(1)(A) through (e)(1)(C) shall be taken.
- ALTERNATIVE: TOC MONTHLY/TAC QUARTERLY**

- (A) The probe shall be identified and the location recorded as specified in Section 1.6, Attachment A.
 - (B) Adjustments to the vacuum of adjacent wells to increase the gas collection in the vicinity of the probe with the exceedance shall be made and the probe resampled no later than 10 calendar days after detecting the exceedance.
 - (C) If the resampling of the probe shows a second exceedance, additional corrective action shall be taken and the probe shall be resampled again no later than 10 calendar days after the second exceedance. If the resampling shows a third exceedance, it is a violation unless the owner or operator determines that a new or replacement gas collection well is needed. The owner or operator must install and operate the new or replacement well no later than 45 days after detecting the third exceedance.
- (2) Collect monthly integrated samples for analysis as specified in Section 2.0, Attachment A, to determine the concentrations of TOC and TAC from the landfill surface, to assure continued compliance. Any reading of 50 ppmv or greater shall be recorded as an exceedance and the actions specified in subparagraphs (e)(2)(A) through (e)(2)(C) shall be taken.

ALTERNATIVE: QUARTERLY

- (A) The grid shall be identified and the location recorded as specified in Section 2.8, Attachment A.
- (B) Cover maintenance or adjustments to the vacuum of adjacent wells to increase the gas collection in the vicinity of the grid with the exceedance shall be made and the grid resampled no later than 10 calendar days after detecting the exceedance. If measurable precipitation occurs within the 10 calendar days, all resampling and analysis shall comply with Section 2.2.2, Attachment A.
- (C) If the resampling of the grid shows a second exceedance, additional corrective action shall be taken and the grid shall be resampled again no later than 10 calendar days after the second exceedance. If the resampling shows a third exceedance, it is a violation unless the owner or operator determines that a new or replacement gas collection well is needed. The owner or operator must install and operate the new or replacement well no later than 45 days after detecting the third exceedance.

(3) Monitor instantaneously as specified in Section 3.0, Attachment A, to determine the concentration of TOC each calendar quarter, to assure continued compliance. Any reading of 500 ppmv TOC or greater shall be recorded as an exceedance and the actions specified in subparagraphs (e)(3)(A) through (e)(3)(C) shall be taken. Any closed landfill that has no monitored exceedances of the 500 ppmv standard in three consecutive quarterly monitoring periods may monitor annually. Any reading of 500 ppmv TOC or more above background detected during the annual monitoring or compliance inspections shall result in a return to quarterly monitoring for that landfill.

755(c)
756(f)

- (A) The location of each monitored exceedance shall be marked on the landfill or identified by using a global positioning system and the location recorded as specified in Section 3.4, Attachment A.
- (B) Cover maintenance or adjustments to the vacuum of adjacent wells to increase the gas collection in the vicinity of each exceedance shall be made and the location shall be remonitored no later than 10 calendar days after detecting the exceedance.
- (C) If the remonitoring of the location shows a second exceedance, additional corrective action shall be taken and the location shall be remonitored again no later than 10 days after the second exceedance. If the remonitoring shows a third exceedance, it is a violation unless the owner or operator determines that a new or replacement gas collection well is needed. The owner or operator must install and operate the new or replacement well no later than 45 days after detecting the third exceedance.

(4) Collect a monthly landfill gas sample for analysis as specified in Section 4.0, Attachment A, to determine the concentrations of TOC and TAC from the main gas collection header line entering the gas treatment and/or gas control systems.

ALTERNATIVE: QUARTERLY

(5) Collect monthly ambient air samples for analysis as specified in Section 5.0, Attachment A, to determine the concentrations of TOC and TAC from the landfill property boundary.

ALTERNATIVE: QUARTERLY

- (6) Monitor the collection and control system equipment specified under subparagraphs (e)(6)(A) and (e)(6)(B) in order to comply with subparagraph (d)(1)(C).

756(b)

- (A) For an enclosed combustor install, calibrate, maintain, and operate according to the manufacturer's specifications, the following equipment:

(i) A temperature monitoring device equipped with a continuous recorder and having an accuracy of plus-minus 1 percent of the temperature being measured expressed in degrees Celsius or Fahrenheit. A temperature monitoring device is not required for boilers or process heaters with design heat input capacity greater than 44 megawatts.

(ii) At least one gas flow rate measuring device that shall record the flow to the control device(s) at least every 15 minutes.

- (B) For a device other than an enclosed combustor, demonstrate compliance with subparagraph (d)(1)(C) by providing information satisfactory to the Executive Officer describing the operation of the control device, the operating parameters that would indicate proper performance, and appropriate monitoring procedures. Alternatives to this rule shall be submitted as specified in subdivision (i). The Executive Officer may specify additional appropriate monitoring procedures.

756(d)

(f) Active Landfill Recordkeeping and Reporting Requirements

The MSW landfill owner or operator shall keep all records up-to-date, readily accessible and maintained for at least a period of 5 years and made available to District staff upon request. Records older than 2 years may be maintained off-site, if they are retrievable no later than 4 hours after request.

758(a)

- (1) The records required in subparagraphs (f)(1)(A) through (f)(1)(H) shall be maintained at the facility.

ALTERNATIVE: RECORDS SHALL BE MAINTAINED AT THE JOINT ADM. OFFICE AND MADE AVAILABLE WITHIN 4 HOURS AFTER REQUEST.

758(b)

- (A) For the life of the control equipment as measured during the initial source test or compliance determination:

- (i) The control device vendor specifications.
 - (ii) The maximum expected gas generation flow rate as calculated in subparagraph (d)(1)(A).
 - (iii) When seeking to demonstrate compliance with subparagraph (d)(1)(C) through the use of an enclosed combustion device other than a boiler or process heater with a design heat input capacity greater than 44 megawatts:
 - (I) The average combustion temperature measured at least every 15 minutes and averaged over the same time period of the source test.
**ALTERNATIVE: FOR FLARE(S),
CONTINUOUSLY RECORD THE
INSTANTANEOUS COMBUSTION
TEMPERATURE.**
 - (II) The reduction of NMOC determined as specified in clause (d)(1)(C)(i) achieved by the control device.
 - (iv) When seeking to demonstrate compliance with subclause (d)(1)(C)(i)(I) through the use of a boiler or process heater of any size: a description of the location at which the collected gas vent stream is introduced into the boiler or process heater over the same time period of the source testing.
- (B) The data required to be recorded under Section 1.6, Attachment A, for subsurface refuse boundary sampling probes and all remedial actions taken for exceedances of the 5 percent TOC standard required in paragraph (d)(4).
 - (C) The data required to be recorded under Section 2.8, Attachment A, for integrated samples and all remedial actions taken for exceedances of the 50 ppmv TOC standard required in paragraph (d)(5).
 - (D) The data required to be recorded under Section 3.4, Attachment A, for instantaneous monitoring and all remedial actions taken for exceedances of the 500 ppmv TOC standard required in paragraph (d)(6).

758(e)

(E) The data required to be recorded under Section 4.5, Attachment A, for landfill gas samples collected from the main gas collection header line entering the gas treatment and/or gas control systems.

(F) The data required to be recorded under Section 5.7, Attachment A, from ambient air collected at the landfill property boundary.

757(f)(3)

(G) A description and the duration of all periods when the collection, treatment or control device was not operating for a period exceeding one hour and the length of time the system was not operating.

758(c)

(H) Continuous records of the equipment operating parameters specified to be monitored under paragraph (e)(6) as well as records for periods of operation during which the parameter boundaries established during the most recent source test are exceeded.

(i) The following constitute exceedances that shall be recorded:

(I) For enclosed combustors except for boilers and process heaters with design heat input capacity of 44 megawatts (150 million British thermal unit per hour) or greater, all 3-hour periods of operation during which the average combustion temperature was more than 28° C (82° F) below the average combustion temperature during the most recent source test at which compliance with subparagraph (d)(1)(C) was determined.

(II) For boilers or process heaters, whenever there is a change in the location at which the vent stream is introduced into the flame zone as required under clause (f)(1)(A)(iv).

(ii) Records of the indication of flow to the control device specified under paragraph (e)(6)(A)(ii).

(iii) Each owner or operator who uses a boiler or process heater with a design heat input capacity of 44 megawatts or greater to comply with subparagraph (d)(1)(C) shall keep records of all periods of operation of the boiler or process heater. (Examples of such records could include records of steam use, fuel use, or monitoring data collected pursuant

to other State, local, Tribal, or Federal regulatory requirements.)

- (2) The reports required in subparagraphs (f)(2)(A) through (f)(2)(D) shall be submitted to the Executive Officer (Either paper copy or electronic formats are acceptable).
- (A) The initial source test report no later than 180 days after start-up and each succeeding complete annual source test report no later than 45 days after the anniversary date of the initial source test, for all control systems required in subparagraph (d)(1)(C).
- (B) A report no later than 45 days after the last day of each calendar quarter with the information required in clauses (f)(2)(B)(i) and (f)(2)(B)(ii).
- (i) All exceedances of the emission standards required in paragraphs (d)(4), (d)(5) and (d)(6) in the format required under Sections 1.6, 2.8 and 3.4, Attachment A. All exceedance resampling/remonitoring and each corrective action required under paragraphs (e)(1), (e)(2) and (e)(3). If there are no exceedances, submit a letter stating there were no exceedances for that quarter.
- (ii) All TAC analyses required in paragraphs (e)(1) through (e)(5).
- (C) A closure report to the Executive Officer no later than 30 days after waste acceptance cessation. The Executive Officer may request additional information as may be necessary to verify that permanent closure has taken place in accordance with the requirements of 40 CFR, Part 258, Section 258.60 or the applicable federal, state and local statutes, regulations, and ordinances in effect at the time of closure. If a closure report has been submitted to the Executive Officer, no additional wastes shall be placed into the landfill without filing a notification of modification as described under 40 CFR, Part 60, Section 60.7(a)(4).
- (D) A decommissioning report to the Executive Officer 30 days prior to well capping, removal or cessation of operation of the collection, treatment or control equipment. The decommissioning report shall contain all of the items as specified in clauses (f)(2)(D)(i) through (f)(2)(D)(iii):

757(d)

757(e)

- (i) A copy of the closure report submitted in accordance with subparagraph (f)(2)(C).
- (ii) A copy of the initial source test report demonstrating that the collection and control system has been installed a minimum of 15 years.
- (iii) All records needed to verify the landfill meets the exemption criteria under subdivision (k).

(g) Active Landfill Compliance Schedule

The MSW landfill owner or operator shall comply with the active landfill requirements of this rule or submit alternatives to this rule as specified in subdivision (i) no later than 90 days after April 10, 1998. Rule 1150.1 Compliance Plans previously submitted to the District shall remain in effect during the 90 days after April 10, 1998, or until the owner or operator has received an approved alternative Rule 1150.1 Compliance Plan submitted as specified in subdivision (i).

(h) Inactive Landfill Requirements

The MSW landfill owner or operator shall comply with either the applicable requirements in paragraphs (h)(1) and (h)(2) or submit alternatives to this rule as specified in subdivision (i).

- (1) Inactive landfills that have a landfill gas collection system shall meet all of the active landfill requirements. For those inactive landfills without a gas collection system and determined to need one, meet all of the active landfill requirements, except the collection and control system design plan and applications for permits shall be submitted no later than one year after notification by the Executive Officer.
- (2) Inactive landfills without a gas collection system:
 - (A) Upon discovery of TOC measured as methane exceeding 500 ppmv at any location on the landfill surface, apply mitigation measures such as compaction, additional cover, and/or watering to reduce the emissions to less than 500 ppmv. The procedure used for measurement of TOC shall meet the requirements of Section 3.0, Attachment A.
 - (B) Submit the following Data and/or meet the required action in paragraph (h)(1):

- (i) At any time after the adoption of this rule, but not later than 30 days after the receipt of a request, submit to the Executive Officer a screening questionnaire pursuant to California Air Resources Board Health and Safety Code (H & S) 41805.5.
- (ii) No later than 90 days after the date of a second request, submit to the Executive Officer a solid waste air quality assessment test (SWAT) report pursuant to H & S 41805.5, to determine whether or not a landfill gas collection and control system and/or a subsurface refuse boundary probe sampling system shall be required to be installed.
- (iii) If additional time is needed to provide the information required in clauses (h)(2)(B)(i) and (h)(2)(B)(ii), a written request for an extension may be submitted in writing to the Executive Officer, indicating the amount of time that is needed to obtain such information. Such a request for an extension may be submitted to the Executive Officer no later than 30 days after the receipt of the Executive Officer's requests as specified in clauses (h)(2)(B)(i) and (h)(2)(B)(ii).
- (iv) Upon notification by the Executive Officer that a landfill gas collection and control system and/or a subsurface refuse boundary probe sampling system shall be required, comply with paragraph (h)(I).

(i) Alternatives:

752(b)(2)(i)(B) Because of the many site-specific factors involved in the design and operation of landfill gas systems, alternatives to the requirements, test methods, procedures, compliance measures, monitoring, recordkeeping or reporting provisions of this rule may be necessary. All alternatives to the requirements of this rule shall be submitted to the Executive Officer in a Rule 1150.1 Compliance Plan. The Executive Officer shall review the Rule 1150.1 Compliance Plan and either approve it, disapprove it, or request that additional information be submitted. The Executive Officer shall deny the plan unless he determines that it will provide equivalent levels of emission control and enforceability, as would compliance with the requirements of this rule.

(j) Test Methods

(1) Methods of Analysis

754(d)

- (A) Either U.S. EPA Reference Method 25 or U.S. EPA Reference Method 18, 40 CFR, Part 60, Appendix A shall be used to determine the efficiency of the control system in reducing NMOC by at least 98 percent by weight. If using Method 18, the minimum list of compounds to be tested shall be those published in the most recent Compilation of Air Pollutant Emission Factors (AP-42). The equation in subparagraph (j)(1)(B) shall be used to calculate efficiency.
- (B) U.S. EPA Reference Method 25, 40 CFR, Part 60, Appendix A shall be used to determine the efficiency of the control system in reducing the outlet NMOC concentration to less than 20 ppmv, dry basis as hexane at 3 percent oxygen. Until, but not after District Method 25.3 has met equivalency as specified in paragraph (j)(2), U.S. EPA Reference Method 18, 40 CFR, Part 60, Appendix A may be used for this source test. If using Method 18, the minimum list of compounds to be tested shall be those published in the most recent Compilation of Air Pollutant Emission Factors (AP-42). The following equation shall be used to calculate efficiency:

$$\text{Control Efficiency} = (\text{NMOC}_{\text{in}} - \text{NMOC}_{\text{out}}) / (\text{NMOC}_{\text{in}})$$

where,

NMOC_{in} = mass of NMOC entering control device

NMOC_{out} = mass of NMOC exiting control device

(2) Equivalent Test Methods

Any other method demonstrated to be equivalent and approved in writing by the Executive Officers of the District, the California Air Resources Board (CARB), and the Regional Administrator of the United States Environmental Protection Agency (U.S. EPA), Region IX, or their designees, may be used to determine compliance with this rule.

(k) Exemptions

An MSW landfill may be temporarily exempt from all or any portion of the requirements of this rule if the owner or operator can demonstrate to the Executive Officer that the MSW landfill emissions meet the requirements of paragraphs

(k)(1) through (k)(4). Temporary exemption may be independently determined by the Executive Officer, if the MSW landfill emissions meet the requirements of paragraphs (k)(1) through (k)(4). MSW landfills issued temporary exemption letters by the Executive Officer shall remain exempt, subject to periodic review, provided:

(1) The MSW landfill complies with the requirements of paragraphs (d)(4), (d)(5) and (d)(6).

(2) The MSW landfill emits less than 55 tons per year of NMOC as specified in 40 CFR, Part 60, Section 60.752(b) or, for a closed landfill, as specified in 40 CFR, Part 60, Section 60.752(b)(2)(v)(C).

752(b)

(3) The MSW landfill constitutes an insignificant health risk. In making this determination the Executive Officer shall consider the listed factors in subparagraphs (k)(3)(A) through (k)(3)(G). Where not specified, in evaluating the cancer risks and hazard indexes, the Executive Officer shall be guided by the definitions in District Rule 1401 - New Source Review of Carcinogenic Air Contaminants, and Rule 1402 - Control of Toxic Air Contaminants From Existing Sources.

(A) The proximity to, and any adverse impacts on, residences, schools, hospitals or other locations or structures which have children, or elderly or sick persons.

(B) The emission migration beyond the landfill property boundary.

(C) The complaint history.

(D) The age and closure date.

(E) The amount and type of waste deposited.

(F) That the emissions of carcinogenic air contaminants, specified in Table 1, Attachment A, from the landfill will not result in a maximum individual cancer risk greater than one in one million (1×10^{-6}) at any receptor location.

(G) That the emissions of TAC, specified in Table 1, Attachment A, from the landfill will not result in a total acute or chronic Hazard Index of greater than 1.

(4) The MSW landfill is in compliance with District Nuisance Rule 402.

Such temporary exemption shall be reviewed periodically by the Executive Officer, to consider the land use surrounding the landfill and gaseous emissions,

and the impact on the public. Depending upon the results of the review, the Executive Officer may extend or terminate the exemption.

(1) **Loss of Exemption**

If an MSW landfill should have its temporary exemption terminated, the owner or operator shall comply with the active landfill requirements of this rule.

ATTACHMENT A

1.0 SUBSURFACE REFUSE BOUNDARY SAMPLING PROBES

Paragraph (d)(4) and (e)(1) Requirements of Rule 1150.1

1.1 Subsurface Probe Design and Installation

Landfills which are subject to Rule 1150.1 must install and maintain a subsurface refuse boundary probe sampling system of adequate design to determine if gas migration exists for the ultimate purpose of preventing surface emissions. The California Integrated Waste Management Board also requires the installation of refuse boundary probes for purposes of detecting and ultimately preventing subsurface migration of landfill gas past the permitted property boundary of the landfill/disposal site as well as the prevention of the accumulation of landfill gas in on-site structures. It is the District's intent that the subsurface refuse boundary probes required by paragraph (d)(3) of Rule 1150.1 be designed and installed in such a manner as to comply with the requirements of the California Integrated Waste Management Board (whenever possible) and Sections 1.1.1 through 1.1.4.

1.1.1 The probes shall be installed within the landfill property line and outside the refuse disposal area.

1.1.2 Wherever accessible, the probes shall be located no further than 100 feet from the refuse boundary.

ALTERNATIVE: WHEREVER ACCESSIBLE AND THE PROBES ARE GREATER THAN 100 FEET FROM THE REFUSE, MONITOR INSTANTANEOUSLY FROM THE REFUSE BOUNDARY TO THE PROBE, USING THE GRID METHOD EVERY QUARTER AND WHEN PROBES EXCEED 2% TOC.

1.1.3 The spacing between probes shall be based on the adjacent land use no further than 1320 feet (1/4 mile) from the refuse boundary and shall be determined as follows:

LAND USE	SPACING
Residential/Commercial	100 feet
Public Access	500 feet
Undeveloped Open Space, (No Public Access)	650 feet
Landfill with Liners	1000 feet

1.1.4 Each probe shall be capped, sealed, have a sampling valve and be of multiple-depth design for which the depth shall be determined based on the depth of refuse no further than 500 feet from the probe as follows:

- | | |
|--------------|--|
| First Depth | 10 feet below surface. |
| Second Depth | 25% of refuse depth or 25 feet below surface, whichever is deeper. |
| Third Depth | 50% of refuse depth or 50 feet below surface, whichever is deeper. |
| Fourth Depth | 75% of refuse depth or 75 feet below surface, whichever is deeper. |

Second, third, or fourth depth probes may be deleted if the required depth of such probe is deeper than the depth of the refuse.

1.2 Number of Samples

All refuse boundary gas probes at each depth shall be monitored monthly for TOC measured as methane using a portable flame ionization detector (FID) meeting the requirements of Section 3.2 and with a tube connected to the probe sampling valve. In addition, samples shall be taken as specified in Section 1.2.1 or 1.2.2 to determine the concentration of both TOC and TAC. The Executive Officer may require additional probes to be sampled upon written request.

1.2.1 If the TOC concentration measured with the FID does not exceed 5% by volume in any of the probes, collect one bag sample from one probe with the highest concentration, or

ALTERNATIVE: IF THE TOC CONCENTRATION MEASURED WITH THE FID OR APPROVED ALTERNATIVE DOES NOT EXCEED 5% BY VOLUME IN ANY OF THE PROBES, NO BAG SAMPLES ARE REQUIRED FOR TOC ANALYSIS. HOWEVER, EACH QUARTER COLLECT ONE BAG SAMPLE FOR TAC ANALYSIS FROM THE PROBE WITH THE HIGHEST CONCENTRATION DURING ANY ONE OF THE MONTHLY MONITORING PERIODS, OR

1.2.2 If the TOC concentration measured with the FID for any of the probes exceeds 5% by volume, collect one bag sample per probe from the probes with the highest concentrations above 5% by volume, from at least five probes.

ALTERNATIVE: IF THE TOC CONCENTRATION MEASURED WITH THE FID OR APPROVED ALTERNATIVE EXCEEDS 5% BY VOLUME IN ANY OF THE PROBES, EACH QUARTER COLLECT ONE BAG SAMPLE FOR TOC/TAC ANALYSIS FROM THE PROBE WITH THE HIGHEST CONCENTRATION DURING ANY ONE OF THE MONTHLY MONITORING PERIODS.

1.3 Subsurface Refuse Boundary Probe Sampling Procedure

1.3.1 Prior to collecting gas samples, evacuate the probe (the probes must be sealed during evacuation) until the TOC concentration remains constant for at least 30 seconds.

1.3.2 The constant TOC concentration shall be measured using an FID that meets the requirements in Section 3.2.

ALTERNATIVE: PORTABLE ANALYZERS ON AN APPROVED LIST OF EQUIPMENT MAINTAINED BY THE AQMD MAY BE USED AS ALTERNATIVES FOR THE SAMPLER/INSTRUMENT REQUIREMENTS OF THIS RULE.

1.3.3 Collect approximately a 10-liter gas sample in a Tedlar (Dupont trade name for polyvinyl) bag or equivalent container over a continuous ten-minute period using the evacuated container sampling procedure described in Section 7.1.1 of EPA Method 18 or direct pump sampling procedure described in Section 7.1.2 of EPA Method 18. The container shall be LIGHT-SEALED.

1.4 Subsurface Refuse Boundary Probe Analytical Procedures

All samples collected shall be analyzed no later than 72 hours after collection for TOC using U.S. EPA Method 25, 40 CFR, Part 60, Appendix A analysis or a portable FID that meets the requirements in Section 3.2 and for the TAC specified in Table 1 and upon written request, Table II, using U.S. EPA Compendium Method TO-14.

1.5 Chain of Custody (Required for samples sent to the lab)

A custody sheet shall accompany the bag samples. Each time a bag changes hands, it shall be logged on the custody sheet with the time of custody transfer recorded. Laboratory personnel shall record the condition of the sample (full,

three-fourths full, one-half full, one-fourth full, or empty). An example of a custody sheet is shown in Figure 4.

1.6 Recording the Results

1.6.1 Record the volume concentration of TOC measured as methane for each individually identified refuse boundary probe (at each depth) and the volume concentration of TAC for selected probes on a quality control sheet as shown in Figure 3. Include a topographic map drawn to scale with the location of both the refuse boundary probes and the gas collection system clearly marked and identified.

1.6.2 Maintain and submit the results as specified in subdivision (f) of Rule 1150.1.

2.0 INTEGRATED LANDFILL SURFACE SAMPLING
Paragraph (d)(5) and (e)(2) Requirements of Rule 1150.1

2.1 Number of Samples

The number of samples collected will depend on the area of the landfill surface. The entire landfill disposal area shall be divided into individually identified 50,000 square foot grids. One monthly sample shall be collected from each grid for analysis. Any area that the Executive Officer deems inaccessible or dangerous for a technician to enter may be excluded from the sampling grids monitored by the landfill owner or operator. To exclude an area from monitoring, the landfill owner or operator shall file a written request with the Executive Officer. Such a request shall include an explanation of the requested exclusion and photographs of the area. The Executive Officer shall notify the landfill owner or operator in writing of the decision. Any exclusion granted shall apply only to the monitoring requirement. The 50 ppmv limit specified in paragraph (d)(5) of Rule 1150.1 applies to all areas.

**ALTERNATIVE: MONITORING IS NOT REQUIRED FOR THE
FOLLOWING LANDFILL SURFACES:
PORTIONS OF SLOPES 30 DEGREES AND GREATER, PAVED
SURFACES EXCEPT FOR CRACKS, AND THE ACTIVE WORKING
FACE.**

2.2 Integrated Surface Sampling Conditions

- 2.2.1. The average wind speed during this sampling procedure shall be five miles per hour or less. Surface sampling shall be terminated when the average wind speed exceeds five miles per hour or the instantaneous wind speed exceeds ten miles per hour. Average wind speed is determined on a 15-minute average.
- 2.2.2. Surface sampling shall be conducted when the landfill is dry. The landfill is considered dry when there has been no measurable precipitation for the preceding 72 hours prior to sampling. Most major newspapers report the amount of precipitation that has fallen in a 24-hour period throughout the Southern California area. Select the nearest reporting station that represents the landfill location or provide for measurable precipitation collection at the MSW landfill wind monitoring station.

2.3 Integrated Surface Sampler Equipment Description

An integrated surface sampler is a portable self-contained unit with its own internal power source. The integrated sampler consists of a stainless steel collection probe, a rotameter, a pump, and a 10-liter Tedlar bag enclosed in a LIGHT-SEALED CONTAINER to prevent photochemical reactions from occurring during sampling and transportation. The physical layout of the sampler is shown in Figure 1.

ALTERNATIVE: THE INTEGRATED SAMPLER SHALL INCLUDE A TEDLAR BAG ANYWHERE FROM ONE TO 10-LITERS IN SIZE.

An alternate integrated surface sampler may be used, provided that the landfill owner or operator can show an equivalency with the sampler specifications in Section 2.4 and shown in Figure 1. All alternatives shall be submitted as specified in subdivision (i) of Rule 1150.1.

2.4 Integrated Surface Sampler Equipment Specifications

- 2.4.1 Power: Batteries or any other power source.
- 2.4.2 Pump: The diaphragm shall be made of non-lubricated Viton (Dupont trade name for co-polymer of hexafluoropropylene and vinylidene fluoride) rubber.
- 2.4.3 Bag: One 10-liter Tedlar bag with a valve. The Tedlar bag shall be contained in a LIGHT-SEALED CONTAINER. The valve shall be leak

free and constructed of aluminum, stainless steel, or non-reactive plastic with a Viton or Buna-N (butadiene acrylonitrile co-polymer) o-ring seal.

2.4.4 Rotameter: The rotameter shall be made of borosilicate glass or other non-reactive material and have a flow range of approximately 0-to-1 liter per minute. The scale shall be in milliliters or an equivalent unit. The graduations shall be spaced to facilitate accurate flow readings.

2.4.5 Air Flow Control Orifice: Needle valve in the rotameter.

2.4.6 Funnel: 316 stainless steel.

2.4.7 Fittings, Tubing and Connectors: 316 stainless steel or Teflon.

2.5 Integrated Surface Sampling Procedure

2.5.1 An integrated surface sampler as described in Section 2.4 shall be used to collect a surface sample approximately 8-to-10 liters from each grid.

2.5.2 During sampling, the probe shall be placed 0-to-3 inches above the landfill surface.

2.5.3 The sampler shall be set at a flow rate of approximately 333 cubic centimeters per minute

2.5.4 Walk through a course of approximately 2,600 linear feet over a continuous 25-minute period. Figure 2 shows a walk pattern for the 50,000 square foot grid.

2.6 Integrated Surface Sample Analytical Procedures

All samples collected shall be analyzed no later than 72 hours after collection for TOC using U.S. EPA Method 25, 40 CFR, Part 60, Appendix A analysis or a portable FID that meets the requirements in Section 3.2. In addition, the samples specified in Section 2.6.1 or 2.6.2 must be analyzed no later than 72 hours after collection for the TAC specified in Table 1 and upon written request, Table II, using U.S. EPA Compendium Method TO-14.

2.6.1 Ten percent of all samples which have a concentration of TOC greater than 50 ppmv as methane, or

2.6.2 Two samples if all samples are 50 ppmv or less of TOC or two samples if there are less than 20 samples above 50 ppmv.

The Executive Officer may require more samples to be tested for TAC if he determines there is a potential nuisance or public health problem.

2.7 Chain of Custody (Required for samples sent to the lab)

A custody sheet shall accompany the bag samples. Each time a bag changes hands, it shall be logged on the custody sheet with the time of custody transfer recorded. Laboratory personnel shall record the condition of the sample (full, three-fourths full, one-half full, one-fourth full, or empty). An example of a custody sheet is shown in Figure 4.

2.8 Recording the Results

- 2.8.1 Record the volume concentration of both TOC measured as methane for each grid and the volume concentration for the required TAC on a quality control sheet as shown in Figure 3. Include a topographic map drawn to scale with the location of the grids and the gas collection system clearly marked and identified.
- 2.8.2 Record the wind speed during the sampling period using the wind speed and direction monitoring system required in paragraph (d)(9) of Rule 1150.1.
- 2.8.3 Maintain and submit the results as specified in subdivision (f) of Rule 1150.1.

3.0 **INSTANTANEOUS LANDFILL SURFACE MONITORING**
Subparagraph (d)(6) and (e)(3) Requirements of Rule 1150.1

3.1 Monitoring Area

The entire landfill disposal area shall be monitored once each calendar quarter. Any area of the landfill that the Executive Officer deems as inaccessible or dangerous for a technician to enter may be excluded from the area to be monitored by the landfill owner or operator. To exclude an area from monitoring, the landfill owner or operator shall file a petition with the Executive Officer. Such a request shall include an explanation of why the area should be excluded and photographs of the area. Any excluded area granted shall only apply to the monitoring requirement. The 500 ppmv limit specified in paragraph (d)(6) of Rule 1150.1 applies to all areas.

**ALTERNATIVE: MONITORING IS NOT REQUIRED FOR THE
FOLLOWING LANDFILL SURFACES:
PORTIONS OF SLOPES 30 DEGREES AND GREATER, PAVED
SURFACES EXCEPT FOR CRACKS, AND THE ACTIVE WORKING
FACE.**

3.2 Equipment Description and Specifications

A portable FID shall be used to instantaneously measure the concentration of TOC measured as methane at any location on the landfill. The FID shall meet the specifications listed in Sections 3.2.1 through 3.2.4 and shall be kept in good operating condition.

3.2.1 The portable analyzer shall meet the instrument specifications provided in Section 3 of U.S. EPA Method 21, except that:

3.2.1.1 "Methane" shall replace all references to VOC.

3.2.1.2 A response time of 15 seconds or shorter shall be used instead of 30 seconds.

3.2.1.3 A precision of 3% or better shall be used instead of 10%.

In addition the instrument shall meet the specifications in Sections 3.2.1.4 through 3.2.1.6.

3.2.1.4 A minimum detectable limit of 5 ppmv (or lower).

3.2.1.5 A flame-out indicator, audible and visual.

3.2.1.6 Operate at an ambient temperature of 0 - 50° C.

3.2.2 The calibration gas shall be methane, diluted to a nominal concentration of 10,000 ppmv in air for subsurface refuse boundary probe monitoring and sample analysis to comply with paragraph (e)(1) of Rule 1150.1, 50 ppmv in air for integrated sample analyses to comply with paragraph (e)(2) of Rule 1150.1 and 500 ppmv in air for instantaneous monitoring to comply with paragraph (e)(3) of Rule 1150.1.

3.2.3 To meet the performance evaluation requirements in Section 3.1.3 of U.S. EPA Method 21, the instrument evaluation procedures of Section 4.4 of U.S. EPA Method 21 shall be used.

3.2.4 The calibration procedures provided in Section 4.2 of U.S. EPA Method 21 shall be followed at the beginning of each day before commencing a surface monitoring survey.

3.3 Monitoring Procedures

3.3.1 The owner or operator shall monitor the landfill disposal area for TOC measured as methane using the described portable equipment.

3.3.2 The sampling probe shall be placed at a distance of 0-3 inches above any location of the landfill to take the readings.

3.3.3 At a minimum, an individually identified 50,000 square foot grid shall be used and a walk pattern as illustrated in Figure 2 shall be implemented including areas where visual observations indicate elevated concentrations of landfill gas, such as distressed vegetation and cracks or seeps in the cover.

3.4 Recording the Results

3.4.1 Record the location and concentration of TOC measured as methane for any instantaneous reading of 500 ppmv or greater on a topographic map of the landfill, drawn to scale with the location of both the grids and the gas collection system clearly marked and identified.

3.4.2 Maintain and submit the results as specified in subdivision (f) of Rule 1150.1.

4.0 LANDFILL GAS SAMPLE FROM GAS COLLECTION SYSTEM
Subparagraph (e)(4) Requirement of Rule 1150.1

4.1 Number of Samples

Collect one monthly sample of landfill gas for analysis from the main gas collection header line entering the gas treatment and/or gas control system(s).

4.2 Sampling Procedure

Collect approximately a 10-liter sample in a Tedlar bag or equivalent container over a continuous ten-minute period.

4.3 Analytical Procedures

Samples collected shall be analyzed no later than 72 hours after collection for TOC using U.S. EPA Method 25, 40 CFR, Part 60, Appendix A analysis and for the TAC specified in Table 1 and upon written request, Table II, using U.S. EPA Compendium Method TO-14.

4.4 Chain of Custody (Required for samples sent to the lab)

A custody sheet shall accompany the bag samples. Each time a bag changes hands, it shall be logged on the custody sheet with the time of custody transfer recorded. Laboratory personnel shall record the condition of the sample (full, three-fourths full, one-half full, one-fourth full, or empty). An example of a custody sheet is shown in Figure 4.

4.5 Recording the Results

- 4.5.1 Record the volume concentration of both TOC measured as methane and the volume concentration for the required TAC on a quality control sheet as shown in Figure 3. Include a topographic map drawn to scale with the location of the gas collection and control system clearly marked and identified.
- 4.5.2 Maintain and submit the results as specified in subdivision (f) of Rule 1150.1.

5.0 AMBIENT AIR SAMPLES AT THE LANDFILL PROPERTY BOUNDARY
Subparagraph (e)(5) Requirement of Rule 1150.1

5.1 Number of Samples

Monthly ambient air samples shall be collected for analysis at the landfill property boundary from both an upwind and downwind sampler sited to provide good meteorological exposure to the predominant offshore (drainage land breeze) and onshore (sea breeze) wind flow patterns. The upwind and downwind samples shall be collected simultaneously over two 12 hour periods beginning between 9:00 a.m. and 10:00 a.m., and 9:00 p.m. and 10:00 p.m. on the same day or different days.

5.2 Ambient Air Sampling Conditions

Ambient air sampling shall be conducted on days when stable (offshore drainage) and unstable (onshore sea breeze) meteorological conditions are representative for the season. Preferable sampling conditions are characterized by the following meteorological conditions:

- 5.2.1 Clear cool nights with wind speeds of two miles per hour or less, and
- 5.2.2 Onshore sea breezes with wind speeds ten miles per hour or less.

No sampling will be conducted if the following adverse meteorological conditions exist:

- 5.2.3 Rain,
- 5.2.4 Average wind speeds greater than 15 miles per hour for any 30-minute period, or
- 5.2.5 Instantaneous wind speeds greater than 25 miles per hour.

Continuously recorded on-site wind speed and direction measurements required in paragraph (d)(9) of Rule 1150.1 will characterize the micrometeorology of the site

Rule 1150.1 (Cont.)
(Attachment A Continued)

and serve to verify that the meteorological criteria have been met during sampling.

5.3 Ambient Air Sampler Equipment Description

An ambient air sampling unit consists of a 10-liter Tedlar bag, a DC-operated pump, stainless steel capillary tubing to control the sample rate to the bag, a bypass valve to control the sample flow rate (and minimize back pressure on the pump), a Rotameter for flow indication to aid in setting the flow, a 24-hour clock timer to shut off the sampler at the end of the 24-hour sampling period, and associated tubing and connections (made of stainless steel, Teflon, or borosilicate glass to minimize contamination and reactivity). The physical layout of the sampler is shown in Figure 5.

An alternate ambient air sampler may be used, provided that the landfill owner or operator can show an equivalency with the sampler specifications in Section 5.3 and shown in Figure 5. All alternatives shall be submitted as specified in subdivision (i) of Rule 1150.1.

5.4 Ambient Air Sampler Equipment Specifications

The equipment used when conducting air samples at any landfill property boundary shall meet the following specifications:

5.4.1 Power: one 12V DC marine battery. The marine battery provides 12V DC to the pump and the clock.

5.4.2 Pump: one 12V DC pump. The diaphragm shall be made of non-lubricated Viton rubber. The maximum pump unloaded flow rate shall be 4.5 liters per minute.


5.4.3 Bag: One 10-liter Tedlar bag with a valve. The Tedlar bag shall be enclosed in a LIGHT-SEALED CONTAINER. The valve is a push-pull type constructed of aluminum and stainless steel, with a Viton or Buna-N (butadiene acrylonitrile co-polymer) o-ring seal.

5.4.4 Rotameter - made of borosilicate glass and has a flow range of 3-to-50 cubic centimeters per minute. The scale is in millimeters (mm) with major graduations (labeled) every 5 mm and minor graduations every 1 mm.

5.4.5 Air flow control orifice: 316 stainless steel capillary tubing.

5.4.6 Bypass valve.

- 5.4.7 Fittings, tubing, and connectors -- 315 stainless steel or Teflon.
- 5.4.8 Clock timer with an accuracy of better than 1%.
- 5.5 Ambient Air Sample Analytical Procedures
Samples collected must be analyzed no later than 72 hours after collection for TOC using U.S. EPA Method 25, 40 CFR, Part 60, Appendix A analysis or a portable FID that meets the requirements in Section 3.2 and for the TAC specified in Table 1 and upon written request, Table II, using U.S. EPA Compendium Method TO-14.
- 5.6 Chain of Custody (Required for samples sent to the lab)
A custody sheet shall accompany the bag samples. Each time a bag changes hands, it shall be logged on the custody sheet with the time of custody transfer recorded. Laboratory personnel shall record the condition of the sample (full, three-fourths full, one-half full, one-fourth full, or empty). An example of a custody sheet is shown in Figure 4.
- 5.7 Recording the Results
- 5.7.1 Record the volume concentration of TOC measured as methane and the volume concentration of TAC for each sample on a quality control sheet as shown in Figure 3. Include a topographic map drawn to scale with the location of both the upwind and downwind samplers and the gas collection and control system clearly marked and identified.
- 5.7.2 Record the wind speed and direction during the 24-hour sampling period using the wind speed and direction monitoring system required in paragraph (d)(9) of Rule 1150.1.
- 5.7.3 Maintain and submit the results as specified in subdivision (f) of Rule 1150.1.

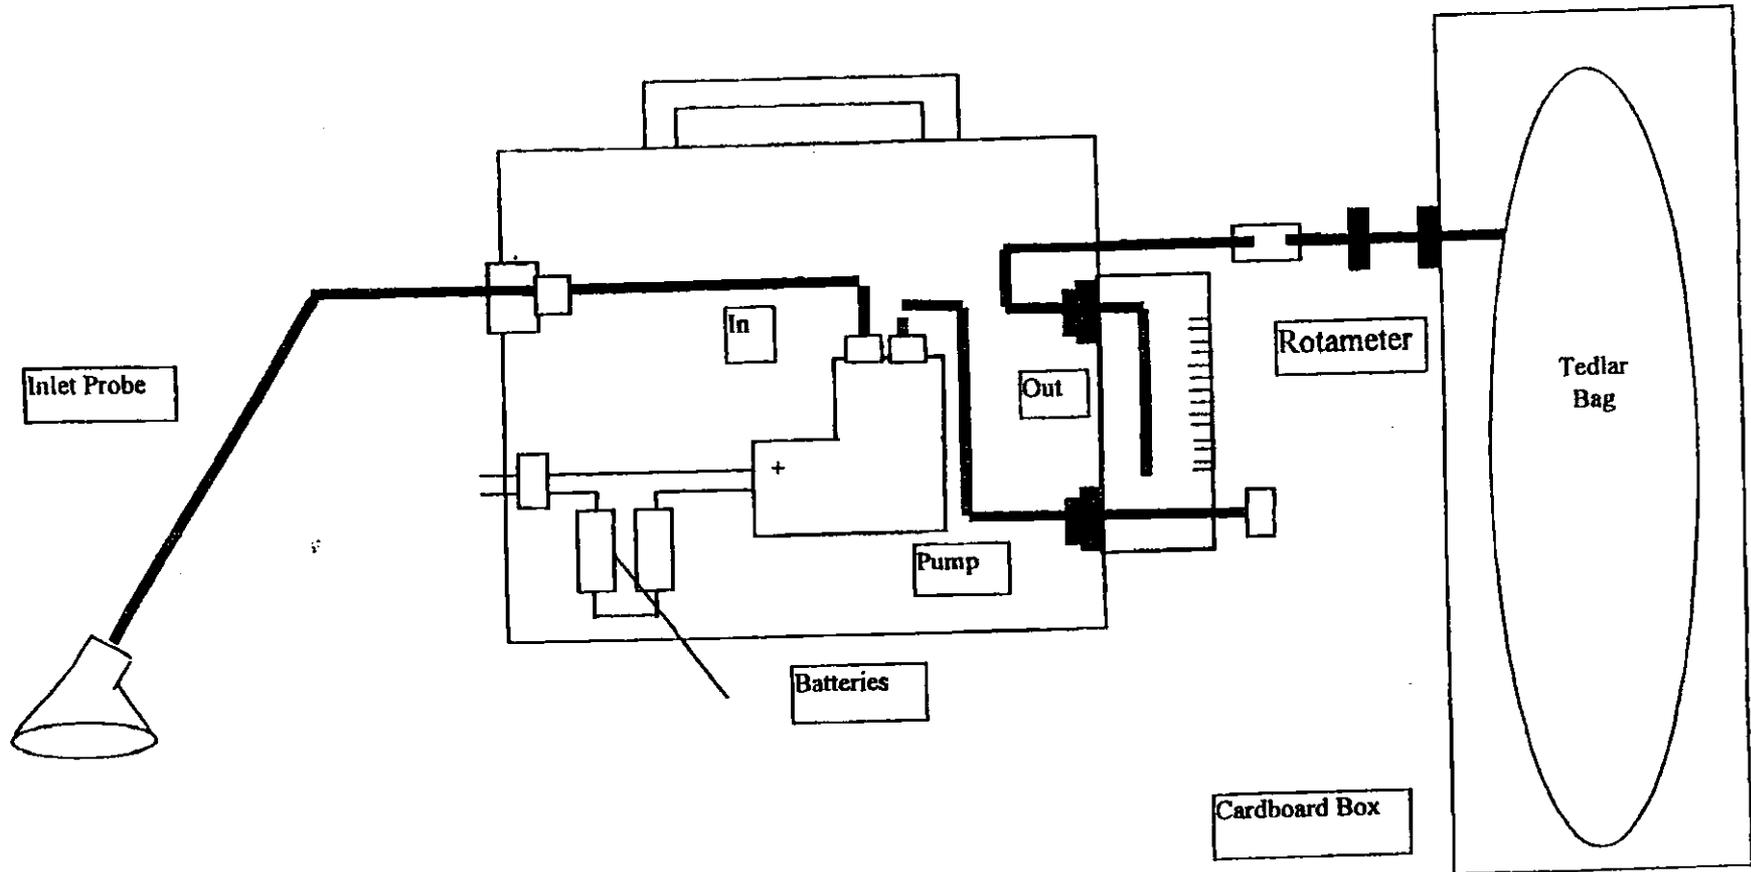

PORTABLE INTEGRATED BAG SAMPLER
Physical Layout

Figure 1

Typical Landfill Walk Pattern
for a 50,000 Square Foot Grid

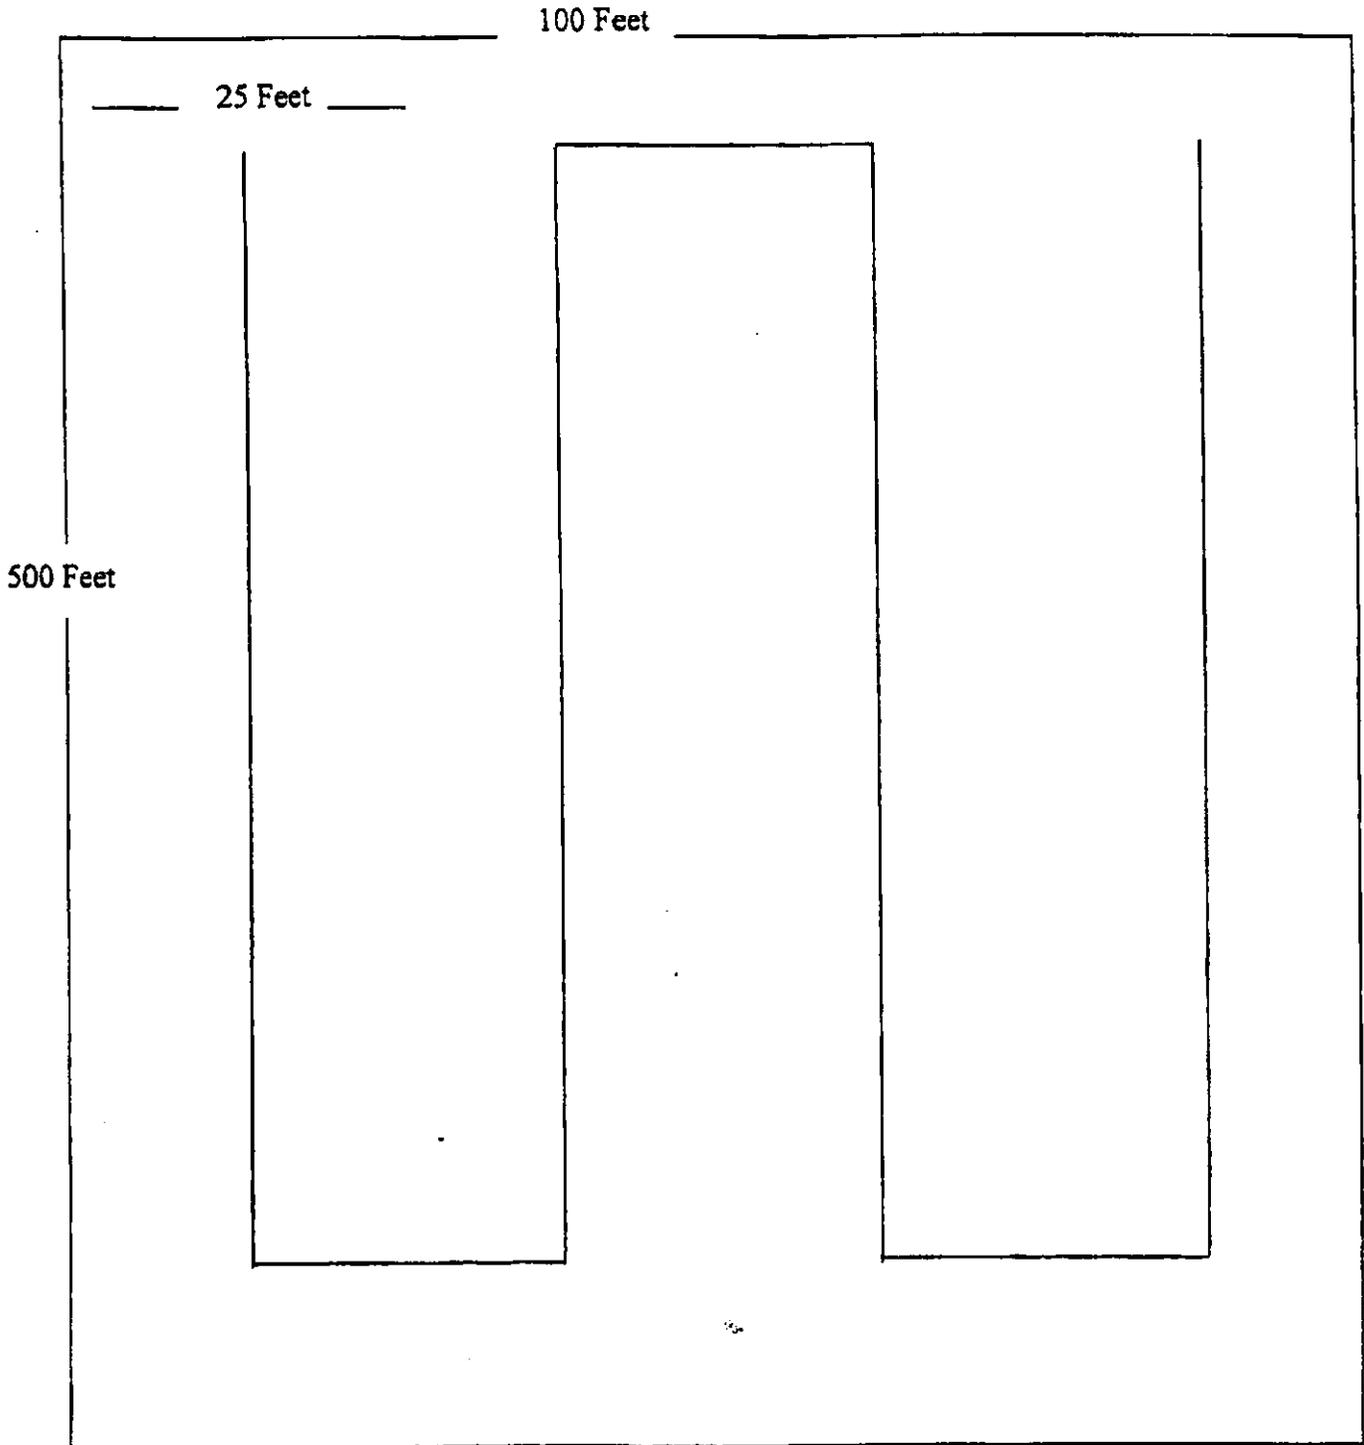


Figure 2

BAG SAMPLE CUSTODY FORM

Project _____

Date: _____

Bag (I.D. #)									
Condition Received in Lab*									

Bags Prepared By: _____ Time: _____
Date: _____

Bags Taken Out By: _____ Time: _____

Bags Taken to Lab By: _____

Bags Received In Lab By: _____ Time _____

* F = 1/2 full to full, O = Overfull (Bulging), L = 1/4 to 1/2 full,
E = Less than 1/4 full but contains some sample, N = No sample at all.

Figure 4

Rule 1150.1 (Cont.)
(Attachment A Continued)

(Amended March 17, 2000)

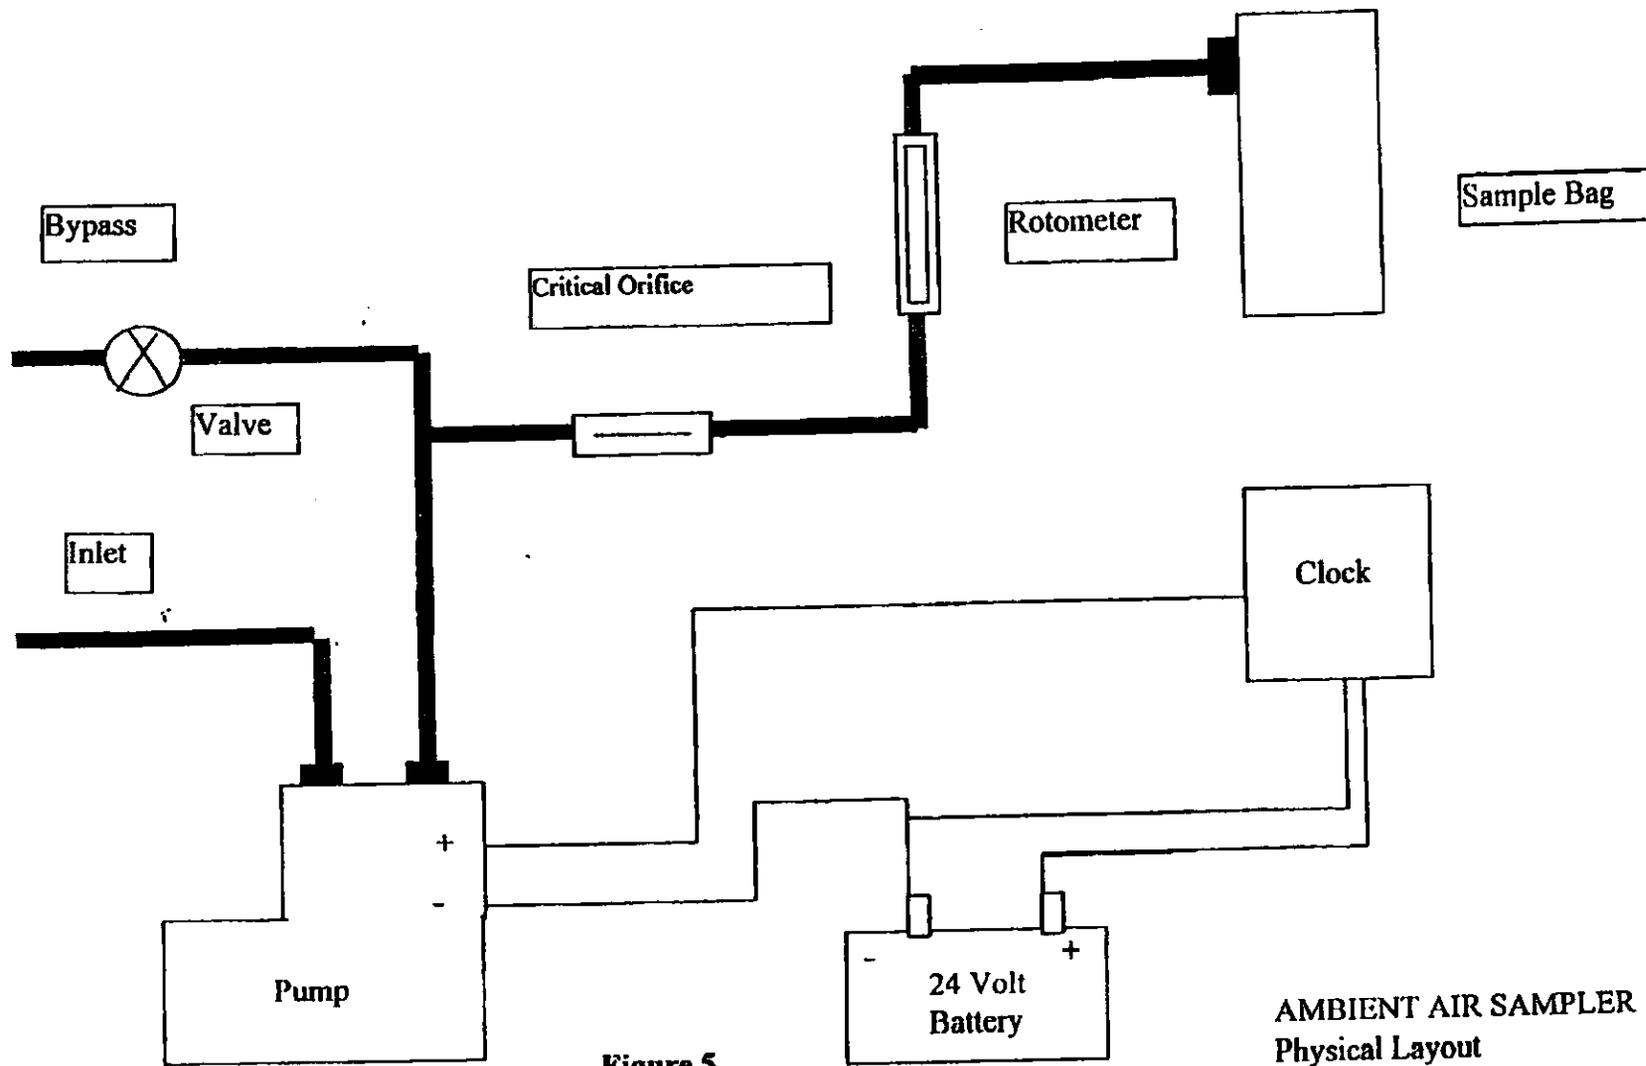


Figure 5

AMBIENT AIR SAMPLER
Physical Layout

**TABLE 1 - CARCINOGENIC AND TOXIC AIR CONTAMINANTS
(Core Group)**

Paragraph (e)(2), Subparagraphs (k)(3)(F) and (k)(3)(G) Requirements of
Rule 1150.1

1.	Benzene	C_6H_6
2.	Benzyl Chloride	$C_6H_5CH_2Cl$
3.	Chlorobenzene	C_6H_5Cl
4.	1,2 Dibromoethane (Ethylene Dibromide)	$BrCH_2CH_2Br$
5.	Dichlorobenzene	$C_6H_4Cl_2$
6.	1,1 Dichloroethane (Ethylidene Chloride)	CH_3CHCl_2
7.	1,2 Dichloroethane (Ethylene Dichloride)	ClH_2CH_2Cl
8.	1,1 Dichloroethene (Vinylidene Chloride)	$CH_2 : CCl_2$
9.	Dichloromethane (Methylene Chloride)	CH_2Cl_2
10.	Hydrogen Sulfide	H_2S
11.	Tetrachloroethylene (Perchloroethylene)	$Cl_2C : CCl_2$
12.	Tetrachloromethane (Carbon Tetrachloride)	CCl_4
13.	Toluene	$C_6H_5CH_3$
14.	1,1,1 Trichloroethane (Methyl Chloroform)	CH_3CCl_3
15.	Trichloroethylene	$CHCl : CCl_2$
16.	Trichloromethane (Chloroform)	$CHCl_3$
17.	Vinyl Chloride	$CH_2 : CHCl$
18.	Xylene	$C_6H_4(CH_3)_2$

**TABLE 2 - CARCINOGENIC AND TOXIC AIR CONTAMINANTS
(Supplemental Group)**

**Paragraph (e)(2), Subparagraphs (k)(3)(F) and (k)(3)(G) Requirements of
Rule 1150.1**

1.	Acetaldehyde	CH ₃ CHO
2.	Acrolein	CH ₂ CHCHO
3.	Acrylonitrile	H ₂ C : CHCN
4.	Allyl Chloride	H ₂ C : CHCH ₂ Cl
5.	Bromomethane (Methyl Bromide)	CH ₃ Br
6.	Chlorinated Phenols	
7.	Chloroprene	H ₂ C : CHCCl : CH ₂
8.	Cresol	CH ₃ C ₆ H ₄ OH
9.	Dialkyl Nitrosamines	
10.	1,4 - Dioxane	OCH ₂ CH ₂ OCH ₂ CH ₂
11.	Epichlorohydrin	CH ₂ OCHCH ₂ Cl
12.	Ethylene Oxide	CH ₂ CH ₂ O
13.	Formaldehyde	HCHO
14.	Hexachlorocyclopentadiene	C ₅ Cl ₆
15.	Nitrobenzene	C ₆ H ₅ NO ₂
16.	Phenol	C ₆ H ₅ OH
17.	Phosgene	COCl ₂
18.	Polychlorinated Dibenzo-P-Dioxin	
19.	Polychlorinated Dibenzo Furan	
20.	Polychlorinated Biphenols	
21.	Polynuclear Aromatic Hydrocarbons	
22.	Propylene Oxide	CH ₂ -CH-CH ₃
23.	Tetrahydrothiophene	CH ₂ CH ₂ CH ₂ CH ₂ S
24.	Thiophene	CHCHCHCHS

Attachment B

TITLE 27. Environmental Protection

Division 2. Solid Waste

Subdivision 1. Consolidated Regulations for Treatment, Storage, Processing or Disposal of Solid

Chapter 3. Criteria for All Waste Management Units, Facilities, and Disposal Sites

Subchapter S. Closure and Post-Closure Maintenance

Article 2. Closure and Post-Closure Maintenance Standards for Disposal Sites and

Landfills

§21140. Section CIWMB -- Final Cover. (T14:§17773)

(a) The final cover shall function with minimum maintenance and provide waste containment to protect public health and safety by controlling at a minimum, vectors, fire, odor, litter and landfill gas migration. The final cover shall also be compatible with postclosure land use.

(b) In proposing a final cover design meeting the requirements under §21090, the owner or operator shall assure that the proposal meets the requirements of this section. Alternative final cover designs shall meet the performance requirements of ¶(a) and, for MSWLF units, 40 CFR 258.60(b); shall be approved by the enforcement agency for aspects of ¶(a).

(c) The EA may require additional thickness, quality, and type of final cover depending on, but not limited to the following:

- (1) a need to control landfill gas emissions and fires;
- (2) the future reuse of the site; and
- (3) provide access to all areas of the site as needed for inspection of monitoring and control facilities, etc.

NOTE

Authority cited: Sections 40502 and 43020, Public Resources Code; and Section 66796.22 (d), Government Code. Reference: Sections 43021 and 43103, Public Resources Code; and Section 66796.22(d), Government Code.

HISTORY

1. New section filed 6-18-97; operative 7-18-97 (Register 97, No. 25).

Attachment C

TITLE 27. Environmental Protection

Division 2. Solid Waste

Subdivision 1. Consolidated Regulations for Treatment, Storage, Processing or

Disposal of Solid

Chapter 3. Criteria for All Waste Management Units, Facilities, and Disposal Sites

Subchapter 2. Siting and Design

Article 2. SWRCB -- Waste Classification and Management

§20200. SWRCB -- Applicability and Classification Criteria. (CIS: §2520)

(a) Concept--This article contains a waste classification system which applies to solid wastes that cannot be discharged directly or indirectly to waters of the state and which therefore must be discharged to waste management units (Units) for treatment, storage, or disposal in accordance with the requirements of this division. Wastes which can be discharged directly or indirectly (e.g., by percolation) to waters of the state under effluent or concentration limits that implement applicable water quality control plans (e.g., municipal or industrial effluent or process wastewater) are not subject to the SWRCB-promulgated provisions of this division. This waste classification system shall provide the basis for determining which wastes may be discharged at each class of Unit. Waste classifications are based on an assessment of the potential risk of water quality degradation associated with each category of waste.

(1) The waste classifications in this article shall determine where the waste can be discharged unless the waste does not consist of or contain municipal solid waste (MSW) and the discharger establishes to the satisfaction of the RWQCB that a particular waste constituent or combination of constituents presents a lower risk of water quality degradation than indicated by classification according to this article.

(2) Discharges of wastes identified in §20210 or §20220 of this article shall be permitted only at Units which have been approved and classified by the RWQCB in accordance with the criteria established in Article 3 of this subchapter, and for which WDRs have been prescribed or waived pursuant to Article 4, Subchapter 3, Chapter 4 of this subdivision (§21710 et seq.). Table 2.1 (of this article) presents a summary of discharge options for each waste category.

(b) Dedicated Units/Cells For Certain Wastes--The following wastes shall be discharged only at dedicated Units [or dedicated landfill cells (e.g., ash monofill cell)] which are designed and constructed to contain such wastes:

- (1) wastes which cause corrosion or decay, or otherwise reduce or impair the integrity of containment structures;
- (2) wastes which, if mixed or commingled with other wastes can produce a violent reaction (including heat, pressure, fire or explosion), can produce toxic byproducts, or can produce any reaction product(s) which:
 - (A) requires a higher level of containment;
 - (B) is a restricted waste; or
 - (C) impairs the integrity of containment structures.

(c) Waste Characterization--Dischargers shall be responsible for accurate characterization of wastes, including determinations of whether or not wastes will be compatible with containment features and other wastes at a Unit under ¶(b), and whether or not wastes are required to be managed as hazardous wastes under Chapter 11 of Division 4.5 of Title 22 of this code.

(d) Management of Liquids at Landfills and Waste Piles--The following requirements apply to discharges of liquids at Class II waste piles and at Class II and Class III landfills, except as otherwise required for MSW landfills by more-stringent state and federal requirements under SWRCB Resolution No. 93-62 section 2908 of Title 23 of this Code (see 40CFR258.28) [*Note: see also definitions of "leachate" and "landfill gas condensate" in §20164*]:

(1) [Reserved.];

(2) wastes containing free liquids shall not be discharged to a Class II waste pile. Any waste that contains liquid in excess of the moisture-holding capacity of the waste in the Class II landfill, or which contains liquid in excess of the moisture-holding capacity as a result of waste management operations, compaction, or settlement shall only be discharged to a surface impoundment or to another Unit with containment features equivalent to a surface impoundment; and

(3) liquids or semi-solid waste (i.e., waste containing less than 50 percent solids, by weight), other than dewatered sewage or water treatment sludge as described in §20220(c), shall not be discharged to Class III landfills. Exceptions may be granted by the RWQCB if the discharger can demonstrate that such discharge will not exceed the moisture-holding capacity of the landfill, either initially or as a result of waste management operations, compaction, or settlement, so long as such discharge is not otherwise prohibited by applicable state or federal requirements

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

**SECTION J: AIR TOXICS
[40CFR 63 Subpart AAAA 01-16-2003]**

**NATIONAL EMISSION STANDARDS FOR HAZARDOUS AIR POLLUTANTS -
MUNICIPAL SOLID WASTE LANDFILLS**

- (1) The owner/operator of a municipal solid waste (MSW) landfill shall comply with all applicable requirements of 40 CFR 63, Subpart AAAA and of 40 CFR 63, Subpart A – General Provisions by the compliance date(s) that are specified in these subparts.
- (2) The owner/operator of a MSW landfill system shall comply with all applicable requirements for installation and operation of a landfill gas collection and/or control system as specified in 40 CFR 60, subpart Cc or WWW.
- (3) The operator shall keep all records pursuant to Section 63.1980 of this subpart or Subpart A to demonstrate compliance with all applicable requirements. All records including data, calculations and any supporting documentation shall be prepared in a format which is acceptable to the AQMD.
- (4) The operator shall submit all reports, notifications, plans, submittals and other communications required by Section 63.1980 of this subpart or Subpart A to the AQMD and, unless notified to the contrary by AQMD or US EPA, to US EPA Region IX (See Sections E and K of this permit for addresses).
- (5) Alternative plans, compliance plans, and the construction and operation of new or modified air pollution control equipment that are required by this subpart shall be approved through the AQMD permit system.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

GENERAL PROVISIONS

1. This permit may be revised, revoked, reopened and reissued, or terminated for cause, or for failure to comply with regulatory requirements, permit terms, or conditions. [3004(a)(7)(C)]
2. This permit does not convey any property rights of any sort or any exclusive privilege. [3004(a)(7)(E)]

Permit Renewal and Expiration

3. (A) Except for solid waste incineration facilities subject to standards under section 129(e) of the Clean Air Act, this permit shall expire five years from the date that this Title V permit is issued. The operator's right to operate under this permit terminates at midnight on this date, unless the facility is protected by an application shield in accordance with Rule 3002(b), due to the filing of a timely and complete application for a Title V permit renewal, consistent with Rule 3003. [3004(a)(2), 3004(f)]

(B) A Title V permit for a solid waste incineration facility combusting municipal waste subject to standards under Section 129(e) of the Clean Air Act shall expire 12 years from the date of issuance unless such permit has been renewed pursuant to this regulation. These permits shall be reviewed by the Executive Officer at least every five years from the date of issuance. [3004(f)(2)]
4. To renew this permit, the operator shall submit to the Executive Officer an application for renewal at least 180 days, but not more than 545 days, prior to the expiration date of this permit. [3003(a)(6)]

Duty to Provide Information

5. The applicant for, or holder of, a Title V permit shall furnish, pursuant to Rule 3002(d) and (e), timely information and records to the Executive Officer or designee within a reasonable time as specified in writing by the Executive Officer or designee. [3004(a)(7)(F)]

Payment of Fees

6. The operator shall pay all required fees specified in Regulation III - Fees. [3004(a)(7)(G)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

Reopening for Cause

7. The Executive Officer will reopen and revise this permit if any of the following circumstances occur:
- (A) Additional regulatory requirements become applicable with a remaining permit term of three or more years. Reopening is not required if the effective date of the requirement is later than the expiration date of this permit, unless the permit or any of its terms and conditions has been extended pursuant to paragraph (f)(4) of Rule 3004.
 - (B) The Executive Officer or EPA Administrator determines that this permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of this permit.
 - (C) The Executive Officer or EPA Administrator determines that the permit must be revised or revoked to assure compliance with the applicable requirements. [3005(g)(1)]

COMPLIANCE PROVISIONS

8. The operator shall comply with all regulatory requirements, and all permit terms and conditions, except:
- (A) As provided for by the emergency provisions of condition no. 17 or condition no. 18, or
 - (B) As provided by an alternative operating condition granted pursuant to a federally approved (SIP-approved) Rule 518.2.

Any non-compliance with any federally enforceable permit condition constitutes a violation of the Federal Clean Air Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or revision; or denial of a permit renewal application. Non-compliance may also be grounds for civil or criminal penalties under the California State Health and Safety Code. [3004(a)(7)(A)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

9. The operator shall allow the Executive Officer or authorized representative, upon presentation of appropriate credentials to:
 - (A) Enter the operator's premises where emission-related activities are conducted, or records are kept under the conditions of this permit;
 - (B) Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permit;
 - (C) Inspect at reasonable times, any facilities, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under the permit; and
 - (D) Sample or monitor at reasonable times, substances or parameters for the purpose of assuring compliance with the facility permit or regulatory requirements. [3004(a)(10)(B)]

10. All terms and conditions in this permit, including any provisions designed to limit a facility's potential to emit, are enforceable by the EPA Administrator and citizens under the federal Clean Air Act, unless the term or condition is designated as not federally enforceable. Each day during any portion of which a violation occurs is a separate offense. [3004(g)]

11. A challenge to any permit condition or requirement raised by EPA, the operator, or any other person, shall not invalidate or otherwise affect the remaining portions of this permit. [3007(b)]

12. The filing of any application for a permit revision, revocation, or termination, or a notification of planned changes or anticipated non-compliance does not stay any permit condition. [3004(a)(7)(D)]

13. It shall not be a defense for a person in an enforcement action, including those listed in Rule 3002(c)(2), that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit, except as provided for in "Emergency Provisions" of this section. [3004(a)(7)(H)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

14. The operator shall not build, erect, install, or use any equipment, the use of which, without resulting in a reduction in the total release of air contaminants to atmosphere, reduces or conceals an emission which would otherwise constitute a violation of Chapter 3 (commencing with Section 41700) of Part 4, of Division 26 of the California Health and Safety Code or of AQMD rules. This rule shall not apply to cases in which the only violation involved is of Section 41700 of the California Health and Safety Code, or Rule 402 of AQMD Rules. [408]
15. Nothing in this permit or in any permit shield can alter or affect:
- (A) Under Section 303 of the federal Clean Air Act, the provisions for emergency orders;
 - (B) The liability of the operator for any violation of applicable requirements prior to or at the time of permit issuance;
 - (C) The applicable requirements of the Acid Rain Program, Regulation XXXI;
 - (D) The ability of EPA to obtain information from the operator pursuant to Section 114 of the federal Clean Air Act;
 - (E) The applicability of state or local requirements that are not "applicable requirements", as defined in Rule 3000, at the time of permit issuance but which do apply to the facility, such as toxics requirements unique to the State; and
 - (F) The applicability of regulatory requirements with compliance dates after the permit issuance date. [3004(c)(3)]
16. For any portable equipment that requires an AQMD or state permit or registration, excluding a) portable engines, b) military tactical support equipment and c) AQMD-permitted portable equipment that are not a major source, are not located at the facility for more than 12 consecutive months after commencing operation, and whose operation does not conflict with the terms or conditions of this Title V permit: 1) the facility operator shall keep a copy of the AQMD or state permit or registration; 2) the equipment operator shall comply with the conditions on the permit or registration and all other regulatory requirements; and 3) the facility operator shall treat the permit or registration as a part of its Title V permit, subject to recordkeeping, reporting and certification requirements. [3004(a)(1)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration EMERGENCY PROVISIONS

17. An emergency¹ constitutes an affirmative defense to an action brought for noncompliance with a technology-based emission limit only if:
- (A) Properly signed, contemporaneous operating records or other credible evidence demonstrate that:
 - (1) An emergency occurred and the operator can identify the cause(s) of the emergency;
 - (2) The facility was operated properly (i.e. operated and maintained in accordance with the manufacturer's specifications, and in compliance with all regulatory requirements or a compliance plan), before the emergency occurred;
 - (3) The operator took all reasonable steps to minimize levels of emissions that exceeded emissions standard, or other requirements in the permit; and,
 - (4) The operator submitted a written notice of the emergency to the AQMD within two working days of the time when the emissions limitations were exceeded due to the emergency. The notice shall contain a description of the emergency, any steps taken to mitigate emissions, and corrective actions taken; and
 - (B) The operator complies with the breakdown provisions of Rule 430 – Breakdown Provisions, or subdivision (i) of Rule 2004 – Requirements, whichever is applicable. [3002(g), 430, 2004(i)]
18. The operator is excused from complying with any regulatory requirement that is suspended by the Executive Officer during a state of emergency or state of war emergency, in accordance with Rule 118 - Emergencies. [118]

¹ "Emergency" means any situation arising from sudden and reasonably unforeseeable events beyond the control of the operator, including acts of God, which: (A) requires immediate corrective action to restore normal operation; and (B) causes the facility to exceed a technology-based emission limitation under the permit, due to unavoidable increases in emissions attributable to the emergency; and (C) is not caused by improperly designed equipment, lack of preventative maintenance, careless or improper operation, or operator error.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration **RECORDKEEPING PROVISIONS**

19. In addition to any other recordkeeping requirements specified elsewhere in this permit, the operator shall keep records of required monitoring information, where applicable, that include:
- (A) The date, place as defined in the Title V permit, and time of sampling or measurements;
 - (B) The date(s) analyses were performed;
 - (C) The company or entity that performed the analyses;
 - (D) The analytical techniques or methods used;
 - (E) The results of such analyses; and
 - (F) The operating conditions as existing at the time of sampling or measurement. [3004(a)(4)(B)]
20. The operator shall maintain records pursuant to Rule 109 and any applicable material safety data sheet (MSDS) for any equipment claimed to be exempt from a written permit by Rule 219 based on the information in those records. [219(t)]
21. The operator shall keep all records of monitoring data required by this permit or by regulatory requirements for a period of at least five years from the date of the monitoring sample, measurement, report, or application. [3004(a)(4)(E)]

REPORTING PROVISIONS

22. The operator shall comply with the following requirements for prompt reporting of deviations:
- (A) Breakdowns shall be reported as required by Rule 430 – Breakdown Provisions or subdivision (i) of Rule 2004 - Requirements, whichever is applicable.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

- (B) Other deviations from permit or applicable rule emission limitations, equipment operating conditions, or work practice standards, determined by observation or by any monitoring or testing required by the permit or applicable rules that result in emissions greater than those allowed by the permit or applicable rules shall be reported within 72 hours (unless a shorter reporting period is specified in an applicable State or Federal Regulation) of discovery of the deviation by contacting AQMD enforcement personnel assigned to this facility or otherwise calling (800) CUT-SMOG.
 - (C) A written report of such deviations reported pursuant to (B), and any corrective actions or preventative measures taken, shall be submitted to AQMD, in an AQMD approved format, within 14 days of discovery of the deviation.
 - (D) All other deviations shall be reported with the monitoring report required by condition no. 23. [3004(a)(5)]
23. Unless more frequent reporting of monitoring results are specified in other permit conditions or in regulatory requirements, the operator shall submit reports of any required monitoring to the AQMD at least twice per year. The report shall include a) a statement whether all monitoring required by the permit was conducted; and b) identification of all instances of deviations from permit or regulatory requirements. A report for the first six calendar months of the year is due by August 31 and a report for the last six calendar months of the year is due by February 28. [3004(a)(4)(F)]
24. The operator shall submit to the Executive Officer and to the Environmental Protection Agency (EPA), an annual compliance certification. For RECLAIM facilities, the certification is due when the Annual Permit Emissions Program (APEP) report is due and shall cover the same reporting period. For other facilities, the certification is due on March 1 for the previous calendar year. The certification need not include the period preceding the date the initial Title V permit was issued. Each compliance certification shall include:
- (A) Identification of each permit term or condition that is the basis of the certification;

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

- (B) The compliance status during the reporting period;
- (C) Whether compliance was continuous or intermittent;
- (D) The method(s) used to determine compliance over the reporting period and currently, and
- (E) Any other facts specifically required by the Executive Officer to determine compliance.

The EPA copy of the certification shall be sent to: Director of the Air Division Attn:
Air-3 USEPA, Region IX 75 Hawthorne St. San Francisco, CA 94105 [3004(a)(10)(E)]

25. All records, reports, and documents required to be submitted by a Title V operator to AQMD or EPA shall contain a certification of accuracy consistent with Rule 3003(c)(7) by a responsible official (as defined in Rule 3000). [3004(a)(12)]

PERIODIC MONITORING

26. All periodic monitoring required by this permit pursuant to Rule 3004(a)(4)(c) is based on the requirements and justifications in the AQMD document "Periodic Monitoring Guidelines for Title V Facilities" or in case-by-case determinations documented in the TitleV application file. [3004(a)(4)]

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

FACILITY RULES

This facility is subject to the following rules and regulations

With the exception of Rule 402, 473, 477, 1118 and Rules 1401 through 1420, the following rules that are designated as non-federally enforceable are pending EPA approval as part of the state implementation plan. Upon the effective date of that approval, the approved rule(s) will become federally enforceable, and any earlier versions of those rules will no longer be federally enforceable.

RULE SOURCE	Adopted/Amended Date	FEDERAL Enforceability
RULE 109	5-2-2003	Federally enforceable
RULE 1113	11-8-1996	Federally enforceable
RULE 1113	6-3-2011	Non federally enforceable
RULE 1133	1-10-2003	Federally enforceable
RULE 1133.1	1-10-2003	Federally enforceable
RULE 1150	10-15-1982	Non federally enforceable
RULE 1150.1	3-17-2000	Federally enforceable
RULE 1150.1	4-1-2011	Non federally enforceable
RULE 1171	11-7-2003	Federally enforceable
RULE 1171	5-1-2009	Non federally enforceable
RULE 1303(a)(1)-BACT	12-6-2002	Non federally enforceable
RULE 1303(a)(1)-BACT	5-10-1996	Federally enforceable
RULE 1303(b)(1)-Modeling	12-6-2002	Non federally enforceable
RULE 1303(b)(1)-Modeling	5-10-1996	Federally enforceable
RULE 1303(b)(2)-Offset	12-6-2002	Non federally enforceable
RULE 1303(b)(2)-Offset	5-10-1996	Federally enforceable
RULE 1401	9-10-2010	Non federally enforceable
RULE 204	10-8-1993	Federally enforceable
RULE 217	1-5-1990	Federally enforceable
RULE 218	5-14-1999	Federally enforceable
RULE 219	6-1-2007	Non federally enforceable
RULE 219	9-4-1981	Federally enforceable

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

SECTION K: TITLE V Administration

RULE SOURCE	Adopted/Amended Date	FEDERAL Enforceability
RULE 3002	11-14-1997	Federally enforceable
RULE 3002	11-5-2010	Non federally enforceable
RULE 3003	11-14-1997	Federally enforceable
RULE 3003	11-5-2010	Non federally enforceable
RULE 3004	12-12-1997	Federally enforceable
RULE 3005	11-14-1997	Federally enforceable
RULE 3005	11-5-2010	Non federally enforceable
RULE 3007	10-8-1993	Federally enforceable
RULE 301	5-6-2011	Non federally enforceable
RULE 304	5-6-2011	Non federally enforceable
RULE 401	11-9-2001	Non federally enforceable
RULE 401	3-2-1984	Federally enforceable
RULE 402	5-7-1976	Non federally enforceable
RULE 403	4-2-2004	Federally enforceable
RULE 403	6-3-2005	Non federally enforceable
RULE 404	2-7-1986	Federally enforceable
RULE 407	4-2-1982	Federally enforceable
RULE 409	8-7-1981	Federally enforceable
RULE 430	7-12-1996	Non federally enforceable
RULE 431.1	6-12-1998	Federally enforceable
RULE 431.2	5-4-1990	Federally enforceable
RULE 431.2	9-15-2000	Non federally enforceable
RULE 461	3-7-2008	Non federally enforceable
RULE 461	6-3-2005	Federally enforceable
RULE 701	6-13-1997	Federally enforceable
40CFR 60 Subpart GG	2-24-2006	Federally enforceable
40CFR 60 Subpart WWW	10-17-2000	Federally enforceable
40CFR 63 Subpart AAAA	1-16-2003	Federally enforceable
40CFR 63 Subpart AAAA	4-20-2006	Federally enforceable
40CFR Part 64	10-22-1997	Federally enforceable

**FACILITY PERMIT TO OPERATE
LA COUNTY SANITATION DIST (CALABASAS)**

**APPENDIX A: NOX AND SOX EMITTING EQUIPMENT EXEMPT FROM WRITTEN
PERMIT PURSUANT TO RULE 219**

NONE

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 11-08-1996]

- (1) Except as provided in paragraphs (c)(2), (c)(3), and (c)(4) of Rule 1113, the operator shall not supply, sell, offer for sale, apply, or solicit the application of, any architectural coating which, at the time of sale or manufacture, contains more than 250 grams of VOC per liter of coating (2.08 pounds per gallon), less water, less exempt compounds, and less any colorant added to tint bases, or manufacture, blend, or repackage such a coating for use within the District.
- (2) Except as provided in paragraphs (c)(3) and (c)(4) of Rule 1113, the operator shall not supply, sell, offer for sale, apply, solicit the application of, manufacture, blend, or repackage, for use within the District, any architectural coating listed in the Table of Standards which contains VOC (excluding any colorant added to tint bases) in excess of the corresponding VOC limit specified in the table, after the effective date specified.

TABLE OF STANDARDS

VOC LIMITS

Grams of VOC Per Liter of Coating, Less Water And Less Exempt Compounds

COATING	Limit*	Effective Date of Adoption	Effective 1/1/1998	Effective 1/1/1999	Effective 7/1/2001	Effective 1/1/2005	Effective 7/1/2008
Bond Breakers	350						
Clear Wood Finishes							
Varnish	350						
Sanding Sealers	350						
Lacquer	680		550			275	
Concrete-Curing Compounds	350						
Dry-Fog Coatings	400						
Fire-proofing Exterior Coatings	350	450		350			
Fire-Retardant Coatings							
Clear	650						
Pigmented	350						
Flats	250				100		50
Graphic Arts (Sign) Coatings	500						

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 11-08-1996]

Industrial Maintenance						
Primers and Topcoats						
Alkyds	420					
Catalyzed Epoxy	420					
Bituminous Coatings	420					
Materials						
Inorganic Polymers	420					
Vinyl Chloride Polymers	420					
Chlorinated Rubber	420					
Acrylic Polymers	420					
Urethane Polymers	420					
Silicones	420					
Unique Vehicles	420					
Japans/Faux Finishing	350	700		350		
Coatings						
Magnesite Cement Coatings	600			450		
Mastic Coatings	300					
Metallic Pigmented Coatings	500					
Multi-Color Coatings	420		250			
Pigmented Lacquer	680		550		275	
Pre-Treatment Wash Primers	780					
Primers, Sealers, and	350					
Undercoaters						
Quick-Dry Enamels	400					
Roof Coatings	300					
Shellac						
Clear	730					
Pigmented	550					
Stains	350					
Swimming Pool Coatings						
Repair	650					
Other	340					
Traffic Coatings	250		150			
Waterproofing Sealers	400					
Wood Preservatives						
Below-Ground	350					
Other	350					

* The specified limits remain in effect unless revised limits are listed in subsequent columns in the Table of Standards

TABLE OF STANDARDS (cont.)

VOC LIMITS

Grams of VOC Per Liter of Material

COATING	Limit
Low-Solids Coating	120

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 06-03-2011]

- (1) Except as provided in paragraphs (c)(3), (c)(4), and designated coatings averaged under (c)(6) of Rule 1113, no person shall supply, sell, offer for sale, market, manufacture, blend, repackage, apply, store at a worksite, or solicit the application of any architectural coating within the District:
 - (A) That is listed in the Table of Standards 1 and contains VOC (excluding any colorant added to tint bases) in excess of the corresponding VOC limit specified in the table, after the effective date specified; or
 - (B) That is not listed in the Table of Standards 1, and contains VOC (excluding any colorant added to tint bases) in excess of 250 grams of VOC per liter of coating (2.08 pounds per gallon), less water, less exempt compounds, until January 1, 2014, at which time the limit drops to 50 grams of VOC per liter of coating, less water, less exempt compounds (0.42 pounds per gallon).
- (2) No person within the District shall add colorant at the point of sale that is listed in the Table of Standards 2 and contains VOC in excess of the corresponding VOC limit specified in the Table of Standards 2, after the effective date specified.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 06-03-2011]

TABLE OF STANDARDS 1 VOC LIMITS

**Grams of VOC Per Liter of Coating,
 Less Water and Less Exempt Compounds**

COATING CATEGORY	Ceiling Limit ¹	Current Limit ²	Effective Date		
			7/1/08	1/1/12	1/1/14
Bond Breakers		350			
Clear Wood Finishes		275			
Varnish	350	275			
Sanding Sealers	350	275			
Lacquer		275			
Concrete-Curing Compounds		100			
Concrete-Curing Compounds For Roadways and Bridges ³		350			
Concrete Surface Retarder		250			50
Driveway Sealer		100		50	
Dry-Fog Coatings		150			50
Faux Finishing Coatings					
Clear Topcoat		350		200	
Decorative Coatings		350			100
Glazes		350			
Japan		350			
Trowel Applied Coatings		350		150	50
Fire-Proofing Coatings		350			150
Flats	250	50	50		
Floor Coatings	100	50			
Form Release Compound		250			100
Graphic Arts (Sign) Coatings		500			150
Industrial Maintenance (IM) Coatings	420	100			
High Temperature IM Coatings		420			
Non-Sacrificial Anti-Graffiti Coatings		100			
Zinc-Rich IM Primers	340	100			
Magnesite Cement Coatings		450			
Mastic Coatings		300			100
Metallic Pigmented Coatings	500	500			150
Multi-Color Coatings		250			
Nonflat Coatings	150	50			
Pre-Treatment Wash Primers		420			
Primers, Sealers, and Undercoaters	200	100			
Reactive Penetrating Sealers		350			
Recycled Coatings		250			
Roof Coatings	250	50			
Roof Coatings, Aluminum		100			

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 06-03-2011]

Roof Primers, Bituminous	350	350		
Rust Preventative Coatings	400	100		
Stone Consolidant		450		
Sacrificial Anti-Graffiti Coatings		100	50	
Shellac				
Clear		730		
Pigmented		550		
Specialty Primers	350	100		
Stains		100		

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 06-03-2011]

COATING CATEGORY	Ceiling Limit ¹	Current Limit ²	Effective Date		
			7/1/08	1/1/12	1/1/14
Stains, Interior	250	250			
Swimming Pool Coatings					
Repair		340			
Other		340			
Traffic Coatings		100			
Waterproofing Sealers	250	100			
Waterproofing Concrete/Masonry Sealers	400	100			
Wood Preservatives		350			

1. The specified ceiling limits are applicable to products sold under the Averaging Compliance Option.
2. The specified limits remain in effect unless revised limits are listed in subsequent columns in the Table of Standards.
3. Does not include compounds used for curbs and gutters, sidewalks, islands, driveways and other miscellaneous concrete areas.

TABLE OF STANDARDS 1 (cont.) VOC LIMITS

Grams of VOC Per Liter of Material

COATING	Limit
Low-Solids Coating	120

TABLE OF STANDARDS 2 VOC LIMITS FOR COLORANTS

Grams of VOC Per Liter of Colorant Less Water and Less Exempt Compounds

COLORANT	Limit ⁴
Architectural Coatings, excluding IM Coatings	50
Solvent-Based IM	600
Waterborne IM	50

4. Effective January 1, 2014.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 11-07-2003]

(1) Solvent Requirements

A person shall not use a solvent to perform solvent cleaning operations unless the solvent complies with the applicable requirements set forth below:

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(A) Product Cleaning During Manufacturing Process Or Surface Preparation For Coating, Adhesive, Or Ink Application	
(i) General	25 (0.21)
(ii) Electrical Apparatus Components & Electronic Components	500 (4.2)
(iii) Medical Devices & Pharmaceuticals	800 (6.7)
(B) Repair and Maintenance Cleaning	
(i) General	25 (0.21)
(ii) Electrical Apparatus Components & Electronic Components	900 (7.5)

**FACILITY PERMIT TO OPERATE
 LA COUNTY SANITATION DIST (CALABASAS)**

**APPENDIX B: RULE EMISSION LIMITS
 [RULE 1171 11-07-2003]**

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(iii) Medical Devices & Pharmaceuticals	
(A) Tools, Equipment, & Machinery	800 (6.7)
(B) General Work Surfaces	600 (5.0)
(C) Cleaning of Coatings or Adhesives Application Equipment	550 (4.6)
(D) Cleaning of Ink Application Equipment	
(i) General	25 (0.21)
(ii) Flexographic Printing	25 (0.21)
(iii) Gravure Printing	
(A) Publication	750 (6.3)
(B) Packaging	25 (0.21)
(iv) Lithographic or Letter Press Printing	

**FACILITY PERMIT TO OPERATE
 LA COUNTY SANITATION DIST (CALABASAS)**

**APPENDIX B: RULE EMISSION LIMITS
 [RULE 1171 11-07-2003]**

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(A) Roller Wash – Step 1	600 (5.0)
(B) Roller Wash-Step 2, Blanket Wash, & On-Press Components	800 (6.7)
(C) Removable Press Components	25 (0.21)
(v) Screen Printing	750 (6.3)
(vi) Ultraviolet Ink/ Electron Beam Ink Application Equipment (except screen printing)	800 (6.7)
(vii) Specialty Flexographic Printing	600 (5.0)
(E) Cleaning of Polyester Resin Application Equipment	25 (0.21)

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 05-01-2009]

(1) Solvent Requirements

A person shall not use a solvent to perform solvent cleaning operations unless the solvent complies with the applicable requirements set forth below:

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(A) Product Cleaning During Manufacturing Process Or Surface Preparation For Coating, Adhesive, Or Ink Application		
(i) General	25 (0.21)	
(ii) Electrical Apparatus Components & Electronic Components	100 (0.83)	
(iii) Medical Devices & Pharmaceuticals	800 (6.7)	
(B) Repair and Maintenance Cleaning		
(i) General	25 (0.21)	
(ii) Electrical Apparatus Components & Electronic Components	100 (0.83)	

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 05-01-2009]

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY (cont.)	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(iii) Medical Devices & Pharmaceuticals		
(A) Tools, Equipment, & Machinery	800 (6.7)	
(B) General Work Surfaces	600 (5.0)	
(C) Cleaning of Coatings or Adhesives Application Equipment	25 (0.21)	
(D) Cleaning of Ink Application Equipment		
(i) General	25 (0.21)	
(ii) Flexographic Printing	25 (0.21)	
(iii) Gravure Printing		
(A) Publication	100 (0.83)	
(B) Packaging	25 (0.21)	
(iv) Lithographic (Offset) or Letter Press Printing		
(A) Roller Wash, Blanket Wash, & On-Press Components	100 (0.83)	

**FACILITY PERMIT TO OPERATE
 LA COUNTY SANITATION DIST (CALABASAS)**

**APPENDIX B: RULE EMISSION LIMITS
 [RULE 1171 05-01-2009]**

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY (cont.)	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(B) Removable Press Components	25 (0.21)	
(v) Screen Printing	100 (0.83)	
(vi) Ultraviolet Ink/ Electron Beam Ink Application Equipment (except screen printing)	650 (5.4)	100 (0.83)
(vii) Specialty Flexographic Printing	100 (0.83)	
(E) Cleaning of Polyester Resin Application Equipment	25 (0.21)	

* The specified limits remain in effect unless revised limits are listed in subsequent columns.

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 404 02-07-1986]

The operator shall not discharge into the atmosphere from this equipment, particulate matter in excess of the concentration at standard conditions, shown in Table 404(a). Where the volume discharged is between figures listed in the Table, the exact concentration permitted to be discharged shall be determined by linear interpolation.

For the purposes of this rule, emissions shall be averaged over one complete cycle of operation or one hour, whichever is the lesser time period.

TABLE 404(a)

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
		Milligrams per Cubic Meter	Grains per Cubic Foot			Milligrams per Cubic Meter	Grains per Cubic Foot
Cubic meters Per Minute	Cubic feet Per Minute			Cubic meters Per Minute	Cubic feet Per Minute		
25 or less	883 or less	450	0.196	900	31780	118	0.0515
30	1059	420	.183	1000	35310	113	.0493
35	1236	397	.173	1100	38850	109	.0476
40	1413	377	.165	1200	42380	106	.0463
45	1589	361	.158	1300	45910	102	.0445

**FACILITY PERMIT TO OPERATE
 LA COUNTY SANITATION DIST (CALABASAS)**

**APPENDIX B: RULE EMISSION LIMITS
 [RULE 404 02-07-1986]**

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot	Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot
50	1766	347	.152	1400	49440	100	.0437
60	2119	324	.141	1500	52970	97	.0424
70	2472	306	.134	1750	61800	92	.0402
80	2825	291	.127	2000	70630	87	.0380
90	3178	279	.122	2250	79460	83	.0362
100	3531	267	.117	2500	88290	80	.0349
125	4414	246	.107	3000	105900	75	.0327
150	5297	230	.100	4000	141300	67	.0293
175	6180	217	.0947	5000	176600	62	.0271
200	7063	206	.0900	6000	211900	58	.0253
250	8829	190	.0830	8000	282500	52	.0227
300	10590	177	.0773	10000	353100	48	.0210
350	12360	167	.0730	15000	529700	41	.0179
400	14130	159	.0694	20000	706300	37	.0162
450	15890	152	.0664	25000	882900	34	.0148

FACILITY PERMIT TO OPERATE LA COUNTY SANITATION DIST (CALABASAS)

APPENDIX B: RULE EMISSION LIMITS [RULE 404 02-07-1986]

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
		Milligrams per Cubic Meter	Grains per Cubic Foot			Milligrams per Cubic Meter	Grains per Cubic Foot
Cubic meters Per Minute	Cubic feet Per Minute			Cubic meters Per Minute	Cubic feet Per Minute		
500	17660	146	.0637	30000	1059000	32	.0140
600	21190	137	.0598	40000	1413000	28	.0122
700	24720	129	.0563	50000	1766000	26	.0114
800	28250	123	.0537	70000 or more	2472000 or more	23	.0100