

PROPOSED

DATE

CERTIFIED MAIL
RETURN RECEIPT REQUESTED
(xxx)

08-xxxE CAB
File No. 0110

Captain Taylor Skadron
Commander, Navy Region Hawaii
Regional Environmental Department
U.S. Navy
PMRF, Barking Sands
517 Russell Avenue, Suite 110
Pearl Harbor, Hawaii 96860-4884

Attn: Darren Chun

Dear Captain Skadron:

**Subject: Covered Source Permit (CSP) No. 0110-01-C
Renewal Application No. 0110-03
US Navy
Pacific Missile Range Facility (PMRF), Barking Sands
Three (3) 320 kW and Two (2) 600 kW Diesel Engine Generators
Located at: PMRF Barking Sands, Kauai (UTM: 419045m E, 2436085m N)
Date of Expiration: [Five years from DATE]**

The subject Covered Source Permit Renewal is issued in accordance with Hawaii Administrative Rules, Title 11, Chapter 60.1. The issuance of this permit is based on your application dated July 17, 2007. This covered source permit supersedes CSP No. 0110-01-C, issued on August 6, 2003.

The Covered Source Permit is issued subject to the conditions/requirements set forth in the following Attachments:

Attachment I:	Standard Conditions
Attachment II:	Special Conditions
Attachment II-INSIG	Special Conditions–Insignificant Activities
Attachment III:	Annual Fee Requirements
Attachment IV:	Annual Emissions Reporting Requirements

Captain Taylor Skadron
DATE
Page 2

The forms for submission are as follows:

Compliance Certification	
Annual Emissions Report Form:	Diesel Engine Generators
Monitoring Report Form:	Diesel Engine Generator Units 1-3
Monitoring Report Form:	Diesel Engine Generator Units 7-8
Monitoring Report Form:	Visible Emissions
Ringelmann Chart	

This permit: (a) shall not in any manner affect the title of the premises upon which the equipment is to be located; (b) does not release the permittee from any liability for any loss due to personal injury or property damage caused by, resulting from or arising out of the design, installation, maintenance, or operation of the equipment; and (c) in no manner implies or suggests that the State of Hawaii Department of Health, or its officers, agents, or employees, assumes any liability, directly or indirectly, for any loss due to personal injury or property damage caused by, resulting from or arising out of the design, installation, maintenance, or operation of the equipment.

Sincerely,

THOMAS E. ARIZUMI, P.E., CHIEF
Environmental Management Division

KK:nn
Enclosures

c: Rodney Yama, EHS - Kauai
CAB Monitoring Section

**ATTACHMENT I: STANDARD CONDITIONS
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

This permit is granted in accordance with the Hawaii Administrative Rules (HAR), Title 11, Chapter 60.1, Air Pollution Control, and is subject to the following standard conditions:

1. Unless specifically identified, the terms and conditions contained in this permit are consistent with the applicable requirement, including form, on which each term or condition is based.

(Auth.: HAR §11-60.1-90)
2. This permit, or a copy thereof, shall be maintained at or near the source and shall be made available for inspection upon request. The permit shall not be wilfully defaced, altered, forged, counterfeited, or falsified.

(Auth.: HAR §11-60.1-6; SIP §11-60-11)²
3. This permit is not transferable whether by operation of law or otherwise, from person to person, from place to place, or from one piece of equipment to another without the approval of the Department of Health, except as provided in HAR, Section 11-60.1-91.

(Auth.: HAR §11-60.1-7; SIP §11-60-9)²
4. A request for transfer from person to person shall be made on forms furnished by the Department of Health.

(Auth.: HAR §11-60.1-7)
5. In the event of any changes in control or ownership of the facilities to be constructed or modified, this permit shall be binding on all subsequent owners and operators. The permittee shall notify the succeeding owner and operator of the existence of this permit and its conditions by letter, copies of which will be forwarded to the Department of Health and the Regional Administrator for the U.S. Environmental Protection Agency (EPA).

(Auth.: HAR §11-60.1-5, §11-60.1-7, §11-60.1-94)
6. The facility covered by this permit shall be constructed and operated in accordance with the application, and any information submitted as part of the application, for the Covered Source Permit. There shall be no deviation unless additional or revised plans are submitted to and approved by the Department of Health, and the permit is amended to allow such deviation.

(Auth.: HAR §11-60.1-2, §11-60.1-4, §11-60.1-82, §11-60.1-84, §11-60.1-90)
7. This permit (a) does not release the permittee from compliance with other applicable statutes of the State of Hawaii, or with applicable local laws, regulations, or ordinances, and

(b) shall not constitute, nor be construed to be an approval of the design of the covered source.

(Auth.: HAR §11-60.1-5, §11-60.1-82)

8. The permittee shall comply with all the terms and conditions of this permit. Any permit noncompliance constitutes a violation of HAR, Chapter 11-60.1 and the Clean Air Act and is grounds for enforcement action; for permit termination, suspension, reopening, or amendment; or for denial of a permit renewal application.

(Auth.: HAR §11-60.1-3, §11-60.1-10, §11-60.1-19, §11-60.1-90)

9. If any term or condition of this permit becomes invalid as a result of a challenge to a portion of this permit, the other terms and conditions of this permit shall not be affected and shall remain valid.

(Auth.: HAR §11-60.1-90)

10. The permittee shall not use as a defense in an enforcement action that it would have been necessary to halt or reduce the permitted activity to maintain compliance with the terms and conditions of this permit.

(Auth.: HAR §11-60.1-90)

11. This permit may be terminated, suspended, reopened, or amended for cause pursuant to HAR, Sections 11-60.1-10 and 11-60.1-98, and Hawaii Revised Statutes (HRS), Chapter 342B-27, after affording the permittee an opportunity for a hearing in accordance with HRS, Chapter 91.

(Auth.: HAR §11-60.1-3, §11-60.1-10, §11-60.1-90, §11-60.1-98)

12. The filing of a request by the permittee for the termination, suspension, reopening, or amendment of this permit, or of a notification of planned changes or anticipated noncompliance does not stay any permit condition.

(Auth.: HAR §11-60.1-90)

13. This permit does not convey any property rights of any sort, or any exclusive privilege.

(Auth.: HAR §11-60.1-90)

14. The permittee shall notify the Department of Health in writing of the following dates:

- a. The **anticipated date of initial start-up** for each emission unit of a new source or significant modification not more than sixty (60) days or less than thirty (30) days prior to such date;

- b. The **actual date of construction commencement** within fifteen (15) days after such date; and
- c. The **actual date of start-up** within fifteen (15) days after such date.

(Auth.: HAR §11-60.1-90)

15. The permittee shall furnish, in a timely manner, any information or records requested in writing by the Department of Health to determine whether cause exists for terminating, suspending, reopening, or amending this permit, or to determine compliance with this permit. Upon request, the permittee shall also furnish to the Department of Health copies of records required to be kept by the permittee. For information claimed to be confidential, the Director of Health may require the permittee to furnish such records not only to the Department of Health but also directly to the U.S. EPA Administrator along with a claim of confidentiality.

(Auth.: HAR §11-60.1-14, §11-60.1-90)

16. The permittee shall notify the Department of Health in writing, of the **intent to shut down air pollution control equipment for necessary scheduled maintenance** at least twenty-four (24) hours prior to the planned shutdown. The submittal of this notice shall not be a defense to an enforcement action. The notice shall include the following:
- a. Identification of the specific equipment to be taken out of service, as well as its location and permit number;
 - b. The expected length of time that the air pollution control equipment will be out of service;
 - c. The nature and quantity of emissions of air pollutants likely to be emitted during the shutdown period;
 - d. Measures such as the use of off-shift labor and equipment that will be taken to minimize the length of the shutdown period; and
 - e. The reasons why it would be impossible or impractical to shut down the source operation during the maintenance period.

(Auth.: HAR §11-60.1-15; SIP §11-60-16)²

17. **Except for emergencies which result in noncompliance with any technology-based emission limitation in accordance with HAR, Section 11-60.1-16.5, in the event any emission unit, air pollution control equipment, or related equipment malfunctions or breaks down in such a manner as to cause the emission of air pollutants in violation of HAR, Chapter 11-60.1 or this permit**, the permittee shall immediately notify the Department of Health of the malfunction or breakdown, unless the protection of personnel or public health or safety demands immediate attention to the malfunction or breakdown and makes such notification infeasible. In the latter case, the notice shall be provided as soon as practicable. Within five (5) working days of this initial notification, the permittee shall also submit, in writing, the following information:

- a. Identification of each affected emission point and each emission limit exceeded;
- b. Magnitude of each excess emission;
- c. Time and duration of each excess emission;
- d. Identity of the process or control equipment causing each excess emission;
- e. Cause and nature of each excess emission;
- f. Description of the steps taken to remedy the situation, prevent a recurrence, limit the excessive emissions, and assure that the malfunction or breakdown does not interfere with the attainment and maintenance of the National Ambient Air Quality Standards and state ambient air quality standards;
- g. Documentation that the equipment or process was at all times maintained and operated in a manner consistent with good practice for minimizing emissions; and
- h. A statement that the excess emissions are not part of a recurring pattern indicative of inadequate design, operation, or maintenance.

The submittal of these notices shall not be a defense to an enforcement action.

(Auth.: HAR §11-60.1-16; SIP §11-60-16)²

18. A copy of applicable correspondence or records submitted to the Department of Health shall be provided to the U.S. EPA Administrator.

(Auth.: HAR §11-60.1-90)

19. The permittee may request confidential treatment of any records in accordance with HAR Section 11-60.1-14.

(Auth.: HAR §11-60.1-14, §11-60.1-90)

20. This permit shall become invalid with respect to the authorized construction if construction is not commenced as follows:

- a. Construction shall be commenced within eighteen (18) months after the permit takes effect, shall not be discontinued for a period of eighteen (18) months or more, and shall be completed within a reasonable time.
- b. For phased construction projects, each phase shall commence construction within eighteen (18) months of the projected and approved commencement dates in the permit. This provision shall be applicable only if the projected and approved commencement dates of each construction phase are defined in Attachment II, Special Conditions of this permit.

(Auth.: HAR §11-60.1-9, §11-60.1-90)

21. The Department of Health may extend the time periods specified in Standard Condition No. 20 upon a satisfactory showing that an extension is justified. Requests for an extension shall be submitted in writing to the Department of Health.

(Auth.: HAR §11-60.1-9, §11-60.1-90)

22. The permittee shall submit fees in accordance with HAR, Chapter 11-60.1, Subchapter 6.

(Auth.: HAR §11-60.1-90)

23. All certifications shall be in accordance with HAR, Section 11-60.1-4.

(Auth.: HAR §11-60.1-4, §11-60.1-90)

24. The permittee shall allow the Director of Health, the Regional Administrator for the U.S. EPA and/or an authorized representative, upon presentation of credentials or other documents required by law:

- a. To enter the premises where a source is located or emission-related activity is conducted, or where records must be kept under the conditions of this permit and inspect at reasonable times all facilities, equipment, including monitoring and air pollution control equipment, practices, operations, or records covered under the terms and conditions of this permit and request copies of records or copy records required by this permit; and
- b. To sample or monitor at reasonable times substances or parameters to assure compliance with this permit or applicable requirements of HAR, Chapter 11-60.1.

(Auth.: HAR §11-60.1-11, §11-60.1-90)

25. Within thirty (30) days of **permanent discontinuance of the construction, modification, relocation, or operation of the facility covered by this permit**, the discontinuance shall be reported in writing to the Department of Health by a responsible official of the source.

(Auth.: HAR §11-60.1-8; SIP §11-60-10)²

26. Each permit renewal application shall be submitted to the Department of Health no fewer than twelve (12) months and no more than eighteen (18) months prior to the permit expiration date. The Department of Health may allow a permit renewal application to be submitted no fewer than six (6) months prior to the permit expiration date, if the Department of Health determines that there is reasonable justification.

(Auth.: HAR §11-60.1-101, 40 CFR §70.5 (a)(1)(iii))¹

27. The terms and conditions included in this permit, including any provision designed to limit a source's potential to emit, are federally enforceable unless such terms, conditions, or requirements are specifically designated as not federally enforceable.

(Auth.: HAR §11-60.1-93)

28. The compliance plan and compliance certification submittal requirements shall be in accordance with HAR, Sections 11-60.1-85 and 11-60.1-86. As specified in HAR, Section 11-60.1-86, the compliance certification shall be submitted to the Department of Health and the U.S. EPA Regional Administrator once per year, or more frequently as set by any applicable requirement.

(Auth.: HAR §11-60.1-90)

29. **Any document (including reports) required to be submitted by this permit shall be certified as being true, accurate, and complete by a responsible official in accordance with HAR, Sections 11-60.1-1 and 11-60.1-4, and shall be mailed to the following address:**

**Clean Air Branch
Environmental Management Division
State of Hawaii Department of Health
P.O. Box 3378
Honolulu, HI 96801-3378**

Upon request, all correspondence to the State of Hawaii Department of Health associated with this Covered Source Permit shall have duplicate copies forwarded to:

**Chief
Permits Office, (Attention: Air-3)
Air Division
U.S. Environmental Protection Agency
Region 9
75 Hawthorne Street
San Francisco, CA 94105**

(Auth.: HAR §11-60.1-4, §11-60.1-90)

¹ The citations to the Code of Federal Regulations (CFR) identified under a particular condition, indicate that the permit condition complies with the specified provision(s) of the CFR. Due to the integration of the preconstruction and operating permit requirements, permit conditions may incorporate more stringent requirements than those set forth in the CFR.

² The citations to the State Implementation Plan (SIP) identified under a particular condition, indicate that the permit condition complies with the specified provision(s) of the SIP.

**ATTACHMENT II: SPECIAL CONDITIONS
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

In addition to the standard conditions of the Covered Source Permit, the following special conditions shall apply to the permitted facility:

Section A. Equipment Description

1. This permit encompasses the following equipment and associated appurtenances:

Unit/Stack No.	Description
1,2,3	320 kW Caterpillar diesel engine generators (DEG) (model no. 3412, serial nos. 81Z04661, 81Z04666, and 81Z04660, respectively)
7,8	600 kW Caterpillar DEG (model no. 3508B, serial nos. 2HW00119 and 2HW00120, respectively)

(Auth.: HAR §11-60.1-3)

2. The permittee shall permanently attach an identification tag or name plate on each DEG, which identifies the model no., serial no., and manufacturer. The identification tag or name plate shall be permanently attached to the DEG at a conspicuous location.

(Auth.: HAR §11-60.1-5)

Section B. Operational and Emission Limitations

1. Fuel Usage

- a. The combined maximum fuel consumption of the three (3) 320 kW DEG, unit nos. 1, 2 and 3, shall not exceed 208,000 gallons in any rolling twelve (12) month period.
- b. The combined maximum fuel consumption of the two (2) 600 kW DEG, unit nos. 7 and 8, shall not exceed 217,800 gallons in any rolling twelve (12) month period.

(Auth.: HAR §11-60.1-5, §11-60.1-38, §11-60.1-90)

2. Fuel Specifications

The DEG shall be fired only on diesel fuel no. 2 with a maximum sulfur content not to exceed 0.5 % by weight.

(Auth.: HAR §11-60.1-5, §11-60.1-38, §11-60.1-90)

3. Visible Emissions

Each DEG shall not exhibit visible emissions of twenty (20) percent opacity or greater for any six (6) minute averaging period, except as follows: during start-up, shut-down, or equipment breakdown, each DEG may exhibit visible emissions greater than twenty (20) but not exceeding sixty (60) percent opacity for a period aggregating not more than six (6) minutes in any sixty (60) minute period.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-32, §11-60.1-90, SIP §11 60-24)²

4. Alternate Operating Scenarios

- a. Terms and conditions for reasonably anticipated operating scenarios identified by the permittee in the covered source permit application and approved by the Department of Health are as follows:
 - i. The permittee may replace DEGs, with a temporary replacement unit if any repair work reasonably warrants the removal (i.e., equipment failure, engine overhaul, or any major equipment problems requiring maintenance for efficient operation) of a DEG from its site and the following provisions are adhered to:
 - A) Written notification identifying the reasons for the replacement from the site of operation is submitted to and approved by the Department of Health *prior* to the exchange;
 - B) The DEG is replaced with another unit with equal or less emissions;
 - C) The temporary replacement unit complies with all applicable conditions including all air pollution control equipment requirements, operating restrictions and emission limits;
 - D) The DEG shall be repaired and returned to service at the same location in a timely manner; and
 - E) Prior to the removal and return of any DEG, the permittee shall submit to the Department of Health written documentation on the removal and return dates; the manufacturer's specifications with calculation of emissions; and on the make, size, model and serial numbers for both the temporary replacement unit and installed unit.
 - b. The permittee shall, contemporaneously with making a change from one operating scenario to another, record in a log at the permitted facility the scenario under which it is operating and, if required by any applicable requirement or the director, submit written notification to the director.
 - c. The terms and conditions under each alternative operating scenarios shall meet all applicable requirements including conditions of this permit.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-90)

Section C. Monitoring and Recordkeeping Requirements

1. Fuel Monitoring and Recordkeeping

The permittee shall, at its own expense, operate and maintain non-resetting fuel meters for the permanent recording of the total fuel usage, in gallons, for each set of DEGs in order to monitor the combined fuel consumption as required below. The following information shall be recorded:

- a. Date of the meter readings;
- b. Beginning meter readings for each month;
- c. Total fuel consumption, in gallons, for each month;
- d. Combined fuel consumption, in gallons, for the three (3) 320 kW DEG on a monthly and rolling twelve (12) month basis; and
- e. Combined fuel consumption, in gallons, for the two (2) 600 kW DEG on a monthly and rolling twelve (12) month basis.

(Auth.: HAR §11-60.1-3, §11-60.1-11, §11-60.1-90)

2. Total Fuel Usage and Specification

Invoices of all fuel oil received for the DEG shall be maintained. At a minimum, fuel delivery receipts shall be maintained, showing the supplier, fuel type, sulfur content (percent by weight), date of delivery, and amount (in gallons) of fuel delivered to the facility for subsequent transfer to the DEG covered under this permit. The fuel sulfur content may be demonstrated by providing the supplier's fuel specification sheet for the type of fuel purchased and received.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-11, §11-60.1-90)

3. Inspection, Maintenance, and Repair Log

The permittee shall maintain records on inspections, maintenance, and any repair work conducted on the DEG. At a minimum, these records shall include: the date of the inspection; name and title of the inspector; a short description of the action and/or any such repair work; and a description of the part(s) inspected or repaired.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-90)

4. Visible Emissions (V.E.)

- a. Except in those months where V.E. observations are conducted by a certified reader for the annual V.E. observations, The permittee shall conduct **monthly** (*calendar month*) V.E. observations for each equipment subject to opacity limits in accordance with Method 9 or by use of a Ringelmann Chart as provided. For the monthly observation for

each equipment, two (2) consecutive six (6) minute observations shall be taken at fifteen (15) second intervals. If an annual test is performed Records shall be completed and maintained in accordance with the *Visible Emissions Form Requirements*.

- b. The permittee shall conduct **annually** (*calendar year*) V.E. observations for each equipment subject to opacity limits by a certified reader in accordance with Method 9. For the annual observation for each equipment, two (2) consecutive six (6) minute observations shall be taken at fifteen (15) second intervals. Records shall be completed and maintained in accordance with the *Visible Emissions Form Requirements*.
- c. Upon written request and justification by the permittee, the Department of Health may waive the requirement for a specific annual V.E. observation. The waiver request is to be submitted prior to the required annual V.E. observation and must include documentation justifying such action. Documentation should include, but is not limited to, the results of the prior V.E. observations indicating compliance by a wide margin, documentation of continuing compliance, and further that operations of the source have not changed since the previous annual V.E. observation.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-90)

5. Records

All records, including support information, shall be true, accurate, maintained for **at least five (5) years** following the date of the monitoring sample, measurement, test, report, or application. Support information includes all maintenance, inspection, and repair records, and copies of all reports required by this permit. These records shall be in a permanent form suitable for inspection and made available to the Department of Health or their representative upon request.

(Auth.: HAR §11-60.1-3, §11-60.1-11, §11-60.1-90)

Section D. Notification and Reporting Requirements

1. Notification and reporting pertaining to the following events shall be done in accordance with Attachment I, Standard Condition Nos. 17 and 25 respectively:
 - a. *Emissions of air pollutants in violation of HAR, Chapter 11-60.1 or this permit (excluding technology-based emission exceedances due to emergencies); and*
 - b. *Permanent discontinuance of construction, modification, relocation, or operation of the facility covered by this permit.*

(Auth.: HAR §11-60.1-8, §11-60.1-15, §11-60.1-16, §11-60.1-90; 40 CFR §60.48c(a); SIP §11-60-10, §11-60-16)^{1,2}

2. Deviations

The permittee shall report (in writing) **within five (5) working days** any deviations from the permit requirements, including those attributable to upset conditions, the probable cause of such deviations and any corrective actions or preventive measures taken. Corrective actions may include a requirement for additional stack testing, or more frequent monitoring, or the implementation of a corrective action plan.

(Auth.: HAR §11-60.1-3, §11-60.1-15, §11-60.1-16, §11-60.1-90)

3. Monitoring

The permittee shall submit, **semi-annually**, the attached *Monitoring Report Form: Diesel Engine Generator Units 1-3*, *Monitoring Report Form: Diesel Engine Generator Units 7-8*; and *Monitoring Report Form: Visible Emissions* to the Department of Health. The report for the DEG shall be submitted **within sixty (60) days** after the end of each semi-annual calendar period (January 1 to June 30 and July 1 to December 31), and shall be signed and dated by a responsible official.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-90)

4. Compliance Certification

During the permit term, the permittee shall submit at least **annually** to the Department of Health and U.S. EPA Region 9, a compliance certification pursuant to HAR, Subsection 11-60.1-86. The permittee shall indicate whether or not compliance is being met with each term or condition of this permit. The compliance certification shall include at a minimum the following information:

- a. The identification of each term or condition of the permit that is the basis of the certification;
- b. The compliance status;
- c. Whether compliance was continuous or intermittent;
- d. The methods used for determining the compliance status of the source currently and over the reporting period;
- e. Any additional information indicating the source's compliance status with any applicable enhanced monitoring and compliance certification including the requirements of Section 114(a)(3) of the Clean Air Act or any applicable monitoring and analysis provisions of Section 504(b) of the Clean Air Act; and
- f. Any additional information as required by the Department of Health including information to determine compliance.

*The compliance certification shall be submitted **within ninety (90) days** after the end of each calendar year, and shall be signed and dated by a responsible official.*

Upon written request of the permittee, the deadline for submitting the compliance certification may be extended, if the Department of Health determines that reasonable justification exists for the extension.

(Auth.: HAR §11-60.1-4, §11-60.1-86, §11-60.1-90)

5. Annual Emissions

As required by *Attachment IV: Annual Emissions Reporting Requirements* and in conjunction with the requirements of *Attachment III: Annual Fee Requirements*, the permittee shall report **annually** the total tons/yr emitted of each regulated air pollutant, including hazardous air pollutants. The reporting of annual emissions is due **within sixty (60) days following the end of each calendar year**. The completion and submittal of *Annual Emissions Report Form: Diesel Engine Generators*, shall be used in reporting fuel usage.

Upon the written request of the permittee, the deadline for reporting of annual emissions may be extended, if the Department of Health determines that reasonable justification exists for the extension.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-11, §11-60.1-90)

Section E. Agency Notification

Any document (including reports) required to be submitted by this permit shall be done in accordance with Attachment I, Standard Condition 29.

(Auth.: HAR §11-60.1-4, §11-60.1-90)

¹ The citation to the Code of Federal Regulations (CFR) identified under a particular condition, indicates that the permit condition complies with the specified provision(s) of the CFR. Due to the integration of the preconstruction and operating permit requirements, permit conditions may incorporate more stringent requirements than those set forth in the CFR.

² The citation to the State Implementation Plan (SIP) identified under a particular condition, indicates that the permit condition complies with the specified provision(s) of the SIP.

**ATTACHMENT II - INSIG
SPECIAL CONDITIONS - INSIGNIFICANT ACTIVITIES
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

In addition to the Standard Conditions of the Covered Source Permit, the following Special Conditions shall apply to the permitted facility:

Section A. Equipment Description

This attachment encompasses insignificant activities listed in HAR, §11-60.1-82(f) and (g) for which provisions of this permit and HAR, Subchapter 2, General Prohibitions, apply.

(Auth.: HAR §11-60.1-3)

Section B. Operational Limitations

1. The permittee shall take measures to operate applicable insignificant activities in accordance with the provisions of HAR, Subchapter 2 for visible emissions, fugitive dust, incineration, process industries, sulfur oxides from fuel combustion, storage of volatile organic compounds, volatile organic compound water separation, pump and compressor requirements, and waste gas disposal.

(Auth.: HAR §11-60.1-3, §11-60.1-82, §11-60.1-90)

2. The Department of Health may at any time require the permittee to further abate emissions if an inspection indicates poor or insufficient controls.

(Auth.: HAR §11-60.1-3, §11-60.1-5, §11-60.1-82, §11-60.1-90)

Section C. Monitoring and Recordkeeping Requirements

1. The Department of Health reserves the right to require monitoring, recordkeeping, or testing of any insignificant activity to determine compliance with the applicable requirements.

(Auth.: HAR §11-60.1-3, §11-60.1-90)

2. All records shall be maintained for at least five (5) years from the date of any required monitoring, recordkeeping, testing, or reporting. These records shall be true, accurate, and maintained in a permanent form suitable for inspection and made available to the Department of Health or its authorized representative upon request.

(Auth.: HAR §11-60.1-3, §11-60.1-11, §11-60.1-90)

Section D. Notification and Reporting

Compliance Certification

During the permit term, the permittee shall submit at least **annually** to the Department of Health and U.S. EPA Region 9, the attached *Compliance Certification Form* pursuant to HAR, Subsection 11-60.1-86. The permittee shall indicate whether or not compliance is being met with each term or condition of this permit. The compliance certification shall include, at a minimum, the following information:

1. The identification of each term or condition of the permit that is the basis of the certification;
2. The compliance status;
3. Whether compliance was continuous or intermittent;
4. The methods used for determining the compliance status of the source currently and over the reporting period;
5. Any additional information indicating the source's compliance status with any applicable enhanced monitoring and compliance certification including the requirements of Section 114(a)(3) of the Clean Air Act or any applicable monitoring and analysis provisions of Section 504(b) of the Clean Air Act; and
6. Any additional information as required by the Department of Health including information to determine compliance.

The compliance certification shall be submitted **within ninety (90) days** after the end of each calendar year, and shall be signed and dated by a responsible official.

Upon written request of the permittee, the deadline for submitting the compliance certification may be extended, if the Department of Health determines that reasonable justification exists for the extension.

In lieu of addressing each emission unit as specified in *Compliance Certification Form*, the permittee may address insignificant activities as a single unit provided compliance is met with all applicable requirements. If compliance is not totally attained, the permittee shall identify the specific insignificant activity and provide the details associated with the noncompliance.

(Auth.: HAR §11-60.1-4, §11-60.1-86, §11-60.1-90)

CSP No. 0110-01-C
Attachment II - INSIG
Page 3 of 3
Issuance Date:
Expiration Date:

PROPOSED

Section E. Agency Notification

Any document (including reports) required to be submitted by this Covered Source Permit shall be done in accordance with Attachment I, Standard Condition No. 28.

(Auth.: HAR §11-60.1-4, §11-60.1-90)

**ATTACHMENT III: ANNUAL FEE REQUIREMENTS
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

The following requirements for the submittal of annual fees are established pursuant to Hawaii Administrative Rules (HAR), Title 11, Chapter 60.1, Air Pollution Control. Should HAR, Chapter 60.1 be revised such that the following requirements are in conflict with the provisions of HAR, Chapter 60.1, the permittee shall comply with the provisions of HAR, Chapter 60.1.

1. Annual fees shall be paid in full:
 - a. **Within sixty (60) days** after the end of each calendar year; and
 - b. **Within thirty (30) days** after the permanent discontinuance of the covered source.
2. The annual fees shall be determined and submitted in accordance with Hawaii Administrative Rules, Chapter 11-60.1, Subchapter 6.
3. The annual emissions data for which the annual fees are based shall accompany the submittal of any annual fees and submitted on forms furnished by the State of Hawaii Department of Health.
4. The annual fees and the emission data shall be mailed to:

**Clean Air Branch
Environmental Management Division
State of Hawaii Department of Health
P.O. Box 3378
Honolulu, HI 96801-3378**

**ATTACHMENT IV: ANNUAL EMISSIONS REPORTING REQUIREMENTS
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

In accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, the permittee shall report to the Department of Health the nature and amounts of emissions.

1. Complete the attached ***Annual Emissions Report Form: Diesel Engine Generators.***
2. The **annual reporting period** shall be from January 1 to December 31 of each year. Annual reports shall be submitted to the Department of Health within **sixty (60) days** after the end of each calendar year. All reports shall be mailed to the following address:

**Clean Air Branch
Environmental Management Division
State of Hawaii Department of Health
P.O. Box 3378
Honolulu, HI 96801-3378**

3. The permittee shall retain the information submitted, including all emission calculations. These records shall be in a permanent form suitable for inspection, retained for a minimum of five (5) years, and made available to the State of Hawaii Department of Health upon request.
4. Any information submitted to the State of Hawaii Department of Health without a request for confidentiality shall be considered public record.
5. In accordance with HAR, Section 11-60.1-14, the permittee may request confidential treatment of specific information by submitting a written request to the Department of Health and clearly identifying the specific information that is to be accorded confidential treatment.

**COMPLIANCE CERTIFICATION FORM
COVERED SOURCE PERMIT 0110-01-C
PAGE 1 OF ____**

Issuance Date: _____

Expiration Date: _____

In accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, the permittee shall report to the Department of Health the following certification at least annually, or more frequently as requested by the Department.

(Make Copies of the Compliance Certification Form for Future Use)

For Period: _____ Date: _____

Company/Facility Name: _____

Responsible Official (Print): _____

Title: _____

Responsible Official (Signature): _____

I certify that I have knowledge of the facts herein set forth, that the same are true, accurate and complete to the best of my knowledge and belief, and that all information not identified by me as confidential in nature shall be treated by Department of Health as public record. I further state that I will assume responsibility for the construction, modification, or operation of the source in accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, and any permit issued thereof.

**COMPLIANCE CERTIFICATION FORM
COVERED SOURCE PERMIT 0110-01-C
(CONTINUED, PAGE 2 OF ___)**

Issuance Date:

Expiration Date:

The purpose of this form is to evaluate whether or not the facility was in compliance with the permit terms and conditions during the covered period. If there were any deviations to the permit terms and conditions during the covered period, the deviation(s) shall be certified as *intermittent compliance* for the particular permit term(s) or condition(s). Deviations include failure to monitor, record, report, or collect the minimum data required by the permit to show compliance. In the absence of any deviation, the particular permit term(s) or condition(s) may be certified as *continuous compliance*.

Instructions:

Please certify Sections A, B, and C below for continuous or intermittent compliance. Sections A and B are to be certified as a group of permit conditions. Section C shall be certified individually for each operational and emissions limit condition as listed in the Special Conditions section of the permit (list all applicable equipment for each condition). Any deviations shall also be listed individually and described in Section D. The facility may substitute its own generated form in verbatim for Sections C and D.

A. Attachment I, Standard Conditions

<u>Permit term/condition</u> All standard conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent
---	--	---

B. Special Conditions - Monitoring, Recordkeeping, Reporting, Testing, and INSIG

<u>Permit term/condition</u> All monitoring conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent
<u>Permit term/condition</u> All recordkeeping conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent
<u>Permit term/condition</u> All reporting conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent
<u>Permit term/condition</u> All testing conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent
<u>Permit term/condition</u> All INSIG conditions	<u>Equipment(s)</u> All Equipment(s) listed in the permit	<u>Compliance</u> Continuous Intermittent

**COMPLIANCE CERTIFICATION FORM
COVERED SOURCE PERMIT 0110-01-C
(CONTINUED, PAGE ____ OF ____)**

Issuance Date:

Expiration Date:

C. Special Conditions - Operational and Emissions Limitations

Each permit term/condition shall be identified in chronological order using attachment and section numbers (e.g., Attachment II, B.1, Attachment IIA, Special Condition No. B.1.f, etc.). Each equipment shall be identified using the description stated in Section A of the Special Conditions (e.g., unit no., model no., serial no., etc.). Check all methods (as required by permit) used to determine the compliance status of the respective permit term/condition.

<u>Permit term/condition</u>	<u>Equipment(s)</u>	<u>Method</u>	<u>Compliance</u>
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent
		monitoring recordkeeping reporting testing none of the above	Continuous Intermittent

(Make Additional Copies if Needed)

**COMPLIANCE CERTIFICATION FORM
COVERED SOURCE PERMIT 0110-01-C
(CONTINUED, PAGE ___ OF ___)**

Issuance Date:

Expiration Date:

D. Deviations

<u>Permit Term/ Condition</u>	<u>Equipment(s) / Brief Summary of Deviation</u>	<u>Deviation Period time (am/pm) & date (mo/day/yr)</u>	<u>Date of Written Deviation Report to DOH (mo/day/yr)</u>
		Beginning: Ending:	

(Make Additional Copies if Needed)

**ANNUAL EMISSIONS REPORT FORM
DIESEL ENGINE GENERATORS
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date: _____

Expiration Date: _____

In accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, the permittee shall report to the Department of Health the following information annually:

(Make copies for Future Use)

For Period: _____ Date: _____

Facility Name: _____

Equipment Location: _____

Equipment Description: _____

Equipment Capacity/Rating (specify units): _____
(Units such as Horsepower, kilowatt, tons/hour, etc.)

Serial/ID No.: _____

Type of Fuel: _____ Max % Sulfur by weight: _____

I certify that I have knowledge of the facts herein set forth, that the same are true, accurate and complete to the best of my knowledge and belief, and that all information not identified by me as confidential in nature shall be treated by Department of Health as public record.

Responsible Official (PRINT): _____

TITLE: _____

Responsible Official (Signature): _____

1. Annual fuel use by Diesel Engine Generators

Calendar Year	Fuel Use Units 1-3 (gal)	Fuel Use Units 7-8 (gal)

**MONITORING REPORT FORM
DIESEL ENGINE GENERATOR UNITS 1-3
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date: _____

Expiration Date: _____

In accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, the permittee shall report to the Department of Health the following information semi-annually:

(Make copies for Future Use)

For Period: _____ Date: _____

Facility Name: US Navy Region Hawaii, PMRF, Barking Sands

Equipment Location: PMRF, Barking Sands, Kauai

Equipment Description: Unit Nos. 1-3 - 320 kW Caterpillar DEGs

Equipment Capacity/Rating (specify units): 320 kW each
(Units such as Horsepower, kilowatt, tons/hour, etc.)

Serial/ID No.: _____

Type of Fuel: _____ Max % Sulfur by weight: _____

I certify that I have knowledge of the facts herein set forth, that the same are true, accurate and complete to the best of my knowledge and belief, and that all information not identified by me as confidential in nature shall be treated by Department of Health as public record.

Responsible Official (PRINT): _____

TITLE: _____

Responsible Official (Signature): _____

MONTH	UNIT 1 * TOTAL (GAL)	UNIT 2 * TOTAL (GAL)	UNIT 3 * TOTAL (GAL)	COMBINED UNITS 1-3 TOTAL (GAL)	ROLLING12-MONTH TOTAL (GAL)
January					
February					
March					
April					
May					
June					
July					
August					
September					
October					
November					
December					
TOTAL					

- Not applicable if individual fuel meters are non-existent.

PROPOSED

**MONITORING REPORT FORM
DIESEL ENGINE GENERATOR UNITS 7-8
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date: _____

Expiration Date: _____

In accordance with the Hawaii Administrative Rules, Title 11, Chapter 60.1, Air Pollution Control, the permittee shall report to the Department of Health the following information semi-annually:

(Make copies for Future Use)

For Period: _____ Date: _____

Facility Name: US Navy Region Hawaii, PMRF, Barking Sands

Equipment Location: PMRF, Barking Sands, Kauai

Equipment Description: Unit Nos. 7,8 - 600 kW Caterpillar DEGs

Equipment Capacity/Rating (specify units): 600 kW each
(Units such as Horsepower, kilowatt, tons/hour, etc.)

Serial/ID No.: _____

Type of Fuel: _____ Max % Sulfur by weight: _____

I certify that I have knowledge of the facts herein set forth, that the same are true, accurate and complete to the best of my knowledge and belief, and that all information not identified by me as confidential in nature shall be treated by Department of Health as public record.

Responsible Official (PRINT): _____

TITLE: _____

Responsible Official (Signature): _____

MONTH	UNIT 7 * TOTAL (GAL)	UNIT 8 * TOTAL (GAL)	COMBINED UNITS 7,8 TOTAL (GAL)	ROLLING 12-MONTH TOTAL (GAL)
January				
February				
March				
April				
May				
June				
July				
August				
September				
October				
November				
December				
TOTAL				

* Not applicable if individual fuel meters are non-existent.

**VISIBLE EMISSIONS FORM REQUIREMENTS
STATE OF HAWAII
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date:

Expiration Date:

The following Visible Emissions (V.E.) Form shall be completed **monthly** (*each calendar month*) for each equipment subject to opacity limits in accordance with Method 9 or by use of a Ringelmann Chart as provided. At least **annually** (*calendar year*), V.E. observations shall be conducted for each equipment subject to opacity limits by a certified reader in accordance with Method 9. The V.E. Form shall be completed as follows:

1. Visible emissions observations shall take place during the day only and shall be compared to the Ringelmann Chart provided. The opacity shall be noted in 5 percent increments (i.e., 25%).
2. Orient the sun within a 140 degree sector to your back. Provide a source layout sketch on the V.E. Form using the symbols as shown.
3. Stand at least three (3) stack heights, but not more than a quarter mile from the stack.
4. Two (2) consecutive six (6) minute observations shall be taken at fifteen (15) second intervals for each equipment.
5. The six (6) minute average opacity reading shall be calculated for each observation.
6. If possible, the observations shall be performed as follows:
 - a. Read from where the line of sight is at right angles to the wind direction.
 - b. The line of sight shall not include more than one (1) plume at a time.
 - c. Read at the point in the plume with the greatest opacity (without condensed water vapor), ideally while the plume is no wider than the stack diameter.
 - d. Read the plume at fifteen (15) second intervals only. Do not read continuously.
 - e. The equipment shall be operating at maximum permitted capacity.
7. If the equipment was shut-down for that period, briefly explain the reason for shut-down in the comment column.

The permittee shall retain the completed V.E. Forms for recordkeeping. These records shall be in a permanent form suitable for inspection, retained for a minimum of five (5) years, and made available to the Department of Health, or their representative upon request.

**VISIBLE EMISSIONS FORM
STATE OF HAWAII
COVERED SOURCE PERMIT NO. 0110-01-C**

Issuance Date: _____

Expiration Date: _____

(Make copies for Future Use For Each Equipment)

Permit No.: 0110-01-C

Company Name: US Navy Region Hawaii, PMRF,
Barking Sands

Equipment and Fuel: _____

Site Conditions:

Stack height above ground (ft): _____

Stack distance from observer (ft): _____

Emission color (black or white): _____

Sky conditions (% cloud cover): _____


Wind speed (mph): _____

Temperature (F): _____

Observer Name: _____

Certified? (Yes/No): _____

Observation Date and Start Time: _____

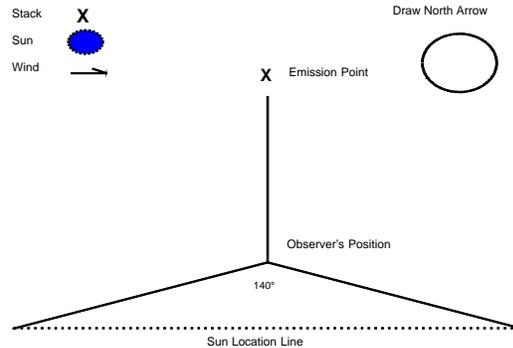

SECONDS	0	15	30	45	COMMENTS
MINUTES					
1					
2					
3					
4					
5					
6					
Six (6) Minute Average Opacity Reading (%):					

Observation Date and Start Time: _____

SECONDS	0	15	30	45	COMMENTS
MINUTES					
1					
2					
3					
4					
5					
6					
Six (6) Minute Average Opacity Reading (%):					