



MAR 13 2015

Mr. Raymond Rodriguez
California Resources Elk Hills, LLC
PO Box 1001
28560 Hwy 119
Tupman, CA 93276

**Re: Notice of Minor Title V Permit Modification
District Facility # S-382 and S-2234
Project # 1151117 and 1151088**

Dear Mr. Rodriguez:

Enclosed is the District's analysis of your application for minor Title V permit modification for the facility identified above. You proposed a Title V minor permit modification to incorporate recently issued S-382-678-8, S-2234-43-6, '46-9 and '47-9 (under projects 1150102 (S-382) and 1150101 (S-2234)) into the Title V operating permit. The ATCs authorized designating a heater and three emergency standby IC engines as compliant dormant emission units.

Enclosed is the engineering evaluation with the following attachments: proposed modified Title V permit, recently issued S-382-678-8, S-2234-43-6, '46-9 and '47-9, emission increases, application, and previous Title V permit. This project will be subject to a 45-day EPA commenting period prior to the District taking final action.

If you have any questions, please contact Mr. Leonard Scandura, Permit Services Manager, at (661) 392-5500.

Thank you for your cooperation in this matter.

Sincerely,



Arnaud Marjollet
Director of Permit Services

Enclosures

cc: Gerardo C. Rios, EPA (w/enclosure) via email

Seyed Sadredin
Executive Director/Air Pollution Control Officer

Northern Region
4800 Enterprise Way
Modesto, CA 95356-8718
Tel: (209) 557-6400 FAX: (209) 557-6475

Central Region (Main Office)
1990 E. Gettysburg Avenue
Fresno, CA 93726-0244
Tel: (559) 230-6000 FAX: (559) 230-6061
www.valleyair.org

Southern Region
34946 Flyover Court
Bakersfield, CA 93308-9725
Tel: 661-392-5500 FAX: 661-392-5585

www.healthyairliving.com

TITLE V APPLICATION REVIEW

Minor Modification

Project #s: 1151088 and 1151117

Engineer: David Torii

Reviewing Engineer: Allan Phillips *AP SUPER AQE*

Facility Number: S-2234 and S-382
Facility Name: California Resources Elk Hills, LLC
Mailing Address: PO Box 1001
28560 Hwy 119
Tupman, CA 93276
Contact Name: Raymond Rodriguez
Phone: 661-763-6159

MAR 11 2015

Responsible Official: Richard F. Garcia
Title: Environmental Team Leader

I. PROPOSAL

California Resources Elk Hills, LLC (CREH) is proposing a Title V minor permit modification to incorporate the recently issued ATCs S-382-678-8, S-2234-43-6, '46-9 and '47-9 into the Title V operating permit. The ATCs authorized designating a heater and three emergency standby IC engines as compliant dormant emission units.

II. FACILITY LOCATION

The engines are located at CREH's natural gas processing plant located at the 35R Gas Processing Stationary Source in NW Section 35, T30S, R23E. The heater is located in the NE/4 of section 18, T31S, R24E in CREH's Light Oil Western stationary source.

III. EQUIPMENT DESCRIPTION

Proposed Title V Operating Permit:

- S-382-678-9: 12 MMBTU/HR NATURAL GAS-FIRED HEATER NO. 3 WITH A CALLIDUS TECHNOLOGIES MODEL CSG-12W-SPL LOW NOX BURNER WITH FGR
- S-2234-43-7: 227 BHP CATERPILLAR DIESEL-FIRED EMERGENCY STANDBY IC ENGINE POWERING AN ELECTRICAL GENERATOR (P4)
- S-2234-46-10: 793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #13397)

- S-2234-46-10: 793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #13397)
- S-2234-47-10: 793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #14772)

IV. SCOPE OF EPA AND PUBLIC REVIEW

This change to a Title V permit is considered to be a minor modification and, as such, requires no public review.

V. APPLICABLE REQUIREMENTS

District Rule 2520, Federally Mandated Operating Permits (Adopted June 21, 2001)

VI. DESCRIPTION OF PROPOSED MODIFICATIONS

The Changes to the original Permits to Operate are as follows

Condition # on Proposed Permits Minor Modification PTOs	Condition is New, Revised, moved or Removed	Reason for Change from Current PTO
1-6	New	compliant dormant emission unit conditions

VII. COMPLIANCE

In accordance with Rule 2520, 3.20, these modifications:

1. Do not violate requirements of any applicable federally enforceable local or federal requirement;
2. Do not relax monitoring, reporting, or recordkeeping requirements in the permit and are not significant changes in existing monitoring permit terms or conditions;
3. Do not require or change a case-by-case determination of an emission limitation or other standard, or a source-specific determination for temporary sources of ambient impacts, or a visibility or increment analysis;
4. Do not seek to establish or change a permit term or condition for which there is no corresponding underlying applicable requirement and that the source has assumed to avoid an applicable requirement to which the source would otherwise be subject. Such terms and conditions include:
 - a. A federally enforceable emission cap assumed to avoid classification as a modification under any provisions of Title I of the Federal Clean Air Act; and

California Resource Production
1151088 (S-2234) and 1151117 (S-382)

- b. An alternative emissions limit approved pursuant to regulations promulgated under section 112(i)(5) of the Federal Clean Air Act;
and
5. Are not Title I modifications as defined in District Rule 2520 or modifications as defined in section 111 or 112 of the Federal Clean Air Act;
and
6. Do not seek to consolidate overlapping applicable requirements.

In accordance with Rule 2520, the application meets the procedural requirements of section 11.4 by including;

1. A description of the change, the emissions resulting from the change, and any new applicable requirements that will apply if the change occurs;
2. The source's suggested draft permit; and
3. Certification by a responsible official that the proposed modification meets the criteria for use of minor permit modification procedures and a request that such procedures be used.

ATTACHMENT A

Proposed Modified Title V Operating Permits
S-382-678-9, S-2234-43-7, '46-10 and '47-10

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-382-678-9

EXPIRATION DATE: 10/31/2016

SECTION: NE18 **TOWNSHIP:** 31S **RANGE:** 24E

EQUIPMENT DESCRIPTION:

12 MMBTU/HR NATURAL GAS-FIRED HEATER NO. 3 WITH A CALLIDUS TECHNOLOGIES MODEL CSG-12W-SPL
LOW NOX BURNER WITH FGR

PERMIT UNIT REQUIREMENTS

1. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
2. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
3. While dormant, normal source testing shall not be required. [District Rule 2080] Federally Enforceable Through Title V Permit
4. Upon recommencing operation of this unit, normal source testing shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Any source testing required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
7. {450} Particulate matter emissions shall not exceed 0.1 grain/dscf at operating conditions, nor 0.1 grain/dscf calculated to 12% CO₂, nor 10 lb/hr. [District Rule 4201 and District Rule 4301, 5.1 and 5.2.3] Federally Enforceable Through Title V Permit
8. The unit shall only be fired on PUC-regulated natural gas. [District Rule 2201] Federally Enforceable Through Title V Permit
9. A non-resettable, totalizing mass or volumetric fuel flow meter to measure the amount of natural gas combusted in the unit shall be installed, utilized and maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
10. Maximum annual heat input of the unit shall not exceed 30 billion Btu per calendar year. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
11. Emissions rates from the natural gas-fired unit shall not exceed any of the following limits: 30 ppmv NO_x @ 3% O₂ or 0.036 lb-NO_x/MMBtu, 0.00285 lb-SO_x/MMBtu, 0.0076 lb-PM₁₀/MMBtu, 100 ppmv CO @ 3% O₂ or 0.073 lb-CO/MMBtu, or 0.0055 lb-VOC/MMBtu. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

12. All emissions measurements shall be made with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. No determination of compliance shall be established within two hours after a continuous period in which fuel flow to the unit is shut off for 30 minutes or longer, or within 30 minutes after a re-ignition as defined in Section 3.0 of District Rule 4306. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
13. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted within 60 days of initial start-up. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
14. For emissions source testing, the arithmetic average of three 30-consecutive-minute test runs shall apply. If two of three runs are above an applicable limit the test cannot be used to demonstrate compliance with an applicable limit. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
15. The results of each source test shall be submitted to the District within 60 days thereafter. [District Rule 1081] Federally Enforceable Through Title V Permit
16. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted at least once every twelve (12) months. After demonstrating compliance on two (2) consecutive annual source tests, the unit shall be tested not less than once every thirty-six (36) months. If the result of the 36-month source test demonstrates that the unit does not meet the applicable emission limits, the source testing frequency shall revert to at least once every twelve (12) months. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
17. The source test plan shall identify which basis (ppmv or lb/MMBtu) will be used to demonstrate compliance. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
18. Source testing shall be conducted using the methods and procedures approved by the District. The District must be notified at least 30 days prior to any compliance source test, and a source test plan must be submitted for approval at least 15 days prior to testing. [District Rule 1081] Federally Enforceable Through Title V Permit
19. NO_x emissions for source test purposes shall be determined using EPA Method 7E or ARB Method 100 on a ppmv basis, or EPA Method 19 on a heat input basis. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
20. CO emissions for source test purposes shall be determined using EPA Method 10 or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
21. Stack gas oxygen (O₂) shall be determined using EPA Method 3 or 3A or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
22. The permittee shall monitor and record the stack concentration of NO_x, CO, and O₂ at least once every month (in which a source test is not performed) using a portable emission monitor that meets District specifications. Monitoring shall not be required if the unit is not in operation, i.e. the unit need not be started solely to perform monitoring. Monitoring shall be performed within 5 days of restarting the unit unless monitoring has been performed within the last month. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
23. If either the NO_x or CO concentrations corrected to 3% O₂, as measured by the portable analyzer, exceed the allowable emissions concentration, the permittee shall return the emissions to within the acceptable range as soon as possible, but no longer than 1 hour of operation after detection. If the portable analyzer readings continue to exceed the allowable emissions concentration after 1 hour of operation after detection, the permittee shall notify the District within the following 1 hour and conduct a certified source test within 60 days of the first exceedance. In lieu of conducting a source test, the permittee may stipulate a violation has occurred, subject to enforcement action. The permittee must then correct the violation, show compliance has been re-established, and resume monitoring procedures. If the deviations are the result of a qualifying breakdown condition pursuant to Rule 1100, the permittee may fully comply with Rule 1100 in lieu of the performing the notification and testing required by this condition. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

24. All alternate monitoring parameter emission readings shall be taken with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. The analyzer shall be calibrated, maintained, and operated in accordance with the manufacturer's specifications and recommendations or a protocol approved by the APCO. Emission readings taken shall be averaged over a 15 consecutive-minute period by either taking a cumulative 15 consecutive-minute sample reading or by taking at least five (5) readings, evenly spaced out over the 15 consecutive-minute period. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
25. The permittee shall maintain records of: (1) the date and time of NO_x, CO, and O₂ measurements, (2) the O₂ concentration in percent and the measured NO_x and CO concentrations corrected to 3% O₂, (3) make and model of exhaust gas analyzer, (4) exhaust gas analyzer calibration records, and (5) a description of any corrective action taken to maintain the emissions within the acceptable range. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
26. {2807} Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rule 405 (Madera), 408 and 409 (Kern), and 408 (all six remaining counties in the San Joaquin Valley); Rule 404 (Madera) 406 (Fresno), and 407 (all six remaining counties in the San Joaquin Valley); SJVUAPCD Rule 4801. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
27. {2808} Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 4201, 4301, 4305, and 4351. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
28. {2809} Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 1081, and County Rules 108 (Kings), 108.1 (Fresno, Merced, San Joaquin, Tulare, Kern, and Stanislaus), and 110 (Madera). [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
29. {2810} The requirements of 40 CFR 72.6(b) are not applicable because this is not an affected unit under the acid rain provisions. The requirements of 40 CFR 60.40c do not apply to this source because it is not used to produce electricity for sale. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
30. Records of monthly and annual heat input of the unit shall be maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
31. All records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070, 4305, and 4306] Federally Enforceable Through Title V Permit
32. Pursuant to Rule 4320, the operator shall pay an annual emission fee to the District for NO_x emissions from this unit for the previous calendar year. Payments are due by July 1 of each year. Payments shall continue annually until either the unit is permanently removed from service in the District or the operator demonstrates compliance with the applicable NO_x emission limit listed in Rule 4320. [District Rule 4320] Federally Enforceable Through Title V Permit
33. Permittee shall maintain records of annual heat input (MMBtu) for this unit on a calendar year basis. Such records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070 and Rule 4320] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-43-7

EXPIRATION DATE: 10/31/2016

EQUIPMENT DESCRIPTION:

227 BHP CATERPILLAR DIESEL-FIRED EMERGENCY STANDBY IC ENGINE POWERING AN ELECTRICAL GENERATOR (P4)

PERMIT UNIT REQUIREMENTS

1. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
2. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
3. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
4. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
7. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
8. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
9. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
10. {2414} Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
11. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
12. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
13. Only CARB certified diesel fuel containing not more than 0.0015% sulfur by weight is to be used. [District Rules 2520, 9.3.2 and 4801 and 17 CCR 93115] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

14. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 20 hours per calendar year. [District Rule 4702, 4.2, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
15. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
16. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
17. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
18. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rule 4702, 6.2.3 and 17 CCR 93115] Federally Enforceable Through Title V Permit
19. The permittee shall maintain monthly records of the type of fuel purchased, the amount of fuel purchased, date when the fuel was purchased, signature of the permittee who received the fuel, and signature of the fuel supplier indicating that the fuel was delivered. [District Rules 2520, 9.4.2 and 4702, and 17 CCR 93115] Federally Enforceable Through Title V Permit
20. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201; Rule 404 (Madera), 406 (Fresno), and 407 (Kings, Merced, San Joaquin, Tulare, Kern, and Stanislaus). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
21. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rules 402 (Madera) and 404 (Fresno, Merced, Kern, Kings, San Joaquin, Stanislaus, Tulare). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
22. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
23. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
24. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. The engine's air filter shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

27. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

DRAFT

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-46-10

SECTION: 35NE TOWNSHIP: 30S RANGE: 23E

EQUIPMENT DESCRIPTION:

793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #13397)

EXPIRATION DATE: 10/31/2016

DRAFT

PERMIT UNIT REQUIREMENTS

1. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
2. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
3. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
4. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
7. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
8. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
9. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
10. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
11. {2414} Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
12. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
13. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
14. {842} If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

15. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
16. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
17. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
18. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
19. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
20. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
21. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit
22. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
23. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
24. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
27. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

29. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

DRAFT

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-47-10

EXPIRATION DATE: 10/31/2016

SECTION: 35NE **TOWNSHIP:** 30S **RANGE:** 23E

EQUIPMENT DESCRIPTION:

793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #14772)

PERMIT UNIT REQUIREMENTS

1. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
2. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
3. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
4. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
7. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
8. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
9. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
10. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
11. {2414} Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
12. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
13. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
14. {842} If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE
These terms and conditions are part of the Facility-wide Permit to Operate.

15. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
16. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
17. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
18. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
19. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
20. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
21. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit
22. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
23. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
24. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
27. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

29. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

DRAFT

ATTACHMENT B

Current Permit

S-382-678-7, S-2234-43-4, '46-7 and '47-7

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-382-678-7

EXPIRATION DATE: 10/31/2016

SECTION: NE18 **TOWNSHIP:** 31S **RANGE:** 24E

EQUIPMENT DESCRIPTION:

12 MMBTU/HR NATURAL GAS-FIRED HEATER NO. 3 WITH A CALLIDUS TECHNOLOGIES MODEL CSG-12W-SPL
LOW NOX BURNER WITH FGR

PERMIT UNIT REQUIREMENTS

1. Particulate matter emissions shall not exceed 0.1 grain/dscf at operating conditions, nor 0.1 grain/dscf calculated to 12% CO₂, nor 10 lb/hr. [District Rule 4201 and District Rule 4301, 5.1 and 5.2.3] Federally Enforceable Through Title V Permit
2. The unit shall only be fired on PUC-regulated natural gas. [District Rule 2201] Federally Enforceable Through Title V Permit
3. A non-resettable, totalizing mass or volumetric fuel flow meter to measure the amount of natural gas combusted in the unit shall be installed, utilized and maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
4. Maximum annual heat input of the unit shall not exceed 30 billion Btu per calendar year. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
5. Emissions rates from the natural gas-fired unit shall not exceed any of the following limits: 30 ppmv NO_x @ 3% O₂ or 0.036 lb-NO_x/MMBtu, 0.00285 lb-SO_x/MMBtu, 0.0076 lb-PM₁₀/MMBtu, 100 ppmv CO @ 3% O₂ or 0.073 lb-CO/MMBtu, or 0.0055 lb-VOC/MMBtu. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
6. All emissions measurements shall be made with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. No determination of compliance shall be established within two hours after a continuous period in which fuel flow to the unit is shut off for 30 minutes or longer, or within 30 minutes after a re-ignition as defined in Section 3.0 of District Rule 4306. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
7. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted within 60 days of initial start-up. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
8. For emissions source testing, the arithmetic average of three 30-consecutive-minute test runs shall apply. If two of three runs are above an applicable limit the test cannot be used to demonstrate compliance with an applicable limit. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
9. The results of each source test shall be submitted to the District within 60 days thereafter. [District Rule 1081] Federally Enforceable Through Title V Permit
10. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted at least once every twelve (12) months. After demonstrating compliance on two (2) consecutive annual source tests, the unit shall be tested not less than once every thirty-six (36) months. If the result of the 36-month source test demonstrates that the unit does not meet the applicable emission limits, the source testing frequency shall revert to at least once every twelve (12) months. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

11. The source test plan shall identify which basis (ppmv or lb/MMBtu) will be used to demonstrate compliance. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
12. Source testing shall be conducted using the methods and procedures approved by the District. The District must be notified at least 30 days prior to any compliance source test, and a source test plan must be submitted for approval at least 15 days prior to testing. [District Rule 1081] Federally Enforceable Through Title V Permit
13. NOx emissions for source test purposes shall be determined using EPA Method 7E or ARB Method 100 on a ppmv basis, or EPA Method 19 on a heat input basis. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
14. CO emissions for source test purposes shall be determined using EPA Method 10 or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
15. Stack gas oxygen (O2) shall be determined using EPA Method 3 or 3A or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
16. The permittee shall monitor and record the stack concentration of NOx, CO, and O2 at least once every month (in which a source test is not performed) using a portable emission monitor that meets District specifications. Monitoring shall not be required if the unit is not in operation, i.e. the unit need not be started solely to perform monitoring. Monitoring shall be performed within 5 days of restarting the unit unless monitoring has been performed within the last month. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
17. If either the NOx or CO concentrations corrected to 3% O2, as measured by the portable analyzer, exceed the allowable emissions concentration, the permittee shall return the emissions to within the acceptable range as soon as possible, but no longer than 1 hour of operation after detection. If the portable analyzer readings continue to exceed the allowable emissions concentration after 1 hour of operation after detection, the permittee shall notify the District within the following 1 hour and conduct a certified source test within 60 days of the first exceedance. In lieu of conducting a source test, the permittee may stipulate a violation has occurred, subject to enforcement action. The permittee must then correct the violation, show compliance has been re-established, and resume monitoring procedures. If the deviations are the result of a qualifying breakdown condition pursuant to Rule 1100, the permittee may fully comply with Rule 1100 in lieu of the performing the notification and testing required by this condition. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
18. All alternate monitoring parameter emission readings shall be taken with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. The analyzer shall be calibrated, maintained, and operated in accordance with the manufacturer's specifications and recommendations or a protocol approved by the APCO. Emission readings taken shall be averaged over a 15 consecutive-minute period by either taking a cumulative 15 consecutive-minute sample reading or by taking at least five (5) readings, evenly spaced out over the 15 consecutive-minute period. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
19. The permittee shall maintain records of: (1) the date and time of NOx, CO, and O2 measurements, (2) the O2 concentration in percent and the measured NOx and CO concentrations corrected to 3% O2, (3) make and model of exhaust gas analyzer, (4) exhaust gas analyzer calibration records, and (5) a description of any corrective action taken to maintain the emissions within the acceptable range. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
20. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rule 405 (Madera), 408 and 409 (Kern), and 408 (all six remaining counties in the San Joaquin Valley); Rule 404 (Madera) 406 (Fresno), and 407 (all six remaining counties in the San Joaquin Valley); SJVUAPCD Rule 4801. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
21. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 4201, 4301, 4305, and 4351. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

22. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 1081, and County Rules 108 (Kings), 108.1 (Fresno, Merced, San Joaquin, Tulare, Kern, and Stanislaus), and 110 (Madera). [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
23. The requirements of 40 CFR 72.6(b) are not applicable because this is not an affected unit under the acid rain provisions. The requirements of 40 CFR 60.40c do not apply to this source because it is not used to produce electricity for sale. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
24. Records of monthly and annual heat input of the unit shall be maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
25. All records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070, 4305, and 4306] Federally Enforceable Through Title V Permit
26. Pursuant to Rule 4320, beginning in 2010 the operator shall pay an annual emission fee to the District for NOx emissions from this unit for the previous calendar year. Payments are due by July 1 of each year. Payments shall continue annually until either the unit is permanently removed from service in the District or the operator demonstrates compliance with the applicable NOx emission limit listed in Rule 4320. [District Rule 4320] ✎
27. Permittee shall maintain records of annual heat input (MMBtu) for this unit on a calendar year basis. Such records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070 and Rule 4320] ✎

These terms and conditions are part of the Facility-wide Permit to Operate.

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-43-4

EXPIRATION DATE: 10/31/2016

EQUIPMENT DESCRIPTION:

227 BHP CATERPILLAR DIESEL-FIRED EMERGENCY STANDBY IC ENGINE POWERING AN ELECTRICAL GENERATOR (P4)

PERMIT UNIT REQUIREMENTS

1. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
2. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
3. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
4. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
5. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
6. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
7. Only CARB certified diesel fuel containing not more than 0.0015% sulfur by weight is to be used. [District Rules 2520, 9.3.2 and 4801 and 17 CCR 93115] Federally Enforceable Through Title V Permit
8. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 20 hours per calendar year. [District Rule 4702, 4.2, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
9. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
10. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
11. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

12. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rule 4702, 6.2.3 and 17 CCR 93115] Federally Enforceable Through Title V Permit
13. The permittee shall maintain monthly records of the type of fuel purchased, the amount of fuel purchased, date when the fuel was purchased, signature of the permittee who received the fuel, and signature of the fuel supplier indicating that the fuel was delivered. [District Rules 2520, 9.4.2 and 4702, and 17 CCR 93115] Federally Enforceable Through Title V Permit
14. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201; Rule 404 (Madera), 406 (Fresno), and 407 (Kings, Merced, San Joaquin, Tulare, Kern, and Stanislaus). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
15. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rules 402 (Madera) and 404 (Fresno, Merced, Kern, Kings, San Joaquin, Stanislaus, Tulare). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
16. On and after May 3, 2013, the permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
17. On and after May 3, 2013, the engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
18. On and after May 3, 2013, the engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
19. On and after May 3, 2013, the engine's air filter shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
20. On and after May 3, 2013, the engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
21. On and after May 3, 2013, the permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
22. On and after May 3, 2013, the permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-46-7

EXPIRATION DATE: 10/31/2016

SECTION: 35NE **TOWNSHIP:** 30S **RANGE:** 23E

EQUIPMENT DESCRIPTION:

793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #13397)

PERMIT UNIT REQUIREMENTS

1. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
2. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
3. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
4. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
5. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
6. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
7. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
8. If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
9. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
10. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
11. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
12. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

13. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
14. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
15. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit
16. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
17. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
18. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
19. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
20. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
21. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
22. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
23. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

San Joaquin Valley Air Pollution Control District

PERMIT UNIT: S-2234-47-7

EXPIRATION DATE: 10/31/2016

SECTION: 35NE **TOWNSHIP:** 30S **RANGE:** 23E

EQUIPMENT DESCRIPTION:

793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #14772)

PERMIT UNIT REQUIREMENTS

1. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
2. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
3. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
4. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
5. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
6. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
7. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
8. If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
9. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
10. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
11. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
12. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit

PERMIT UNIT REQUIREMENTS CONTINUE ON NEXT PAGE

These terms and conditions are part of the Facility-wide Permit to Operate.

13. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
14. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
15. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit
16. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
17. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
18. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
19. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
20. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
21. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
22. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
23. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

These terms and conditions are part of the Facility-wide Permit to Operate.

ATTACHMENT C

Authority to Construct Permit

S-382-678-8, S-2234-43-6, '46-9 and '47-9



AUTHORITY TO CONSTRUCT

PERMIT NO: S-382-678-8

ISSUANCE DATE: 02/19/2015

LEGAL OWNER OR OPERATOR: CALIFORNIA RESOURCES ELK HILLS, LLC

MAILING ADDRESS: PO BOX 1001
TUPMAN, CA 93276

LOCATION: LIGHT OIL WESTERN STATIONARY SOURCE
KERN COUNTY, CA

SECTION: NE18 **TOWNSHIP:** 31S **RANGE:** 24E

EQUIPMENT DESCRIPTION:

MODIFICATION OF 12 MMBTU/HR NATURAL GAS-FIRED HEATER NO. 3 WITH A CALLIDUS TECHNOLOGIES MODEL CSG-12W-SPL LOW NOX BURNER WITH FGR: DESIGNATE AS A COMPLIANT DORMANT EMISSIONS UNIT

CONDITIONS

1. The facility shall submit an application to modify the Title V permit in accordance with the timeframes and procedures of District Rule 2520. [District Rule 2520] Federally Enforceable Through Title V Permit
2. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
3. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
4. While dormant, normal source testing shall not be required. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Upon recommencing operation of this unit, normal source testing shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Any source testing required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

YOU MUST NOTIFY THE DISTRICT COMPLIANCE DIVISION AT (661) 392-5500 WHEN CONSTRUCTION IS COMPLETED AND PRIOR TO OPERATING THE EQUIPMENT OR MODIFICATIONS AUTHORIZED BY THIS AUTHORITY TO CONSTRUCT. This is NOT a PERMIT TO OPERATE. Approval or denial of a PERMIT TO OPERATE will be made after an inspection to verify that the equipment has been constructed in accordance with the approved plans, specifications and conditions of this Authority to Construct, and to determine if the equipment can be operated in compliance with all Rules and Regulations of the San Joaquin Valley Unified Air Pollution Control District. Unless construction has commenced pursuant to Rule 2050, this Authority to Construct shall expire and application shall be cancelled two years from the date of issuance. The applicant is responsible for complying with all laws, ordinances and regulations of all other governmental agencies which may pertain to the above equipment.

Seyed Sadredin, Executive Director / APCO

Arnaud Marjollet, Director of Permit Services

S-382-678-8 : Mar 9 2015 1:22PM -- TORID : Joint Inspection NOT Required

7. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
8. Particulate matter emissions shall not exceed 0.1 grain/dscf at operating conditions, nor 0.1 grain/dscf calculated to 12% CO₂, nor 10 lb/hr. [District Rule 4201 and District Rule 4301, 5.1 and 5.2.3] Federally Enforceable Through Title V Permit
9. The unit shall only be fired on PUC-regulated natural gas. [District Rule 2201] Federally Enforceable Through Title V Permit
10. A non-resettable, totalizing mass or volumetric fuel flow meter to measure the amount of natural gas combusted in the unit shall be installed, utilized and maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
11. Maximum annual heat input of the unit shall not exceed 30 billion Btu per calendar year. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
12. Emissions rates from the natural gas-fired unit shall not exceed any of the following limits: 30 ppmv NO_x @ 3% O₂ or 0.036 lb-NO_x/MMBtu, 0.00285 lb-SO_x/MMBtu, 0.0076 lb-PM₁₀/MMBtu, 100 ppmv CO @ 3% O₂ or 0.073 lb-CO/MMBtu, or 0.0055 lb-VOC/MMBtu. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
13. All emissions measurements shall be made with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. No determination of compliance shall be established within two hours after a continuous period in which fuel flow to the unit is shut off for 30 minutes or longer, or within 30 minutes after a re-ignition as defined in Section 3.0 of District Rule 4306. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
14. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted within 60 days of initial start-up. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
15. For emissions source testing, the arithmetic average of three 30-consecutive-minute test runs shall apply. If two of three runs are above an applicable limit the test cannot be used to demonstrate compliance with an applicable limit. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
16. The results of each source test shall be submitted to the District within 60 days thereafter. [District Rule 1081] Federally Enforceable Through Title V Permit
17. Source testing to measure NO_x and CO emissions from this unit while fired on natural gas shall be conducted at least once every twelve (12) months. After demonstrating compliance on two (2) consecutive annual source tests, the unit shall be tested not less than once every thirty-six (36) months. If the result of the 36-month source test demonstrates that the unit does not meet the applicable emission limits, the source testing frequency shall revert to at least once every twelve (12) months. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
18. The source test plan shall identify which basis (ppmv or lb/MMBtu) will be used to demonstrate compliance. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
19. Source testing shall be conducted using the methods and procedures approved by the District. The District must be notified at least 30 days prior to any compliance source test, and a source test plan must be submitted for approval at least 15 days prior to testing. [District Rule 1081] Federally Enforceable Through Title V Permit
20. NO_x emissions for source test purposes shall be determined using EPA Method 7E or ARB Method 100 on a ppmv basis, or EPA Method 19 on a heat input basis. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
21. CO emissions for source test purposes shall be determined using EPA Method 10 or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit
22. Stack gas oxygen (O₂) shall be determined using EPA Method 3 or 3A or ARB Method 100. [District Rules 4305 and 4306] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

23. The permittee shall monitor and record the stack concentration of NO_x, CO, and O₂ at least once every month (in which a source test is not performed) using a portable emission monitor that meets District specifications. Monitoring shall not be required if the unit is not in operation, i.e. the unit need not be started solely to perform monitoring. Monitoring shall be performed within 5 days of restarting the unit unless monitoring has been performed within the last month. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
24. If either the NO_x or CO concentrations corrected to 3% O₂, as measured by the portable analyzer, exceed the allowable emissions concentration, the permittee shall return the emissions to within the acceptable range as soon as possible, but no longer than 1 hour of operation after detection. If the portable analyzer readings continue to exceed the allowable emissions concentration after 1 hour of operation after detection, the permittee shall notify the District within the following 1 hour and conduct a certified source test within 60 days of the first exceedance. In lieu of conducting a source test, the permittee may stipulate a violation has occurred, subject to enforcement action. The permittee must then correct the violation, show compliance has been re-established, and resume monitoring procedures. If the deviations are the result of a qualifying breakdown condition pursuant to Rule 1100, the permittee may fully comply with Rule 1100 in lieu of the performing the notification and testing required by this condition. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
25. All alternate monitoring parameter emission readings shall be taken with the unit operating either at conditions representative of normal operations or conditions specified in the Permit to Operate. The analyzer shall be calibrated, maintained, and operated in accordance with the manufacturer's specifications and recommendations or a protocol approved by the APCO. Emission readings taken shall be averaged over a 15 consecutive-minute period by either taking a cumulative 15 consecutive-minute sample reading or by taking at least five (5) readings, evenly spaced out over the 15 consecutive-minute period. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
26. The permittee shall maintain records of: (1) the date and time of NO_x, CO, and O₂ measurements, (2) the O₂ concentration in percent and the measured NO_x and CO concentrations corrected to 3% O₂, (3) make and model of exhaust gas analyzer, (4) exhaust gas analyzer calibration records, and (5) a description of any corrective action taken to maintain the emissions within the acceptable range. [District Rules 4305, 5.4.2 and 4306, 5.4.2] Federally Enforceable Through Title V Permit
27. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rule 405 (Madera), 408 and 409 (Kern), and 408 (all six remaining counties in the San Joaquin Valley); Rule 404 (Madera) 406 (Fresno), and 407 (all six remaining counties in the San Joaquin Valley); SJVUAPCD Rule 4801. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
28. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 4201, 4301, 4305, and 4351. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
29. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following requirements: SJVUAPCD Rule 1081, and County Rules 108 (Kings), 108.1 (Fresno, Merced, San Joaquin, Tulare, Kern, and Stanislaus), and 110 (Madera). [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
30. The requirements of 40 CFR 72.6(b) are not applicable because this is not an affected unit under the acid rain provisions. The requirements of 40 CFR 60.40c do not apply to this source because it is not used to produce electricity for sale. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
31. Records of monthly and annual heat input of the unit shall be maintained. [District Rules 2201, 4305, and 4306] Federally Enforceable Through Title V Permit
32. All records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070, 4305, and 4306] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

33. Pursuant to Rule 4320, beginning in 2010 the operator shall pay an annual emission fee to the District for NOx emissions from this unit for the previous calendar year. Payments are due by July 1 of each year. Payments shall continue annually until either the unit is permanently removed from service in the District or the operator demonstrates compliance with the applicable NOx emission limit listed in Rule 4320. [District Rule 4320] Federally Enforceable Through Title V Permit
34. Permittee shall maintain records of annual heat input (MMBtu) for this unit on a calendar year basis. Such records shall be maintained and retained on-site for a minimum of five (5) years, and shall be made available for District inspection upon request. [District Rules 1070 and Rule 4320] Federally Enforceable Through Title V Permit



AUTHORITY TO CONSTRUCT

PERMIT NO: S-2234-43-6

ISSUANCE DATE: 02/19/2015

LEGAL OWNER OR OPERATOR: CALIFORNIA RESOURCES ELK HILLS, LLC

MAILING ADDRESS: PO BOX 1001
TUPMAN, CA 93276

LOCATION: GAS PLANT
SECTION SE-35, T-30S, R-23E
TUPMAN, CA

EQUIPMENT DESCRIPTION:

MODIFICATION OF 227 BHP CATERPILLAR DIESEL-FIRED EMERGENCY STANDBY IC ENGINE POWERING AN ELECTRICAL GENERATOR (P4): DESIGNATE AS A COMPLIANT DORMANT EMISSIONS UNIT

CONDITIONS

1. The facility shall submit an application to modify the Title V permit in accordance with the timeframes and procedures of District Rule 2520. [District Rule 2520] Federally Enforceable Through Title V Permit
2. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
3. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
4. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit
7. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

YOU MUST NOTIFY THE DISTRICT COMPLIANCE DIVISION AT (661) 392-5500 WHEN CONSTRUCTION IS COMPLETED AND PRIOR TO OPERATING THE EQUIPMENT OR MODIFICATIONS AUTHORIZED BY THIS AUTHORITY TO CONSTRUCT. This is NOT a PERMIT TO OPERATE. Approval or denial of a PERMIT TO OPERATE will be made after an inspection to verify that the equipment has been constructed in accordance with the approved plans, specifications and conditions of this Authority to Construct, and to determine if the equipment can be operated in compliance with all Rules and Regulations of the San Joaquin Valley Unified Air Pollution Control District. Unless construction has commenced pursuant to Rule 2050, this Authority to Construct shall expire and application shall be cancelled two years from the date of issuance. The applicant is responsible for complying with all laws, ordinances and regulations of all other governmental agencies which may pertain to the above equipment.

Seyed Sadredin, Executive Director / APCO

8. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
9. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
10. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
11. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
12. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
13. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
14. Only CARB certified diesel fuel containing not more than 0.0015% sulfur by weight is to be used. [District Rules 2520, 9.3.2 and 4801 and 17 CCR 93115] Federally Enforceable Through Title V Permit
15. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 20 hours per calendar year. [District Rule 4702, 4.2, 17 CCR 93115, and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
16. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
17. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
18. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
19. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rule 4702, 6.2.3 and 17 CCR 93115] Federally Enforceable Through Title V Permit
20. The permittee shall maintain monthly records of the type of fuel purchased, the amount of fuel purchased, date when the fuel was purchased, signature of the permittee who received the fuel, and signature of the fuel supplier indicating that the fuel was delivered. [District Rules 2520, 9.4.2 and 4702, and 17 CCR 93115] Federally Enforceable Through Title V Permit
21. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201; Rule 404 (Madera), 406 (Fresno), and 407 (Kings, Merced, San Joaquin, Tulare, Kern, and Stanislaus). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
22. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following subsumed requirements: Rules 402 (Madera) and 404 (Fresno, Merced, Kern, Kings, San Joaquin, Stanislaus, Tulare). A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

23. On and after May 3, 2013, the permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
24. On and after May 3, 2013, the engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. On and after May 3, 2013, the engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. On and after May 3, 2013, the engine's air filter shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
27. On and after May 3, 2013, the engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. On and after May 3, 2013, the permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
29. On and after May 3, 2013, the permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit



AUTHORITY TO CONSTRUCT

PERMIT NO: S-2234-46-9

ISSUANCE DATE: 02/19/2015

LEGAL OWNER OR OPERATOR: CALIFORNIA RESOURCES ELK HILLS, LLC

MAILING ADDRESS: PO BOX 1001
TUPMAN, CA 93276

LOCATION: GAS PLANT
SECTION SE-35, T-30S, R-23E
TUPMAN, CA

SECTION: 35NE **TOWNSHIP:** 30S **RANGE:** 23E

EQUIPMENT DESCRIPTION:

MODIFICATION OF 793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #13397): DESIGNATE AS A COMPLIANT DORMANT EMISSIONS UNIT

CONDITIONS

1. The facility shall submit an application to modify the Title V permit in accordance with the timeframes and procedures of District Rule 2520. [District Rule 2520] Federally Enforceable Through Title V Permit
2. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
3. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
4. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

YOU MUST NOTIFY THE DISTRICT COMPLIANCE DIVISION AT (661) 392-5500 WHEN CONSTRUCTION IS COMPLETED AND PRIOR TO OPERATING THE EQUIPMENT OR MODIFICATIONS AUTHORIZED BY THIS AUTHORITY TO CONSTRUCT. This is NOT a PERMIT TO OPERATE. Approval or denial of a PERMIT TO OPERATE will be made after an inspection to verify that the equipment has been constructed in accordance with the approved plans, specifications and conditions of this Authority to Construct, and to determine if the equipment can be operated in compliance with all Rules and Regulations of the San Joaquin Valley Unified Air Pollution Control District. Unless construction has commenced pursuant to Rule 2050, this Authority to Construct shall expire and application shall be cancelled two years from the date of issuance. The applicant is responsible for complying with all laws, ordinances and regulations of all other governmental agencies which may pertain to the above equipment.

Seyed Sadredin, Executive Director / APCO

7. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
8. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
9. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
10. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
11. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
12. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
13. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
14. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
15. If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
16. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
17. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
18. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
19. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
20. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
21. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
22. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

23. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
24. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
27. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
29. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
30. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit



AUTHORITY TO CONSTRUCT

PERMIT NO: S-2234-47-9

ISSUANCE DATE: 02/19/2015

LEGAL OWNER OR OPERATOR: CALIFORNIA RESOURCES ELK HILLS, LLC

MAILING ADDRESS: PO BOX 1001
TUPMAN, CA 93276

LOCATION: GAS PLANT
SECTION SE-35, T-30S, R-23E
TUPMAN, CA

SECTION: 35NE **TOWNSHIP:** 30S **RANGE:** 23E

EQUIPMENT DESCRIPTION:

MODIFICATION OF 793 BHP WAUKESHA NATURAL GAS-FIRED STANDBY IC ENGINE (UNX #14772): DESIGNATE AS A COMPLIANT DORMANT EMISSIONS UNIT

CONDITIONS

1. The facility shall submit an application to modify the Title V permit in accordance with the timeframes and procedures of District Rule 2520. [District Rule 2520] Federally Enforceable Through Title V Permit
2. While dormant, the fuel line shall be physically disconnected from the unit. [District Rule 2080] Federally Enforceable Through Title V Permit
3. Permittee shall submit written notification to the District upon designating the unit as dormant or active. [District Rule 2080] Federally Enforceable Through Title V Permit
4. While dormant, the operator shall not be required to perform normal maintenance and inspections. [District Rule 2080] Federally Enforceable Through Title V Permit
5. Upon recommencing operation of this unit, normal maintenance and inspections shall resume. [District Rule 2080] Federally Enforceable Through Title V Permit
6. Any maintenance and inspections required by this permit shall be performed within 60 days of recommencing operation of this unit, regardless of whether the unit remains active or is again designated as dormant. [District Rule 2080] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

YOU MUST NOTIFY THE DISTRICT COMPLIANCE DIVISION AT (661) 392-5500 WHEN CONSTRUCTION IS COMPLETED AND PRIOR TO OPERATING THE EQUIPMENT OR MODIFICATIONS AUTHORIZED BY THIS AUTHORITY TO CONSTRUCT. This is NOT a PERMIT TO OPERATE. Approval or denial of a PERMIT TO OPERATE will be made after an inspection to verify that the equipment has been constructed in accordance with the approved plans, specifications and conditions of this Authority to Construct, and to determine if the equipment can be operated in compliance with all Rules and Regulations of the San Joaquin Valley Unified Air Pollution Control District. Unless construction has commenced pursuant to Rule 2050, this Authority to Construct shall expire and application shall be cancelled two years from the date of issuance. The applicant is responsible for complying with all laws, ordinances and regulations of all other governmental agencies which may pertain to the above equipment.

Seyed Sadredin, Executive Director / APCO

Arnaud Marjollet, Director of Permit Services

S-2234-47-9 - Mar 9 2015 1:23PM -- TORID - Joint Inspection NOT Required

7. Records of all dates and times that this unit is designated as dormant or active, and copies of all corresponding notices to the District, shall be maintained, retained for a period of at least five years, and made available for District inspection upon request. [District Rule 1070] Federally Enforceable Through Title V Permit
8. Approved locations for this equipment: any site within facility S-2234. [District Rule 2201] Federally Enforceable Through Title V Permit
9. The operator shall notify the District in writing at least two weeks prior to starting operations at a new location. [District Rule 2201] Federally Enforceable Through Title V Permit
10. This engine shall be operated and maintained in proper operating condition as recommended by the engine manufacturer or emissions control system supplier. [District Rule 4702] Federally Enforceable Through Title V Permit
11. Sulfur compound emissions shall not exceed 0.2% by volume, 2000 ppmv, on a dry basis averaged over 15 consecutive minutes. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
12. Particulate matter emissions shall not exceed 0.1 grains/dscf in concentration. [District Rule 4201, 3.1] Federally Enforceable Through Title V Permit
13. This engine shall be equipped with an operational non-resettable elapsed time meter or other APCO approved alternative. [District Rule 4702 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
14. Unit shall be fired only on PUC quality natural gas with a sulfur content of less than or equal to 0.017% by weight. [District Rule 4801 and Kern County Rule 407] Federally Enforceable Through Title V Permit
15. If the IC engine is fired on PUC-regulated natural gas, then maintain on file copies of all natural gas bills. [District Rule 2520, 9.4.2] Federally Enforceable Through Title V Permit
16. If the engine is not fired on PUC-regulated natural gas, then the sulfur content (as hydrogen sulfide) of the natural gas being fired in the IC engine shall be calculated using a continuous monitor averaged over a daily basis in accordance with SCAQMD Rule 431.1 Attachment A (as amended June 12, 1998). [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
17. If the engine is not fired on PUC-regulated natural gas, the sulfur content (as hydrogen sulfide) of each fuel source shall be tested. [District Rule 2520, 9.3.2] Federally Enforceable Through Title V Permit
18. This engine shall be operated only for testing and maintenance of the engine, required regulatory purposes, and during emergency situations. Operation of the engine for maintenance, testing, and required regulatory purposes shall not exceed 100 hours per calendar year. [District Rules 2201 and 4702, 3.15 and 4.2, 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
19. An emergency situation is an unscheduled electrical power outage caused by sudden and reasonably unforeseen natural disasters or sudden and reasonably unforeseen events beyond the control of the permittee. [District Rule 4702] Federally Enforceable Through Title V Permit
20. This engine shall not be used to produce power for the electrical distribution system, as part of a voluntary utility demand reduction program, or for an interruptible power contract. [District Rule 4702] Federally Enforceable Through Title V Permit
21. During periods of operation for maintenance, testing, and required regulatory purposes, the permittee shall monitor the operational characteristics of the engine as recommended by the manufacturer or emission control system supplier (for example: check engine fluid levels, battery, cables and connections; change engine oil and filters; replace engine coolant; and/or other operational characteristics as recommended by the manufacturer or supplier). [District Rule 4702] Federally Enforceable Through Title V Permit
22. The permittee shall maintain monthly records of emergency and non-emergency operation. Records shall include the number of hours of emergency operation, the date and number of hours of all testing and maintenance operations, the purpose of the operation (for example: load testing, weekly testing, rolling blackout, general area power outage, etc.), and records of operational characteristics monitoring. For units with automated testing systems, the operator may, as an alternative to keeping records of actual operation for testing purposes, maintain a readily accessible written record of the automated testing schedule. [District Rules 1070 and 4702, 6.2.3] Federally Enforceable Through Title V Permit

CONDITIONS CONTINUE ON NEXT PAGE

23. Compliance with permit conditions in the Title V permit shall be deemed compliance with the following applicable requirements of SJVUAPCD Rule 4201 and Kern County Rule 407. A permit shield is granted from these requirements. [District Rule 2520, 13.2] Federally Enforceable Through Title V Permit
24. The permittee must minimize the engine's time spent at idle during startup and minimize the engine's startup time to a period needed for appropriate and safe loading of the engine, not to exceed 30 minutes. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
25. The engine shall be in full compliance with 40 CFR Part 63, Subpart ZZZZ (National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines). [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
26. The engine's oil and filter shall be changed every 500 hours of operation or every 12 months, whichever comes first. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
27. The engine's spark plugs shall be inspected every 1,000 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
28. The engine's hoses and belts shall be inspected every 500 hours of operation or every 12 months, whichever comes first, and replaced as necessary. [40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
29. The permittee shall maintain monthly records of all performance tests, opacity and visible emissions observations and required maintenance performed on the air pollution control and monitoring equipment. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit
30. The permittee shall maintain monthly records of the occurrence and duration of each malfunction of operation (i.e., process equipment) or the air pollution control and monitoring equipment. The permittee shall also maintain monthly records of action taken during periods of malfunction to minimize emissions in accordance with §63.6605(b), including corrective actions to restore malfunctioning process and air pollution control and monitoring equipment to its normal or usual manner of operation. [District Rule 1070 and 40 CFR 63, ZZZZ] Federally Enforceable Through Title V Permit

ATTACHMENT C

Emissions Increases

SSIPE (lb/yr)				
NOx	VOC	CO	SOx	PM10
0	0	0	0	0

ATTACHMENT E

Application


San Joaquin Valley Air Pollution Control District

www.valleyair.org

RECEIVED
MAR 03 2015
SJVAPCD
Southern Region

Permit Application For:

[] ADMINISTRATIVE AMENDMENT [X] MINOR MODIFICATION [] SIGNIFICANT MODIFICATION

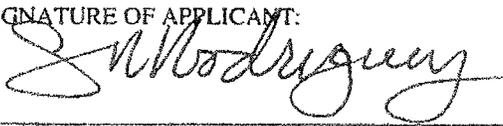1. PERMIT TO BE ISSUED TO: <p style="text-align: center;">California Resources Elk Hills, LLC</p>	
2. MAILING ADDRESS: STREET/P.O. BOX: <u>PO Box 1001, 28590 Hwy 119</u> CITY: <u>Tupman</u> STATE: <u>CA</u> 9-DIGIT ZIP CODE: <u>93276</u>	
3. LOCATION WHERE THE EQUIPMENT WILL BE OPERATED: STREET <u>Elk Hills</u> CITY <u>Tupman</u> ¼ SECTION _____ TOWNSHIP _____ RANGE _____	INSTALLATION DATE:
4. GENERAL NATURE OF BUSINESS: <u>Oil and Natural Gas Production</u>	
5. DESCRIPTION OF EQUIPMENT OR MODIFICATION FOR WHICH APPLICATION IS MADE (include Permit #'s if known, and use additional sheets if necessary) <u>Incorporate the following ATC into S-2234 and S-382 Title V Permit:</u> S-2234-43-6 S-2234-46-9 S-2234-47-9 S-382-678-8	
6. TYPE OR PRINT NAME OF APPLICANT: <p style="text-align: center;">Raymond Rodriguez</p>	TITLE OF APPLICANT: <p style="text-align: center;">Air Team Lead</p>
7. SIGNATURE OF APPLICANT: 	DATE: <u>3/3/2015</u> PHONE: (661) 763-6159 FAX: (661) 763-6681 EMAIL: <u>Raymond.rodriguez@crc.com</u>

For APCD Use Only:

NO \$

DATE STAMP	FILING FEE RECEIVED: \$ _____ CHECK#: _____
	DATE PAID: _____
	PROJECT NO: <u>S-1151088</u> FACILITY ID: <u>S-2234</u>

S-1151117

S-382



CALIFORNIA RESOURCES ELK HILLS, LLC
P. O. Box 1001, 28590 Highway 119, Turman, California 93276
Telephone 661-763-6000

RECEIVED
MAR 03 2015
SJVAPCD
Southern Region

Submitted via email

March 3, 2015

Mr. Leonard Scandura
Permit Services Manager
San Joaquin Valley APCD – Southern Region
34946 Flyover Court
Bakersfield, CA 93308

Subject: Minor Modification to California Resources of Elk Hills, LLC.
Title V Permit (S-2234 and S-382)

Dear Mr. Scandura:

California Resources Elk Hills, LLC. (CREH) requests District approval for an Minor Modification of facility S-2234 and S-382 Title V Permits to include the below listed Authorities to Construct:

S-2234-43-6

S-2234-46-9

S-2234-47-9

S-382-678-8

Please bill CREH for all administrative costs associated with this request. If you have any questions or require addition information concerning this issue, please contact me directly at (661) 763-5961 or on my cellular phone at (661) 204-9236.

Sincerely,

Raymond Rodriguez
Air Team Lead
California Resources Elk Hills, LLC

cc: Richard F. Garcia, CREH

**San Joaquin Valley
Unified Air Pollution Control District**

RECEIVED

MAR 03 2015

SJVAPCD
Southern Region

TITLE V MODIFICATION - COMPLIANCE CERTIFICATION FORM

I. TYPE OF PERMIT ACTION (Check appropriate box)


- [] SIGNIFICANT PERMIT MODIFICATION [] ADMINISTRATIVE AMENDMENT
 [X] MINOR PERMIT MODIFICATION

COMPANY NAME: California Resources Elk Hills, LLC	FACILITY ID: S -382/2234
1. Type of Organization: [x] Corporation [] Sole Ownership [] Government [] Partnership [] Utility	
2. Owner's Name: California Resources Elk Hills, LLC	
3. Agent to the Owner: California Resources Elk Hills, LLC	

II. COMPLIANCE CERTIFICATION (Read each statement carefully and initial all circles for confirmation):

-  Based on information and belief formed after reasonable inquiry, the equipment identified in this application will continue to comply with the applicable federal requirement(s).
-  Based on information and belief formed after reasonable inquiry, the equipment identified in this application will comply with applicable federal requirement(s) that will become effective during the permit term, on a timely basis.
-  Corrected information will be provided to the District when I become aware that incorrect or incomplete information has been submitted.
-  Based on information and belief formed after reasonable inquiry, information and statements in the submitted application package, including all accompanying reports, and required certifications are true accurate and complete.

I declare, under penalty of perjury under the laws of the state of California, that the forgoing is correct and true:

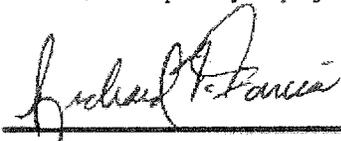

 Signature of Responsible Official

3-3-15

 Date

Richard F. Garcia

 Name of Responsible Official (please print)

Environmental Team Leader

 Title of Responsible Official (please print)