

## **Excerpt 1**

Final Permit [(cover letter and permit conditions (Enclosure 1)], dated June 11, 2013("Final Permit"), AR V.2



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY  
REGION 2  
290 BROADWAY  
NEW YORK, NY 10007-1866

**JUN 11 2013**

Mr. Patrick Mahoney  
President  
Energy Answers, LLC  
79 North Pearl Street  
Albany, New York 12207

Re: Final Permit - Prevention of Significant Deterioration (PSD) of Air Quality  
Energy Answers Arecibo Puerto Rico Renewable Energy Project

Dear Mr. Mahoney:

On February 8, 2011, the U.S. Environmental Protection Agency (EPA) received a PSD application from Energy Answers Arecibo, LLC's (Energy Answers) for the construction of a new resource recovery facility at the former site of the Global Fibers Paper Mill in Barrio Cambalache, Arecibo, Puerto Rico. The Energy Answers proposed project, known as the Arecibo Puerto Rico Renewable Energy Project, involves the construction and installation of the following equipment for the renewable energy project: two 1,050 tons per day (each) refuse-derived fuel municipal waste combustors, a 77 megawatt steam turbine electrical-generator, and ancillary equipment.

On May 9, 2012, EPA issued a preliminary determination, subject to public review, to approve the PSD permit. The public comment period for the proposed permit was originally scheduled to last approximately 30 days. However, the public comment period was subsequently extended, and it was officially closed on August 31, 2012. During the public comment period, EPA received written comments ("comment letters"), and oral comments given at the six public hearings sessions held between June 25, 2012 and August 27, 2012.

EPA carefully reviewed all the comments, prepared responses to those comments, and made changes to the draft permit, as appropriate. This final permit also includes EPA initiated revisions to the dioxin and furans emissions performance tests frequency and to the hydrogen chloride emissions monitoring requirements. The changes and responses can be found in the enclosed Responses to Comments document. The final permit conditions are found in Enclosure I. A project description and a summary of the pollutants subject to PSD requirements and the control technologies proposed to be used by Energy Answers are provided in Enclosure II.

EPA concludes that this final permit meets all applicable requirements of the PSD regulations at 40 CFR § 52.21 and the Clean Air Act (the Act). Accordingly, I hereby approve Energy Answers' PSD permit. This letter and its enclosures represent EPA's final permit decision. The final PSD permit and the Responses to Comments document are also available on the EPA Region 2 website at <http://www.epa.gov/region02/air/permit/energyanswers>. Other key documents relevant to the application and the preliminary determination to approve the PSD permit are available on the Interamerican University-Arecibo Campus website at <http://www.arecibo.inter.edu/reserva/epa/epa.htm#>.

The complete Administrative Record for this PSD permit decision, including comment letters, transcripts from the public hearings, and additional supporting information related to EPA's final permit decision can be viewed in person, by visiting either one of the addresses below, between 9:00 AM and 4:00 PM, Monday through Friday, excluding holidays. Please call the EPA offices at the numbers listed below to arrange a visit at least 24 hours in advance. Electronic copies of the Response to Comments and Final Permit are also available upon request in writing or by e-mail, to either one of the addresses below:

U.S. Environmental Protection Agency  
Region 2  
Permitting Section  
Air Programs Branch  
290 Broadway  
New York, New York 10007  
Attention: Mr. Steven C. Riva  
(212) 637-4074  
riva.steven@epa.gov

U.S. Environmental Protection Agency  
Region 2  
Caribbean Environmental Protection Division  
City View Plaza III-Suite 7000  
#48 Rd. 165 km 1.2  
Guaynabo, PR 00968-8069  
Attention: Mr. Jose Font  
(787) 977-5870  
font.jose@epa.gov

This final permit decision may be challenged under the Consolidated Permit Regulations, codified at 40 CFR Part 124, that apply to EPA's processing of this permit decision. Specifically, 40 CFR § 124.19 establishes the following procedures for administrative appeal of the final PSD permit decision. Any person who filed comments on the draft permit or participated in the public hearings may petition the Environmental Appeals Board (EAB) in Washington, D.C. to review any condition of the final permit. In addition, any person who failed to file comments or participate in the public hearing on the draft permit, may petition for review only to the extent of the changes from the draft permit to the final permit.

Any petition for review under this part must be made within thirty (30) days of the service of notice of the final permit decision. The petition for review shall include a statement of the reason (s) for requesting the review, including a demonstration that any issues being raised were raised during the public comment period to the extent required by the regulations at 40 CFR Part 124 and a showing that the conditions in question are based on (1) a finding of fact or conclusion of law which is erroneous, or (2) an exercise of discretion or an important policy consideration which the EAB should, in its discretion, review. Please see 40 CFR § 124.19 and visit <http://www.epa.gov/eab/> for more information on the required contents of the petition and procedures for appeal of a PSD permit decision to the Environmental Appeal Board.

All persons petitioning for administrative review must file the original and one (1) copy of the petition with EAB at the following address:

For Regular Mail:  
Clerk of the Board  
U.S. Environmental Protection Agency  
Environmental Appeals Board  
1200 Pennsylvania Avenue, NW  
Mail Code 1103M  
Washington, DC 20460-0001

For Hand-Carrier and Federal Express Mail:

Clerk of the Board  
U.S. Environmental Protection Agency  
Environmental Appeals Board  
1201 Constitution Avenue, NW  
U.S. EPA East Building, Room 3334  
Washington, DC 20004  
Phone number: (202) 233-0122

Any petition for review filed with the EAB must also be served on EPA Region 2 at the following address pursuant to the filing and service requirements at 40 CFR § 124.19(i) (as amended January 25, 2013):


John Filippelli, Director  
Clean Air and Sustainability Division  
U.S. EPA Region 2  
290 Broadway  
New York, New York 10007

For purposes of judicial review under the Act, final Agency action does not occur until after administrative review procedures are exhausted and EPA Region 2 issues a final permit decision. Notice of the Agency's final action with respect to this permit will be published in the Federal Register. Judicial review of this final action is available by filing a petition for review in the United States Court of Appeals for the appropriate circuit within sixty (60) days of the date of the Federal Register notice. Only those persons who petitioned EPA under the administrative procedures of 40 CFR Part 124 may petition for review in the Court of Appeals. Under Section 307(b) of the Act, a final Agency action shall not be subject to judicial review in civil or criminal proceedings for enforcement.

Since comments requesting changes to the draft permit were received and changes were made to the draft permit, this final permit will become effective thirty (30) days after the service of notice, unless review is requested under 40 CFR §124.19. If a petition for review of the final Agency action is filed, the permit will not become effective until after the Environmental Appeals Board renders a decision on the petition.

If you have any questions regarding this letter, please call Mr. Steven C. Riva, Chief, Permitting Section, Air Programs Branch, at (212) 637-4074.

Sincerely,

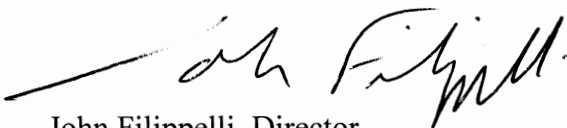

John Filippelli, Director  
Clean Air and Sustainability Division

Enclosure I: Final PSD Permit - Permit Conditions  
Enclosure II: Final PSD Permit - General Project Description  
Responses to Comments

cc: Luis Sierra, Puerto Rico Environmental Quality Board  
Jose Font, EPA Region 2, Caribbean Environmental Protection Division

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### Table of Contents

<b>I.</b>	<b>Permit Expiration</b>	4
<b>II.</b>	<b>Notification of Commencement of Construction and Startup</b>	4
<b>III</b>	<b>Plant Operations</b>	4
<b>IV.</b>	<b>Right to Entry</b>	4
<b>V.</b>	<b>Transfer of Ownership</b>	5
<b>VI.</b>	<b>Emission Units List and Annual Facility Emission Limits</b>	6
	A. Emission Units List	6
	B. Annual Facility Emission Limits	7
<b>VII.</b>	<b>Operating Requirements/Work Practices, and Stack Parameters</b>	8
	A. Municipal Waste Combustors Units	8
	B. Ash Handling System	13
	C. Storage Silos	14
	D. Emergency Equipment	14
	E. Storage Tanks	16
	F. Cooling Tower System	17
	G. Fugitive Particulate Emission Sources	19
	H. Stack Parameters	21
<b>VIII.</b>	<b>Fuel Requirements</b>	21
	A. Municipal Waste Combustors Units	21
	B. Emergency Equipment	27
	C. Sulfur Content of Ultra Low Sulfur Distillate Fuel Oil No.2 and Propane	27

## ENCLOSURE I

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**Table of Contents (continued)**

<b>IX.</b>	<b>Air Pollution Control Equipment</b>	28
	A. Municipal Waste Combustors Units	28
	B. Ash Handling System and Storage Silos	29
	C. Cooling Tower System	29
	D. Monitoring Requirements for the Air Pollution Control Equipment	29
<b>X.</b>	<b>Air Pollutants Emissions, Opacity, and Visible Emissions Limitations</b>	31
	A. Municipal Waste Combustors Units	31
	B. Ash Handling System and Storage Silos	36
	C. Emergency Equipment	37
	D. Storage Tanks	38
	E. Cooling Tower System	38
	F. Fugitive Particulate Emission Sources	38
	G. Opacity	39
	H. Visible Emissions	39
<b>XI.</b>	<b>Performance Test Requirements</b>	40
	A. Initial and Subsequent Performance Tests	40
	B. Test Methods	43
<b>XII.</b>	<b>Continuous Emission Monitoring/Continuous Opacity Monitoring</b>	45

**ENCLOSURE I****ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT****Final Permit****Table of Contents (continued)**

<b>XIII.</b>	<b>Other Monitoring Requirements</b>	46
	A. Determination of Actual CO <sub>2</sub> e Emissions - Municipal Waste Combustors Units and Emergency Equipment	46
	B. Storage Tanks	48
	C. Cooling Tower System	49
	D. Fugitive Particulate Emission Sources	49
	E. Heat Input Rate and Refuse-Derived Fuel Consumption Rate “12-month rolling average” limit.	50
	F. Heat rate and lb CO <sub>2</sub> e/lb of steam “30-day rolling average” limits.	51
<b>XIV.</b>	<b>Recordkeeping Requirements</b>	51
<b>XV.</b>	<b>Reporting Requirements</b>	53
<b>XVI.</b>	<b>Other Applicable Requirements</b>	56



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### **I. Permit Expiration**

This PSD Permit shall become invalid if construction:

- A. has not commenced (as defined in 40 CFR Part 52.21(b) (9)) within 18 months of the effective date of this permit;
- B. is discontinued for a period of 18 months or more; or
- C. is not completed within a reasonable time.

#### **II. Notification of Commencement of Construction and Startup**

The Regional Administrator (RA) of the United States Environmental Protection Agency (EPA), Region 2 Office shall be notified in writing of the anticipated date of initial startup (as defined in 40 CFR Part 60.2) of each facility of the source not more than sixty (60) days nor less than thirty (30) days prior to such date. The RA shall be notified in writing of the actual date of both the commencement of construction and startup within fifteen (15) days after such date

#### **III. Plant Operations**

All equipment, facilities, and systems installed or used to achieve compliance with the terms and conditions of this PSD Permit, shall at all times be maintained in good working order, and be operated as efficiently as possible to minimize air pollutant emissions. Energy Answers Arecibo, LLC (the Permittee) shall demonstrate initial and continuous compliance with the operating, emission and other limits according to the performance testing and compliance assurance and all other requirements of this permit.

#### **IV. Right to Entry**

Pursuant to Section 114 of the Clean Air Act (Act), 42 U.S.C. §7414, the EPA Administrator and/or his/her authorized representatives have the right to enter and inspect for all purposes authorized under Section 114 of the Act. The Permittee acknowledges that the Regional Administrator and/or his/her authorized representatives, upon the presentation of credentials shall be permitted:

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

- A. to enter at any time upon the premises where the source is located or in which any records are required to be kept under the terms and conditions of this PSD Permit;
  - B. at reasonable times to access and to copy any records required to be kept under the terms and conditions of this PSD Permit;
  - C. to inspect any equipment, operation, or method required in this PSD Permit;  
and
  - D. to sample emissions from the source relevant to this permit
- V. **Transfer of Ownership**

In the event of any changes in control or ownership of facilities to be constructed, this PSD Permit shall be binding on all subsequent owners and operators. The Permittee shall notify the succeeding owner and operator of the existence of this PSD Permit and its conditions by letter, a copy of which shall be forwarded to the RA.

**ENCLOSURE I****ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT****Final Permit****VI. Emission Units List and Annual Facility Emission Limits****A. Emission Units List**

The table below summarizes the emission units that are subject to this permit; all emission units, except for the Gen and Fire, are assumed to operate 8,760 hours per year.

<b>Emission Unit Id. No.</b>	<b>Description</b>
<b>Municipal Waste Combustors Units</b>	
Boiler 1 and Boiler 2	Two identical municipal waste combustor units
<b>Ash Handling System</b>	
Trans 1	Bottom Ash Handling and Conveying System
Trans 2	Bottom Ash Storage and Conveying System
Ash	Bottom Ash Processing Activities
Silo 4	Fly Ash Conveying, Storage Silo, Conditioning, and Loading System
<b>Storage Silos</b>	
Silo 1	Carbon Handling System and Storage Silo
Silo 2	Lime Handling System and Storage Silo
<b>Emergency Equipment</b>	
Gen	Emergency Diesel Generator
Fire	Emergency Diesel Fire Pump
<b>Storage Tanks</b>	
Tank 1	Ammonia Storage Tank
Tank 2 through Tank 4	Distillate Fuel Oil No.2 Storage Tanks
<b>Cooling Towers</b>	
Cool 1 through Cool 4	"Four - Cell" Cooling Tower
<b>Fugitive Particulate Emission Sources*</b>	

\* There is no Emission Unit Id. No. assigned to fugitive particulate emission sources.

## ENCLOSURE I

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**B. Annual Facility Emission Limits**

The table below summarizes the annual facility emission limits for the air pollutants that are subject to this PSD permit:

Pollutant	Annual Emissions (tons per year)
Nitrogen Oxides (NO <sub>x</sub> )	352
Carbon Monoxide (CO)	357
Ozone* (as Volatile organic compounds or VOC)	52.4
Sulfur Dioxide (SO <sub>2</sub> )	260
Municipal waste combustor acid gases (measured as SO <sub>2</sub> and Hydrogen Chloride or HCL)	
SO <sub>2</sub>	260
Hydrogen Chloride	124
Particulate matter (PM)	51.7
PM <sub>10</sub>	104
PM <sub>2.5</sub>	90
Municipal waste combustor metals (measured as particulate matter)	51.7
Municipal waste combustor organics (measured as dioxins <sup>1</sup> and furans <sup>1</sup> )	4.07E-05
Sulfuric Acid Mist	16.6
Fluorides (measured as hydrogen fluoride)	10.8
Ammonia (NH <sub>3</sub> )**	29.5
CO <sub>2</sub> equivalent ( without biogenic CO <sub>2</sub> )	466,619
Fugitive Particulate Emissions	
PM	7.06
PM <sub>10</sub>	1.41
PM <sub>2.5</sub>	0.35

\* Ozone is regulated by its precursors VOC and NO<sub>x</sub>. (40 CFR Part 52.21(b) (50) (i) (a))

\*\* NH<sub>3</sub> is not a PSD pollutant; NH<sub>3</sub> emissions at the facility primarily result from the NH<sub>3</sub> emissions known as NH<sub>3</sub> "slip" resulting from the Regenerative Selective Catalytic Reduction units-Selective Catalytic Reduction modules that uses ammonia solution as reagent while reducing NO<sub>x</sub>; only a small portion of the NH<sub>3</sub> emissions will result from the ammonia storage tank (Tank 1).

<sup>1</sup> Based on the definition of municipal waste combustors organics at 40 CFR 52.21 (b) (23)(i) the, "dioxins" shall mean total tetra-through octa-chlorinated dibenzo-p-dioxin, and "furans" shall mean total -tetra-through-octa- chlorinated dibenzofurans.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### **VII. Operating Requirements/Work Practices and Stack Parameters**

##### **A. Municipal Waste Combustors Units**

1. The Permittee shall install two identical municipal waste combustors units (Boiler 1 and Boiler 2). Each municipal waste combustor unit shall consist of a spreader- stoker boiler.
2. Each municipal waste combustor unit shall be equipped with three auxiliary fuel oil fired burners that should be used only: (1) during warmup, and shutdown periods; and (2) to maintain the units' combustion chamber temperature during potentially short-term interruptions of the refuse-derived fuel (RDF) or waste-derived fuel (WDF) supply. See section VIII. A.1.a and A.3.d of this permit for the definitions of RDF and WDF.
3. The maximum combined heat input of the three auxiliary fuel oil burners shall not exceed 400 MMBTU/hr.
4. Operating Loads

For the purposes of this permit, the following operating loads are defined for each municipal waste combustor unit (Boiler 1 and Boiler 2):

- a. Normal operation load shall be defined as the municipal waste combustor unit operating at or above 400 million British Thermal Units per hour (MMBTU/hr) heat input rate, while burning RDF or WDF.
- b. Warmup shall be defined as the period beginning with the initial firing of the municipal waste combustor unit's auxiliary fuel oil burners and ending at the time when RDF or WDF are introduced in the municipal combustor unit, and the firing of the fuel oil to the auxiliary fuel oil burners is ceased.
- c. Shutdown shall be defined as the period of time beginning with the cessation of feeding the RDF or WDF, and starting firing of the

**ENCLOSURE I****ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT****Final Permit**

municipal waste combustor unit's auxiliary fuel oil burners and ending when the municipal waste combustor grates are clear.

**5. Heat Input and Steam Production Rate Limitations**

- a. Except for warmup and shutdown, for each 1-hour period, each municipal waste combustor unit (Boiler 1 and Boiler 2), shall only operate between the following two heat input rate limits:
  - i. 400 MMBtu/hr; Compliance with this heat input rate limit shall be demonstrated by multiplying the design steam ratio or the actual steam ratio (expressed as MMBTU/lb of steam) by the measured steam production rate (lb of steam /hr) at 830 degrees Fahrenheit (<sup>0</sup>F) and 850.3 pounds per square inch gauge (psig); and
  - ii. 550 MMBtu/hr; Compliance with this heat input rate limit shall be demonstrated by multiplying the design steam ratio or the actual steam ratio (expressed as MMBTU/ lb of steam) by the measured steam production rate ( lb of steam /hr) at 830<sup>0</sup>F and 850.3 psig.
- b. Except for warmup and shutdown, each municipal waste combustor unit shall not exceed 500 MMBtu/hr, based on a 12-month rolling average. See section XIII. E. of this permit for a detailed explanation on determination of the heat input rate based on 12-month rolling average limit.
- c. For the purposes of this permit the design steam ratio (MMBTU/lb of steam) specified in 5.a.i and 5.a.ii above shall be defined as the ratio of each combustor's design heat input rate (MMBTU/hr) to its design steam production rate output (lb of steam/hr). The design steam ratio used for demonstrating compliance with the heat input rate limits specified in this permit shall be 0.001379 MMBtu/lb of steam or 1.379E-03 MMBtu/lb of steam.
- d. The steam ratio(MMBTU/lb of steam) of each combustor shall be measured quarterly, to determine the actual steam ratio (MMBTU/lb of steam) of each combustor, as follows:

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- i. Actual heat input rate (MMBtu/hr) shall be determined as the product of the actual (weighted) amount of waste (tons per hr of RDF and WDF) charged to each municipal waste combustor, and the actual heating value (i.e., heat content) of the waste expressed as MMBtu/ton of RDF and WDF;
- ii. Heating value (MMBtu/ton) of RDF and WDF shall be determined by the procedures contained in the American Society of Mechanical Engineers (ASME) Performance Test Code 34-2007 "Waste Combustors with Energy Recovery", or the most current ASME version, or other procedures upon EPA's approval.
- iii. Actual steam production rate (lb of steam/hr) shall be supplied by the steam monitoring device;
- iv. Actual MMBtu/lb of steam ratio shall be calculated by dividing the actual heat input rate (MMBtu/hr) by the actual steam production rate (lb of steam/hr).
- e. The results of each combustor quarterly steam ratio measurements must be submitted to EPA within 15 days after completion of the measurements.
- f. If, during a quarterly measurement it is determined that the actual steam ratio (MMBtu/lb of steam) is greater than the design steam ratio of  $1.379E-03$  (MMBtu/lb of steam), the Permittee, for the next quarter compliance demonstration with the heat input rate limits, may use the actual steam ratio.
- g. The Permittee shall calculate and record, on an hourly basis, for each municipal waste combustor unit, the actual heat input (MMBtu/hr) during normal operation. The actual heat input shall be calculated based steam production rate (lb of steam/hr) supplied by the steam monitoring device and the design steam ratio or the actual steam ratio.
- h. The Permittee shall submit a written report of the heat input rates recordings, including the data and calculations used to derive them, to

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

EPA for every calendar quarter. All quarterly reports shall be postmarked by the 30th day following the end of each quarter.

6. During normal operation, the temperature of the municipal waste combustors units' combustion chamber shall be maintained at or above 1800<sup>0</sup>F.
7. Warmup and Shutdown
  - a. The total number of warmup/shutdown events for the two municipal combustors units, combined, shall be limited to 32 events during any consecutive 12-month period.
  - b. The duration of each warmup event shall not exceed 7 hours; and the duration of each shutdown event shall not exceed 6 hours.
  - c. The warmup shall occur only between 7:00 AM and 7:00 PM, and the warmup shall not occur simultaneously for the two municipal waste combustors units.
  - d. During warmup and shutdown, the Permittee shall:
    - i. Minimize the emissions by: 1) operating and maintaining the municipal waste combustors units and associated air pollution control equipment in accordance with good combustion and air pollution control practices, safe operating practices, and protection of the facility; and 2) implementation of operations and maintenance practices comprised of maintaining a high level of operation time, and minimizing the frequency of warmup and shutdown events.
    - ii. Operate continuous emission monitoring system (CEMS), continuous opacity monitoring system, and other continuous monitoring systems and devices required by this permit.
    - iii. Unless otherwise specified in this permit, comply with all emissions and opacity limits applicable during normal operation.



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- e. During each warmup and shutdown event, the Permittee shall record:
    - i. The time, date, and duration in hours and minutes;
    - ii. The heat input rate (MMBtu/hr) of each municipal waste combustor unit that shall be determined based on the actual fuel oil consumption and the fuel's heating value (MMBTU/gallon) as specified in this permit.
  - f. During warmup periods, the Regenerative Selective Catalytic Reduction (RSCR) units, including ammonia injection, shall be operated no later than when the inlet gas temperature to the RSCR unit temperature reaches 290<sup>0</sup> F.
8. The Permittee shall install, calibrate, maintain, and operate on a continuous basis monitoring systems or devices for the following parameters for each municipal waste combustor unit:
- a. Steam flow rate (lb of steam per hour) on an hourly basis.
  - b. Steam temperature (<sup>0</sup>F).
  - c. Steam pressure (pounds per square inch gauge).
  - d. Steam turbine's energy output in megawatts hour (MW-hour) on an hourly basis.
  - e. Combustion chamber temperature (<sup>0</sup>F).
  - f. Stack gas volumetric flow rate to be used in determining mass emission rates.
9. The monitoring systems and devices required at VII.A.8 above shall be installed in accordance with the manufacturers' specifications, and must meet all applicable EPA monitoring performance specifications.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### B. Ash Handling System

1. The Ash Handling System shall be comprised of the following emission units:
  - a. Bottom Ash Handling and Conveying System (Trans 1), that shall consist of bottom ash hoppers, sifting hoppers, and conveyors.
  - b. Bottom Ash Storage and Conveying System (Trans 2), that shall consist of bottom ash storage bunkers, and conveyors.
  - c. Bottom Ash Processing Activities (Ash), that shall consist of conveyers and equipment used for processing, and separation of ferrous, non-ferrous, and Boiler Aggregate<sup>TM</sup>(defined as a granular material recovered from bottom ash that is used as a substitute for conventional aggregate in construction products) materials from the bottom ash.
  - d. Fly Ash Conveying, Storage Silo, Conditioning, and Loading System (Silo 4), which shall consist of conveyors, silo, and conditioning equipment (e.g., pug mill mixer).
2. The following emission units of the Ash Handling System shall be located within enclosed buildings or structures: (1) Trans 1; (2) Trans 2; and (3) Ash.
3. The conveyors and the conveyors' transfer points of the following emission units shall be enclosed, sealed, and kept under negative pressure: Trans 1, Trans 2, Ash, and Silo 4.
4. All fly ash shall be conditioned (i.e., hydrated, via a pug mill mixer) prior to transfer for disposal.
5. At least 6 months prior to the anticipated startup date, the Permittee shall submit a bottom and fly ash characterization study plan to the Puerto Rico Environmental Quality Board (PREQB) for review and approval. The Permittee shall not send any ash or Boiler Aggregate<sup>TM</sup> for either disposal or beneficial use, without receiving prior approval from the PREQB.

## **ENCLOSURE I**

### **ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

#### **Final Permit**

#### **C. Storage Silos**

1. The Storage Silos shall be comprised of the following emission units:
  - a. Carbon Handling System and Storage Silo (Silo 1).
  - b. Lime Handling System and Storage Silo (Silo 2).
2. Each emission unit shall consist of a pneumatic truck off-load and handling system, and a storage silo.
3. The carbon and the lime shall be transferred pneumatically from the bulk delivery trucks into the storage silo and from the silo to the municipal waste combustors.

#### **D. Emergency Equipment**

1. The emergency equipment shall include the following emission units: one emergency diesel generator (Gen) and one emergency diesel fire pump (Fire).
2. The Permittee shall install an emergency diesel generator that:
  - a. Is a fuel-efficient certified engine.
  - b. Is certified by the manufacturer to be at least a model year 2010 or more recent emergency generator.
  - c. Is certified by the manufacturer to meet the emission standards required by 40 CFR Part 89, Subpart B Table 1 for non-road compression ignition engines.
  - d. Has a nameplate capacity that shall not exceed a maximum power output of 670 brake horsepower (BHP) (500 kilowatts or kW).
3. The Permittee shall install an emergency diesel fire pump that:

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- a. Is the most fuel-efficient National Fire Protection Association (NFPA-20) certified pump available.
  - b. Is certified by the manufacturer to be at least a model year 2010 or more recent.
  - c. Is certified by the manufacturer to meet the emission standards required by 40 CFR Part 60, Subpart III Table 4.
  - d. Has a nameplate capacity that shall not exceed a maximum power output of 335 BHP (250 kW).
4. The emergency diesel generator (Gen) shall be used only when routine electrical power to the permitted facility is unavoidably interrupted, and for maintenance checks and readiness testing on the generator engine.
  5. The emergency diesel fire pump (Fire) shall only be used for fighting fires when no electricity is available at the permitted facility, and for the operation of the engine for maintenance, and readiness testing purposes, including as required for fire safety testing.
  6. The maximum operating hours for, the emergency generator and the fire pump shall each be limited to 500 hours per 12-month rolling total, as determined at the end of each calendar month. The annual permitted hours shall include testing, maintenance, and emergency hours.
  7. The duration of each maintenance and testing event of the emergency diesel generator and fire pump shall be limited to a maximum of 30 minutes/event (in any hour), and shall occur only between 7:00 AM and 7:00 PM, Monday through Friday.
  8. The Permittee shall install and maintain a non-resettable operating hour meter or the equivalent software to accurately indicate the elapsed operating time of the emergency generator and fire pump.
  9. The emergency generator and the emergency fire pump shall comply with all applicable provisions of 40 CFR 60 Subpart III.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### E. Storage Tanks

##### 1. Ammonia Storage Tank

- a. The Permittee is authorized to install and operate a 12,000 gallon tank (Tank 1) to store aqueous ammonia solution containing 19% ammonia by volume that is used as reagent for the Regenerative Selective Catalytic Reduction (RSCR) units–Selective Catalytic Reduction (SCR) modules. Compliance with the 19% ammonia by volume requirement of this permit shall be demonstrated by ammonia supplier certification of each ammonia delivery.
- b. The ammonia storage tank shall be aboveground, double walled, unpressurized, and equipped with an emergency relief valve, and a vapor recovery, and return system.
- c. The ammonia storage tank area shall be marked and secured as to protect the tank from accidents that could cause rupture.
- d. Audio, olfactory, and visual checks for ammonia emissions shall be made at least three times per day (i.e., 24 hours period) within the operating area; one check shall be made during night time, regardless of whether the facility is operating during night time.
- e. No later than one hour following detection of a leak, the Permittee shall take the following actions:
  - i. Locate and isolate the leak.
  - ii. Use a leak collection/containment system to control the leak until repair or replacement can be made.
- f. Within 24 hours following the detection of a leak, the Permittee shall commence repair or replacement of the leaking component as appropriate. The Permittee shall record all of the leak events and the actions taken.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- g. The Permittee shall maintain a Plan of the Prevention and Protection Measures for the ammonia storage tank and ammonia distribution system to the RSCR. A copy of the Permittee's Plan shall be kept on site.
2. Distillate Fuel Oil No.2 Storage Tanks.
- a. The Permittee is authorized to construct the following distillate fuel oil No.2 aboveground storage tanks:
    - i. 50,000 gallons (Tank 2), vertical fixed roof tank for the municipal waste combustors warm up, shutdown, and temperature maintenance periods and the RSCR units, with a net throughput that shall not exceed 995,304 gallons per 12-month rolling total.
    - ii. 2,000 gallons (Tank 3), horizontal fixed roof tank for the emergency generator, with a net throughput that shall not exceed 16,200 gallons per 12-month rolling total.
    - iii. 500 gallons (Tank 4), horizontal fixed roof tank for the emergency fire pump, with a net throughput that shall not exceed 8,100 gallons per 12-month rolling total.
  - b. The storage tanks shall be operated and maintained as indicated by the tanks' manufacturer to prevent and minimize emissions. A copy of the manufacturer's manual for each tank shall be kept onsite.

#### F. Cooling Tower System

- 1. The Permittee shall install and operate a "four-cell" mechanical draft wet cooling tower system, 56 feet in height, equipped with high efficiency drift eliminators.
- 2. An identification tag or nameplate shall be displayed on the cooling tower, which identifies the applicable model number, serial number, and manufacturer. The identification tag or nameplate shall be permanently attached to the cooling tower at a conspicuous location.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

3. The maximum total circulating flow water rate shall not exceed 65,150 gallons per minute (gpm).
4. The total dissolved solids (TDS) content of the cooling tower circulating water shall not exceed 16,100 ppm by weight (ppmw).
5. The Permittee shall:
  - a. Continuously monitor the flow rate of the circulating water; and
  - b. Use, on a monthly basis, EPA Method 160.3, to measure and record the TDS content of the circulating water.
6. The use of chromium-based treatment chemicals in the cooling tower water is prohibited.
7. Prior to the initial operation of the cooling tower, the Permittee shall have the cooling tower vendor's field representative inspect the cooling tower drift eliminator and certify that the installation was performed in a satisfactory manner.
8. The Permittee shall operate and maintain the cooling tower in accordance with the manufacturer's Operations and Maintenance plan. This plan shall be kept onsite and available to EPA personnel on request.
9. At least once per shift, the Permittee shall inspect the cooling tower, as well as the drift eliminator on the cooling tower to ensure that any damage to the drift eliminators or cooling tower is corrected. Such an inspection shall include an inspection of the integrity of the seals between the drift eliminators and the cooling towers.
10. At least once per calendar year, the Permittee shall conduct a complete inspection of the cooling tower and drift eliminator. The inspection shall be conducted using an inspector with recognized expertise in the field of mechanical draft cooling tower drift eliminators.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### G. Fugitive Particulate Emission Sources

1. The control measures to minimize the fugitive particulate emission from roadways and parking areas, shall include, but not be limited to, the following :
  - a. Paving all the facility roads and parking areas. All other areas of the site shall be landscaped, to the maximum extent possible, using grass, shrubs, and trees,
  - b. Treating the paved roadways, parking areas, exterior and interior of the buildings and other areas as necessary by sweeping, vacuuming, and /or watering at sufficient treatment frequencies to minimize the fugitive dust emissions to the maximum extent possible.
  - c. The Permittee shall perform daily inspections of each of the roadway segments and parking areas to determine the need for implementing the fugitive dust control measures. These inspections shall be performed during representative normal traffic conditions.
2. All delivery vehicles, including but not limited to, municipal solid waste (MSW), supplementary fuels (as defined in this permit), lime, carbon, and fly ash conditioning agent vehicles shall be enclosed or covered.
3. All MSW and supplementary fuels delivery vehicles shall be unloaded exclusively in enclosed buildings.
4. All vehicles leaving the facility that are used for transporting materials likely to become airborne shall be enclosed or covered.
5. All unloading, storage, processing, shredding, and blending activities of the MSW, supplementary fuels, and bottom ash, shall be done in enclosed buildings.
6. In order to prevent the fugitive particulate emissions from the MSW and supplementary fuels unloading, storage, processing, and blending buildings, the Permittee shall maintain these buildings under negative pressure when either one or both boilers are operating. The negative



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

pressure shall be maintained by continuously drawing the exhaust air from these buildings into the municipal waste combustors as combustion air. During times when both boilers are shut down, in order to prevent the fugitive emissions from the MSW and supplementary fuels unloading, storage, processing, and buildings, the exhaust air from these buildings shall be vented to dust collectors.

7. The Permittee shall ensure that the doors from all processing buildings (including the municipal waste combustors units' building) remain closed to the maximum extent possible using good engineering design.
8. The Permittee shall perform the following:
  - a. Daily checks for any visible fugitive emissions from the processing buildings (including the municipal waste combustors units' building) windows, doors, and roof monitors.
  - b. Weekly inspection of all the processing buildings to ensure that:
    - i. All access doors that are capable of being closed are closed; and
    - ii. For the MSW and supplementary fuels processing buildings, the direction of air at each natural draft opening is inward, as shown by the flow monitoring devices.
9. As required elsewhere in the permit all conveyors shall be fully enclosed, and all fabric filters shall be operational at all times as prescribed by the manufacturers.
10. The particulate emissions resulting from the fly ash conditioning process shall be controlled by a fabric filter, and the conditioned fly ash shall be stored in an enclosed storage space.
11. If visible emissions are observed as a result of any of the above-specified inspections, the Permittee shall take corrective actions as soon as possible, to minimize and eliminate the visible emissions.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

12. Notwithstanding the fugitive particulate emissions control measures specified in this permit, the Permittee may employ additional control measures to prevent fugitive particulate emissions from becoming airborne and causing the discharge of visible emissions of fugitive particulate emissions beyond the property line.

#### H. Stack Parameters

1. Each municipal waste combustor unit (Boiler 1 and Boiler 2) shall exhaust to an individual stack that rises to 95.5 m above grade with an inner stack diameter of 2.13 m.
2. Each RSCR unit exhaust shall be vented through the corresponding municipal waste combustor unit's stacks.
3. The emergency generator (Gen) and the firewater pump (Fire) shall each exhaust to an individual stack that rises to 10 m above grade with an inner stack diameter of 0.152 m.

### VIII. Fuel Requirements

#### A. Municipal Waste Combustors Units

1. Primary Fuel: Refuse-Derived Fuel
  - a. The primary fuel for each municipal waste combustor unit shall be the refuse-derived fuel (RDF). The RDF shall consist of shredded municipal solid waste.
  - b. The Permittee shall use exclusively municipal solid waste (MSW) that includes items and materials that fit within the definition of municipal solid waste contained in 40 CFR Part 60.51b. With respect to MSW supplied from municipalities, the Permittee shall accept municipal solid waste only from municipalities that: (i) have established a Recycling Plan under 12 L.P.R.A Section 1320b that has been approved by the Puerto Rico Solid Waste Authority ("SWA") or are participating in a municipal consortium with a Recycling Plan approved by the SWA; or (ii) do not have such an SWA-approved

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

Recycling Plan, but are covered by an order or other resolution issued by the SWA pursuant to 12 L.P.R.A Chapters 127 or 127A directing such municipality to submit its Recycling Plan to the SWA for its evaluation and approval and the time allotted for the submittal of such Recycling Plan has not expired.

- c. The Permittee shall employ the best engineering and work practices to:
  - i. Remove, to the maximum extent possible, all identifiable wastes from the municipal waste stream that do not qualify as municipal solid waste prior to shredding;
  - iii. Remove, to the maximum extent possible, the metal component from the municipal waste stream;
  - iv. Prevent large quantities of easily discernible yard wastes, such as grass clippings, leaves, tree trimmings, bushes and shrubs from being charged to the municipal waste combustors.
- d. The total combined RDF consumption rate for the two municipal waste combustors units shall not exceed 2,106 tons per day (TPD) based on 12-month rolling average. See section XIII. E. of this permit for detailed explanation on determination of the 12-month rolling average limit.
- e. If any amount of the supplementary fuels is combusted, the RDF consumption rate shall be prorated so that the heat input rates limitations specified by this permit for each municipal waste combustor unit are not exceeded.

#### 2. Supplementary Fuels

The supplementary fuels shall consist of Automotive-Shredder Residue (ASR), Processed Urban Wood Waste (PUWW), and Tire-Derived Fuel (TDF).

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- a. Automotive-Shredder Residue
  - i. For the purposes of this permit ASR shall be defined as shredded interior plastic trim, upholstery fabric and filler, insulation and padding of end-of-life vehicles, which may include only the following materials: pieces of rubber, paper, hard plastic, vinyl glass, and also limited amounts of aluminum and plated metals scrap, rocks, and dirt.
  - ii. The total combined ASR consumption rate for the two municipal waste combustors units shall not exceed 286 TPD.
  - iii. The Permittee shall not combust ASR with a content of chlorine and heavy metals [particulate matter (PM) is the surrogate for heavy metals] exceeding the maximum acceptable level (s) determined during the supplementary fuels combustion demonstration period.
- b. Processed Urban Wood Waste
  - i. For the purposes of this permit PUWW shall be defined as separated, inspected and shredded green and dried wood waste materials, which may include only the following materials: sawn lumber, pruned branches, stumps, and whole trees from street and park maintenance, shipping pallets, wood debris separated from construction and demolition and land clearing and grubbing activities.
  - ii. The total combined PUWW consumption rate for the two municipal waste combustors units shall not exceed 898 TPD.
- c. Tire Derived Fuel
  - i. The TDF shall be defined as shredded material made from scrap tires that are no longer usable for their original intended purpose because of wear, damage, or defect.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- ii. The Permittee shall not combust TDF made from scrap tires that have not been de-wired. For the purposes of this permit, “de-wired” scrap tires means scrap tires with their metal content removed.
  - iii. The total combined TDF consumption rate for the two municipal waste combustors units shall not exceed 330 TPD.
  - d. Prior to shredding and combustion of supplementary fuels (including the combustion demonstration period as described in this permit), the Permittee shall employ the best engineering and work practices, to remove, to the maximum extent possible, all identifiable items that do not qualify as ASR, PUWW, and TDF as defined by this permit.
3. Monitoring Requirements for RDF and Supplementary Fuels.
- a. The ASR shall be received at the facility only in a shredded form.
  - b. The MSW and supplementary fuels’ handling, processing, shredding, and blending equipment shall be exclusively driven by electric motors.
  - c. The supplementary fuels shall only be combusted if well blended with RDF.
  - d. For the purposes of this PSD permit, the blend of RDF and supplementary fuels shall be defined as waste-derived fuel (WDF).
  - e. Only one supplementary fuel shall be present in the mixture fed to the municipal waste combustor units at any given time. This requirement shall apply at all times, including the supplementary fuel combustion demonstration period.
  - f. The Permittee shall install scales on the feed conveyors to determine the weight of RDF and WDF charged to each municipal waste combustor unit. Scales shall be capable of: 1) automatically weighing each charge, at minimum recording the time, date, and weight (e.g., lb, or tons per hour and tons per day); and 2) printing hourly and daily totals for each municipal waste combustor unit.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- g. The Permittee shall install scales to monitor the amount of each supplementary fuel (in tons per day) charged to each municipal waste combustor unit.
  - h. Each delivery from an ASR and PUWW supplier must be accompanied by documentation demonstrating that:
    - i. The ASR is free of fluids, batteries, air bags, mercury switches, catalytic converters; and
    - ii. The PUWW is free of paint, stain, coatings, wood preservatives, including but not limited to, formaldehyde, copper, chromium, arsenate, creosote, or pentachlorophenol.
  - i. Each delivery from an ASR supplier must be accompanied by an analysis report showing the ASR's content of chlorine and heavy metals.
  - j. The supplier's documentation and analysis report required at (g) and (h), above, shall include a unique identification number, date of delivery, sampling analysis, date the sampling analysis was performed, and analytical methods used. The documentation must be for each delivery of ASR or PUWW accepted for use as a supplementary fuel.
  - k. The Permittee shall maintain records of all the suppliers' documentations and analysis reports required at (g) and (h) above.
4. Supplementary Fuels Combustion Demonstration Period.
- a. Prior to using any of the supplementary fuels (ASR, PUWW and TDF), the Permittee shall conduct a combustion demonstration period to verify the efficiency of the municipal waste combustor units' air pollution control equipment in reducing the air pollutants resulting from the combustion of the supplementary fuels.
  - b. The Permittee shall submit a Supplementary Fuels-Combustion Demonstration Period Plan to EPA for review and approval at least 90 days prior to the anticipated start-up date of the demonstration period.

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

- c. During the Combustion Demonstration Period, the Permittee:
    - i. Shall not discharge or cause the discharge of emissions from the municipal waste combustor units in excess of the emission and opacity limits specified in this permit.
    - ii. Shall determine the maximum acceptable content of chlorine and heavy metals in ASR for which the hydrogen chloride and heavy metals emission limits specified in this permit are continuously met. Once determined, the ASR's maximum acceptable chlorine and heavy metals content shall be submitted to EPA and, if approved, added as a condition of this permit.
  - d. The Permittee shall submit a report to EPA containing the Combustion Demonstration Period results.
  - e. The Permittee shall not combust the amounts of supplementary fuels specified in this permit, unless it demonstrates that the emissions resulting from these fuels are less than or equal to the emission limits contained in this permit.
  - f. If, during the Combustion Demonstration Period, the Permittee determines that the emission, or opacity limits established in this permit are not feasible while combusting RDF and supplementary fuels, the Permittee shall submit an application to EPA requesting modification of this permit to reduce the supplementary fuels' consumption rates, or other modifications, as appropriate.
5. Ultra Low Sulfur Distillate Fuel oil No.2: Municipal Waste Combustors Units' Auxiliary Burners and RSCR units.
- a. The municipal waste combustors units' auxiliary burners shall only burn Ultra Low Sulfur Distillate (ULSD) fuel oil No.2.
  - b. The RSCR units (as described in this permit at section IX.A.1.d.) shall only combust: (1) ULSD fuel oil No.2 for providing the optimal temperature range necessary for the NO<sub>x</sub> reduction; and (2) propane for maintaining the safety pilot flame.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- c. The total combined ULSD fuel oil No.2 consumption for the two municipal waste combustors' auxiliary burners and the two RSCR units shall not exceed 995,304 gallons based on 12-month rolling total.
- d. The total combined propane consumption for the two RSCR units shall not exceed 57,740 gallons based on 12-month rolling total.
- e. The Permittee shall monitor the quantity of ULSD fuel oil No.2 used by each municipal waste combustor unit's auxiliary fuel oil burners, using a non-resettable totalizing fuel meter.
- f. The Permittee shall monitor the quantity of ULSD fuel oil No.2 and propane used by each RSCR unit by using non-resettable totalizing fuel meters.

#### **B. Emergency Equipment**

1. The emergency generator (Gen) and the emergency fire pump (Fire) shall only combust ULSD fuel oil No.2.
2. The maximum ULSD fuel oil No.2 consumption for the emergency generator (Gen) shall not exceed: 1) 32.4 gallons/hr; and 2) 16,200 gallons based on 12-month rolling total.
3. The maximum ULSD fuel oil No.2 consumption for the emergency fire pump (Fire) shall not exceed: 1) 16.2 gallons/hr; and 2) 8,100 gallons based on 12-month rolling total.
4. The Permittee shall monitor the quantity of ULSD fuel oil No.2 used by each of the following emission units: (1) emergency generator (Gen); and (2) emergency fire pump (Fire).

#### **C. Sulfur Content of ULSD Fuel Oil No. 2 and Propane**

1. The sulfur content of the ULSD fuel oil No.2 and propane shall not exceed 0.0015 percent (%) [15 parts per million] sulfur by weight. Compliance with this requirement shall be demonstrated by fuel supplier certifications for each distillate fuel oil and propane delivery.



**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**IX. Air Pollution Control Equipment**

At all times, including periods of warmup, shutdown and malfunction, the Permittee shall use best practices to maintain and operate all the emissions units, including associated air pollution control, for minimizing emissions. Determination by EPA of whether acceptable operating and maintenance procedures are being used will be based on information available to EPA, which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the facility.

**A. Municipal Waste Combustors Units**

1. The Permittee shall install and continuously operate, and maintain (unless otherwise specified elsewhere in this permit), the following air pollution control equipment on each municipal waste combustor unit (Boiler 1 and Boiler 2):
  - a. Turbosorp Circulating Dry Scrubber system that uses lime injection.
  - b. Activated Carbon Injection system.
  - c. Fabric Filter.
  - d. Regenerative Selective Catalytic Reduction unit that shall include:
    - i. One Oxidation Catalyst module; and
    - ii. One Selective Catalytic Reduction (SCR) module, with ammonia solution injection;
    - iii. Three distillate fuel-oil No.2 burners with a maximum combined (three burners) heat input rate of 4.5 MMBTU/hr , and three propane pilot flame burners with a maximum combined ( three burners) heat input rate of 0.3 MMBTU/hr.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### **B. Ash Handling System and Storage Silos**

1. The Permittee shall install and continuously operate and maintain the following air pollution control equipment:
  - a. Two Fabric Filters (one operating, one standby) for each of the following emission units: (1) Bottom Ash Handling and Conveying System (Trans 1); and (2) Bottom Ash Storage and Conveying System (Trans 2). The nameplate capacity of each Fabric Filter shall not exceed a maximum design inlet gas air flow rate of 20,040 dry standard cubic feet per minute (dscfm).
  - b. One Fabric Filter with a nameplate capacity that shall not exceed a maximum design inlet gas air flow rate of 59,700 dscfm, for the Bottom Ash Processing Activities (Ash).
  - c. One Fabric Filter for each of the following emission units: (1) Fly Ash Conveying, Storage Silo, Conditioning, and Loading System (Silo 4); (2) Carbon Handling System and Storage Silo (Silo 1); and (3) Lime Handling System and Storage Silo (Silo 2). The nameplate capacity of each Fabric Filter shall not exceed a maximum design inlet gas air flow rate of 1,000 dscfm.

#### **C. Cooling Tower System**

1. The Permittee shall install and continuously operate and maintain a drift eliminator designed to limit circulating water flow drift loss to 0.0005 % percent or less.

#### **D. Monitoring Requirements for the Air Pollution Control Equipment**

1. The Permittee shall install, calibrate, operate and maintain on a continuous basis devices for the following parameters of the air pollution control equipment:
  - a. Pressure drop (inches of water column), for the Activated Carbon Injection, Turbosorp Circulating Dry Scrubber (Boiler 1, and Boiler 2),

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

and Fabric Filters (Boiler 1, Boiler 2, Trans 1, Trans 2, Ash, Silo 1, Silo 2, and Silo 4)

- b. Activated carbon mass feed rate (lb/hr) (for each Activated Carbon Injection system), lime flow injection rate (lb/hr) (for each Turbosorp Circulating Dry Scrubber system), and ammonia solution injection rate (gallons/hr) (for each RSCR-SCR module) (Boiler 1 and Boiler 2).
  - c. Flue gas temperature ( $^{\circ}\text{F}$ ) at the inlet of each municipal waste combustors unit (Boiler 1 and Boiler 2)'s Fabric Filter. The temperature shall be calculated in 4-hour block arithmetic averages.
  - d. Flue gas temperature ( $^{\circ}\text{F}$ ) at the inlet and outlet of each RSCR unit.
  - e. Flue gas temperature ( $^{\circ}\text{F}$ ) at the outlet of each Turbosorp Circulating Dry Scrubber system (Boiler 1 and Boiler 2).
  - f. Bag leak detection system for each Fabric Filter. An audible alarm shall be installed to sound when the pre-set level of emissions is exceeded (Boiler 1, Boiler 2, Trans 1, Trans 2, Ash, Silo 1, Silo 2, and Silo 4).
2. The maximum ammonia injection rate required to achieve the  $\text{NO}_x$  emissions and ammonia slip limits specified in this permit shall be determined during the  $\text{NO}_x$  performance test and shall be submitted to EPA and, if approved, become a condition of this permit; once the maximum ammonia injection rate becomes a permit condition, it shall not be exceeded.
  3. The acceptable pressure drop (inches of water column) for each air pollution control equipment specified at section IX. D.1.a. above shall be based either on the manufacturer's specifications, or on the pressure drop range established during any required performance test and shall be submitted to EPA and, if approved, become a condition of this permit.

**ENCLOSURE I****ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT****Final Permit****X. Air Pollutants Emissions, Opacity, and Visible Emissions Limitations****A. Municipal Waste Combustors Units**

Unless otherwise specified in this permit, the emission limits listed below shall apply at all times to each municipal waste combustor unit (Boiler 1 and Boiler 2), separately.

The municipal waste combustors units' emissions shall also include the emissions from their corresponding RSCR units. The pounds per hour (lb/hr) emission limits reflect maximum values calculated based on 550 MMBtu/hr, whereas the annual emission limits in tons per year (TPY) reflect values calculated based on 500 MMBtu/hr. The TPY emission limits listed below at A-1 through A-13 represent the total combined emissions from normal operation, warmup, and shutdown periods.

1. Nitrogen Oxides.
  - a. 45 parts per million by volume, corrected to 7 percent oxygen on dry basis or ppmvd @ 7% O<sub>2</sub> (based on 24-hour daily arithmetic average).
  - b. 43.89 lb/hr (1-hour average).
  - c. NO<sub>x</sub> (ppmvd @ 7% O<sub>2</sub> and lb/hr) emissions limits listed at X.A.1.a and b do not apply during warmup periods.
  - d. 480 lb/7 hours warmup event; the Permittee shall calculate the actual lb of NO<sub>x</sub> for each warmup event based on (CEMS) data; these calculations shall be recorded at the conclusion of each warmup event.
  - e. 175.3 TPY (12-month rolling total).
2. Carbon Monoxide.
  - a. 75 ppmvd @ 7% O<sub>2</sub> (based on 24-hour daily arithmetic average).
  - b. 44.53 lb/hr (1-hour average).

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

- c. CO (ppmvd @ 7% O<sub>2</sub> and lb/hr) emissions limits listed at X.A.2.a. and b. do not apply during warmup periods.
  - d. 228 lb/7 hours warmup event; the Permittee shall calculate the actual lb of CO for each warmup event based on CEMS data; these calculations shall be recorded at the conclusion of each warmup event.
  - e. 177.8 TPY (12-month rolling total).
3. Volatile Organic Compounds (as propane).
- a. 7.0 ppmvd @ 7% O<sub>2</sub> (average of three 1-hour test runs).
  - b. 6.56 lb/hr (1-hour average).
  - c. 26.1 TPY (12-month rolling total).
4. Sulfur Dioxide.
- a. 24 ppmvd @ 7% O<sub>2</sub> (based on 24-hour daily geometric average).
  - b. 32.59 lb/hr (1-hour average).
  - c. 130.1 TPY (12-month rolling total).
5. Municipal Waste Combustor Acid Gases [measured as SO<sub>2</sub> and hydrogen chloride] (MWC acid gases).
- a. Sulfur Dioxide
    - i. 24 ppmvd @ 7% O<sub>2</sub> (based on 24-hour daily geometric average).
    - ii. 32.59 lb/hr (1-hour average).
    - iii. 130.1 TPY (12-month rolling total).

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

b. Hydrogen Chloride

- i. 20 ppmvd @ 7% O<sub>2</sub> (average of three 1-hour test runs).
- ii. 15.48 lb/hr (1-hour average).
- iii. 61.8 TPY (12-month rolling total).

6. Particulate Matter (PM)

Particulate Matter emissions shall include only the filterable fraction PM.

- a. 10 milligrams per dry standard cubic meter corrected at 7% O<sub>2</sub> (mg/dscm @ 7% O<sub>2</sub>) (average of three 1-hour test runs).
- b. 5.10 lb/hr (1-hour average).
- c. 20.3 tons/yr (based on 12-month rolling total).

7. Particulate Matter with an aerodynamic diameter equal to or less than 10 micrometers (PM<sub>10</sub>).

PM<sub>10</sub> emissions shall include both filterable and condensable fractions of PM.

- a. 24 mg/dscm @ 7% O<sub>2</sub> (average of three 1-hour test runs).
- b. 12.23 lb/hr (1-hour average).
- c. 48.8 tons/yr (based on 12-month rolling total).

8. Particulate Matter with an aerodynamic diameter equal to or less than 2.5 micrometers (PM<sub>2.5</sub>)

PM<sub>2.5</sub> emissions shall include both filterable and condensable fractions of PM.

- a. 22 mg/dscm @ 7% O<sub>2</sub> (average of three 1-hour test runs).

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- b. 11.21 lb/hr (1-hour average).
  - c. 44.8 tons/yr (based on 12-month rolling total).
  - d. Special PM<sub>2.5</sub> Emission Limit Provisions.
    - i. Because condensable PM<sub>2.5</sub> emissions from municipal waste combustors have not been widely quantified, there is a possibility that the actual condensable portion of PM<sub>2.5</sub> would cause the above emission limits to be exceeded. In the event that the Permittee cannot meet the 22 mg/dscm @ 7% O<sub>2</sub> because of the condensable PM<sub>2.5</sub>, EPA may adjust the PM<sub>2.5</sub> emissions to a level not to exceed 30 mg/dscm @ 7% O<sub>2</sub>, 15.28 lb/hr, and 61 TPY based on EPA's review of the stack test results. This change in the permit will be accomplished administratively.
    - ii. Notwithstanding the stack test results, no PM<sub>2.5</sub> emission adjustment will take place until the Permittee demonstrates that the actual ammonia slip emissions of equal to or less than 5 ppmvd @ 7% O<sub>2</sub> do not provide a reasonable assurance of proper NO<sub>x</sub> emissions reduction by the RSCR unit.
9. Municipal Waste Combustor Metals [measured as particulate matter "PM"] (MWC metals).
- a. 10 mg/dscm @ 7% O<sub>2</sub> (average of three 1-hour test runs).
  - b. 5.10 lb/hr (1-hour average).
  - c. 20.3 tons/yr (12-month rolling total).
10. Municipal Waste Combustor Organics (measured as dioxins and furans).
- a. 10 nanograms per dry standard cubic meter, corrected to 7 percent oxygen (average of three test runs; minimum 4 hour/test run).
  - b. 5.10E-06 lb/hr (1-hour average).

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

- c. 2.036E-05 TPY (12-month rolling total).
11. Sulfuric Acid Mist ( $H_2SO_4$ ).
- a. 1.0 ppmvd @ 7%  $O_2$  (average of three 1-hour test runs).
  - b. 2.08 lb/hr (1-hour average).
  - c. 8.3 TPY (12-month rolling total).
12. Fluorides (measured as hydrogen fluoride: HF).
- a. 3.2 ppmvd @ 7%  $O_2$  (average of three 1-hour test runs).
  - b. 1.36 lb/hr (1-hour average).
  - c. 5.42 TPY (12-month rolling total).
13. Ammonia or  $NH_3$  slip.
- a. 10 ppmvd @ 7%  $O_2$  (based on 24-hour daily arithmetic average).
  - b. 3.60 lb/hr (1-hour average).
  - c. 14.4 TPY (based on 12-month rolling total).
14. Greenhouse Gas Emissions.
- a. The  $CO_2$  equivalent ( $CO_2e$ ) emission limits shall include combined emissions of  $CO_2$ ,  $CH_4$  and  $N_2O$ , and shall not include biogenic  $CO_2$  emissions (as described in 40 CFR Part 52.21(b) (49) (ii) (a)).
  - b. During normal operation, the  $CO_2e$  emissions from each municipal waste combustor unit and the corresponding RSCR unit shall not exceed 0.15 lb  $CO_2e$  /lb of steam, based on 30-day rolling average. See section XIII. F of this permit for an explanation on determination of the 30-day rolling average of lb  $CO_2e$ /lb of steam rate.



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- c. During normal operation, the heat rate from the two municipal waste combustor units and the steam turbine generator shall not exceed 13.25 MMBtu/MW-hour (MW-hour or MWh represents the amount of electricity generated by the steam turbine generator) based on 30-day rolling average. See section XIII. F. of this permit for an explanation on determination of the 30-day rolling average of MMBTU/MWh rate.
- d. During normal operation, the total combined CO<sub>2</sub>e emissions for the two municipal waste combustors and the corresponding RSCR units shall not exceed 461,424 TPY, based on 12-month rolling total.
- e. During warmup and shutdown periods, the total combined CO<sub>2</sub>e emissions for the two municipal waste combustor units and the corresponding RSCR units shall not exceed 4,921 TPY, based on 12-month rolling total.

#### **B. Ash Handling System and Storage Silos**

- 1. The emissions of PM, PM<sub>10</sub>, and PM<sub>2.5</sub> from the exhaust of each fabric filter controlling the ash handling system and storage silos' emission units shall not exceed the following limits for each pollutant:
  - a. 0.017 mg/dscm and 0.0013 lb/hr, for each of the following emission units: (1) Bottom Ash Handling and Conveying System (Trans 1); and (2) Bottom Ash Storage and Conveying System (Trans 2).
  - b. 0.017 mg/dscm and 0.0038 lb/hr, for the Bottom Ash Processing Activities (Ash).
  - c. 0.017 mg/dscm and 6.38E-05 lb/hr, for each of the following emission units: (1) Fly Ash Conveying, Storage Silo, Conditioning and Loading System (Silo 4); (2) Activated Carbon Handling System and Storage Silo (Silo1); and (3) Lime Handling System (Silo 2).
- 2. PM, PM<sub>10</sub>, and PM<sub>2.5</sub> emissions shall include only filterable PM.

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**C. Emergency Equipment**

1. Emergency Generator (Gen).
  - a. NO<sub>x</sub> emissions shall not exceed 2.85 g/BHP-hr and 4.2 lb/hr.
  - b. CO emissions shall not exceed 2.6 g/BHP-hr and 3.86 lb/hr.
  - c. VOC emissions shall not exceed 0.15 g/BHP-hr and 0.22 lb/hr.
  - d. PM emissions (filterable fraction only) shall not exceed 0.15 g/BHP-hr and 0.22 lb/hr.
  - e. PM<sub>10</sub> (filterable + condensable fraction) shall not exceed 0.15 g/BHP-hr and 0.22 lb/hr.
  - f. PM<sub>2.5</sub> (filterable + condensable fraction) shall not exceed 0.15 g/BHP-hr and 0.22 lb/hr.
  - g. SO<sub>2</sub> emissions shall not exceed 0.006 lb/hr.
  - f. CO<sub>2</sub>e emissions shall include combined emissions of CO<sub>2</sub>, CH<sub>4</sub>, and N<sub>2</sub>O, and shall not exceed 183 tons per year (based on 12-month rolling total).
2. Emergency Fire Pump (Fire).
  - a. NO<sub>x</sub> emissions shall not exceed 2.85 g/BHP-hr and 2.1 lb/hr.
  - b. CO emissions shall not exceed 2.6 g/BHP-hr and 1.93 lb/hr.
  - c. VOC emissions shall not exceed 0.15 g/BHP-hr and 0.11 lb/hr.
  - d. PM emissions (filterable fraction only) shall not exceed 0.15 g/BHP-hr and 0.11 lb/hr.
  - e. PM<sub>10</sub> (filterable + condensable fraction) shall not exceed 0.15 g/BHP-hr and 0.11 lb/hr.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- f. PM<sub>2.5</sub> (filterable + condensable fraction) shall not exceed 0.15 g/BHP-hr and 0.11 lb/hr.
- g. SO<sub>2</sub> emissions shall not exceed 0.003 lb/hr.
- h. CO<sub>2</sub>e emissions shall include combined emissions of CO<sub>2</sub>, CH<sub>4</sub>, and N<sub>2</sub>O, and shall not exceed 91.3 tons per year (based on 12-month rolling total).

#### D. Storage Tanks

- 1. The emissions of ammonia and volatile organic compounds generated from the storage and transfer of aqueous ammonia solution and distillate fuel oil No.2 from and to the tanks shall not exceed the following limits:
  - a. 0.674 TPY for NH<sub>3</sub> emissions (based on 12-rolling total).
  - b. 70.28 lb/yr for VOC emissions (for all distillate fuel oil No.2 storage tanks combined) (based on 12-rolling rolling total).

#### E. Cooling Tower System

- 1. PM emissions shall not exceed 2.48 lb/hr (based on 24-hour daily average).
- 2. PM<sub>10</sub> emissions shall not exceed 1.30 lb/hr (based on 24-hour daily average).
- 3. PM<sub>2.5</sub> emissions shall not exceed 0.005 lb/hr (based on 24-hour daily average).

#### F. Fugitive Particulate Emission Sources

- 1. The fugitive PM emissions shall not exceed 7.06 tons per year (based on 12-month rolling total).
- 2. The fugitive PM<sub>10</sub> emissions shall not exceed 1.41 tons per year (based on 12-month rolling total).

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

3. The fugitive dust  $PM_{2.5}$  emissions shall not exceed 0.35 tons per year (based on 12-month rolling total).

#### G. Opacity

1. Opacity of emissions from the municipal waste combustors units (Boiler 1 and Boiler 2)'s stacks shall not exceed 10% (based on 6-minute average).
2. Opacity of emissions from the fabric filters' exhaust of the following emission units shall not exceed 5% (based on 6-minute average): (1) Bottom Ash Handling and Conveying System (Trans 1); (2) Bottom Ash Storage and Conveying System (Trans 2); (3) Bottom Ash Processing Activities (Ash); (4) Fly Ash Conveying, Storage Silo, Conditioning and Loading System (Silo 4); (5) Carbon Handling System and Storage Silo (Silo 1); and (6) Lime Handling System and Storage Silo (Silo 2).
3. Opacity of emissions from the emergency diesel generator (Gen), and the emergency diesel fire's (Fire) stacks shall not exceed 20% except for one period of no more than six (6) minutes in any sixty (60) minute interval when the opacity shall not exceed 27 percent.

#### H. Visible Emissions

1. The visible emissions of combustion ash resulting from the conveying systems (including conveyor transfer points) and from buildings and enclosures of ash conveying systems of the Ash Handling System's emission units (Trans 1, Trans 2, Ash, and Silo 4) shall not exceed 5% of the observation period (i.e., 9 minutes per 3-hour period). This limit shall not apply during maintenance and repairs of ash conveying system.

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**XI. Performance Test Requirements**

**A. Initial and Subsequent Performance Tests**

1. Initial performance tests shall be conducted within 60 days after achieving the maximum production rate, but no later than 180 days after initial startup of each emission unit as defined in 40 CFR Part 60.2, and at such other times as specified by EPA.
2. At least 60 days prior to actual testing, the Permittee shall submit to the EPA a Quality Assurance Project Plan detailing methods and procedures to be used during the performance stack testing. A Quality Assurance Project Plan that does not have EPA approval may be grounds to invalidate any test and require a re-test.
3. Notification of the stack test must be given to EPA at least 30 days prior to actual testing.
4. For performance test purposes, sampling ports, platforms and access shall be provided by the Permittee on the emission units' exhaust, as applicable, in accordance with 40 CFR Part 60.8 (e).
5. Performance tests must be conducted under such conditions to ensure representative performance of each emission unit. Operations during periods of startup, warmup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test.
6. All performance tests required for the municipal waste combustor units (Boiler 1 and Boiler 2) shall be conducted at 500 MMBtu/hr, and 550 MMBtu/hr.
7. Three test runs shall be conducted for each load condition and compliance for each operating mode shall be based on the average emission rate of these runs. Except otherwise indicated, the minimum sampling time per each run shall be 1 hour. For Dioxin/Furan (D/F) emissions, the minimum sampling time shall be 4-hour per test run.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

8. Results of emission testing must be submitted to EPA within 60 days after completion of performance tests.
9. Performance tests for the: (1) emissions of NO<sub>x</sub>, CO, SO<sub>2</sub> (including SO<sub>2</sub> as a surrogate for MWC acid gases), PM (including PM as a surrogate for MWC metals), HCL, D/F, CO<sub>2</sub>, O<sub>2</sub>, and Opacity of emissions required for Boiler 1 and Boiler 2; and (2) Visible emissions of combustion ash required for the conveying systems (including conveyor transfer points) and from buildings and enclosures of ash conveying systems of the Ash Handling System emission units (Trans 1, Trans 2, Ash, Silo 4) shall comply with all applicable procedures and methods specified at 40 CFR Part 60.58b.
10. The Permittee shall conduct initial performance tests (as described in 40 CFR Part 60.8) as follows:
  - a. For the PM (including PM as a surrogate for MWC metals), PM<sub>10</sub>, PM<sub>2.5</sub>, NO<sub>x</sub>, CO, VOC, SO<sub>2</sub> (including SO<sub>2</sub> as a surrogate for MWC acid gases), D/F, HCL, H<sub>2</sub>SO<sub>4</sub>, HF, NH<sub>3</sub>, O<sub>2</sub>, CO<sub>2</sub> total (biogenic + non-biogenic) and biogenic CO<sub>2</sub> emissions resulting from Boiler 1, and Boiler 2.
  - b. For the drift loss of the cooling tower cells (Cool 1 through 4).
  - c. For the heating value (i.e., heat content) of the RDF and WDF.
  - d. For the opacity of emissions resulting from each of the following emission units: Boiler 1, Boiler 2, fabric filters' exhaust of the Trans 1, Trans 2, Ash, Silo 1, Silo 2, Silo 4, Gen, and Fire.
  - e. No later than 30 days following any exceedances of the opacity of emissions limit specified in this permit at Section X.G.2 for any of the ash handling system emission units (Trans 1, Trans 2, Ash, and Silo 4), the Permittee shall conduct PM, PM<sub>10</sub>, and PM<sub>2.5</sub> performance tests following the test procedures specified in this permit.
  - f. For the visible emissions of combustion ash resulting from the conveying systems (including conveyor transfer points) and from

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

buildings and enclosures of ash conveying systems of the Ash Handling System emission units: Trans 1, Trans 2, Ash, and Silo 4.

11. Following the date of the initial performance tests, the Permittee shall conduct performance tests as follows:
  - a. On a calendar year basis (as described in 40 CFR Part 60.55b):
    - i. For the PM (including PM as a surrogate for MWC metals), PM<sub>10</sub>, PM<sub>2.5</sub>, emissions (Boiler 1 and Boiler 2).
  - b. On an annual basis (as described in 40 CFR Part 60.55b):
    - i. For the VOC, HCL, H<sub>2</sub>SO<sub>4</sub>, HF, O<sub>2</sub>, and NH<sub>3</sub> emissions (Boiler 1 and Boiler 2).
    - ii. For the drift loss of the cooling tower cells (Cool 1 through 4).
    - iii. For the opacity of emissions from each of the following emission units: Boiler 1, Boiler 2, fabric filters' exhaust of Trans 1, Trans 2, Ash, Silo 1, Silo 2, Silo 4, Gen, and Fire.
  - c. On a calendar quarter basis:
    - i. For the biogenic CO<sub>2</sub> emissions (Boiler 1 and Boiler 2).
    - ii. For the heating value (i.e., heat content) of the RDF and WDF.
    - iii. For D/F emissions (Boiler 1 and Boiler 2);
    - iv. The D/F performance test shall be performed quarterly on each combustor for the first three (3) years of operation. The reduction of the frequency of the performance tests for D/F, from once per calendar quarter to once per calendar year, may be authorized by EPA in its discretion, provided that each one of the twelve (12) quarterly performance tests over the first 3-year period indicate that D/F emissions are less than or equal to 7 nanograms (ng)/dscm @ 7% O<sub>2</sub>). In the event that any of the subsequent calendar year

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

performance tests (if authorized by EPA) indicates that D/F emissions exceed 7 ng/dscm @ 7% O<sub>2</sub>, the Permittee shall return to the quarterly D/F performance test requirement.

- d. On a monthly basis:
  - i. For the visible emissions of combustion ash (including conveyor transfer points) and from buildings and enclosures of ash conveying systems of the Ash Handling System' emission units: Trans 1, Trans 2, Ash, and Silo 4.

12. Additional performance tests may be required at the discretion of the EPA for any or all of the air pollutants specified by this permit.

#### **B. Test Methods**

- 1. The Permittee shall use the following test methods or a test method applicable at the time of the test and detailed in a test protocol approved by EPA.
  - a. Performance test for the emissions of NO<sub>x</sub> and SO<sub>2</sub> (including SO<sub>2</sub> as a surrogate for MWC acid gases) shall be conducted using EPA Method 19.
  - b. Performance test for the emissions of CO shall be conducted using EPA Method 10, 10A, or 10B.
  - c. Performance test for the emissions of PM (including PM as a surrogate for MWC metals), shall be conducted using EPA Method 5.
  - d. Performance test for emissions PM<sub>10</sub> and PM<sub>2.5</sub> shall be conducted using EPA Method 201 or 201A, and Method 202
  - e. Performance test for the emissions of VOC shall be conducted using EPA Method 25A.
  - f. Performance test for the emissions of HCL shall be conducted using EPA Method 26 or 26A.



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- g. Performance test for the emissions of D/F shall be conducted using EPA Method 23.
- h. Performance test for the emissions of HF shall be conducted using EPA Method 13A or 13B.
- i. Performance test for the emissions of H<sub>2</sub>SO<sub>4</sub> shall be conducted using EPA Method 8.
- j. Performance test for the emissions of NH<sub>3</sub> shall be conducted in accordance with EPA Conditional Test Method 027.
- k. Performance test for the emissions of O<sub>2</sub>, and CO<sub>2</sub> total (biogenic + non-biogenic) shall be conducted using EPA Method 3, 3A, or 3B.
- l. Performance test for the biogenic CO<sub>2</sub> shall be conducted using American Society for Testing and Materials (ASTM) D6866-08“Standard Test Methods for Determining the Biobased Content of Solid, Liquid, and Gaseous Samples Using Radiocarbon Analysis”, and ASTM D7459-08“Standard Practice for Collection of Integrated Samples for the Speciation of Biomass(Biogenic) and Fossil-Derived Carbon Dioxide Emitted from Stationary Emissions Sources”, or the most current ASTM version, and following the procedures described at 40 CFR Part 98.34
- m. Performance test for the visual determination of the opacity of emissions from each of the following emission units: Boiler 1, Boiler 2, fabric filters' exhaust of Trans 1, Trans 2, Ash, Silo 1, Silo 2, and Silo 4, Gen, and Fire shall be conducted using EPA Method 9.
- n. Performance test for the visual determination of the visible emissions of combustion ash from Trans 1, Trans 2, Ash, and Silo 4 shall be conducted using EPA Method 22.
- o. Performance tests for the drift loss on the cooling tower cells shall be conducted using the isokinetic sampling system with the heated backpack style method (HBIK) to confirm the specified drift loss of the circulating water flow of 0.0005%.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- p. ASME Test Code 34-2007 or approved equivalent for the heating value (i.e., heat content) of the RDF and WDF.

#### **XII. Continuous Emission Monitoring/Continuous Opacity Monitoring**

1. Prior to the initial performance tests and thereafter, the Permittee shall install, calibrate, maintain, and operate the following continuous monitoring systems for each municipal waste combustion unit ( Boiler 1 and Boiler 2):
  - a. Continuous emission monitoring system (CEMS) to measure stack gas NO<sub>x</sub> (measured as NO<sub>2</sub>) and CO.
  - b. CEMS, to measure stack gas SO<sub>2</sub>, and SO<sub>2</sub> at the inlet of the Turbosorp Circulating Dry Scrubber.
  - c. CEMS, to measure total CO<sub>2</sub> (biogenic + non- biogenic) emissions at: (1) the stack; (2) the inlet of the Turbosorp Circulating Dry Scrubber; and (3) each location where CO, SO<sub>2</sub>, and NO<sub>x</sub> are monitored.
  - d. CEMS, to measure O<sub>2</sub> at each location where CO, SO<sub>2</sub>, and NO<sub>x</sub> are monitored
  - e. Continuous opacity monitoring system (COMS), to measure the opacity emissions at the stack.
  - f. In the event EPA promulgates HCL CEMS performance specification before the end of calendar year 2014, the Permittee shall install, calibrate, maintain, and operate CEMS to measure stack gas HCL. Before using CEMS for HCL, the Permittee shall comply with all notifications requirements of 40 CFR Part 60. 58 b (n). In the event that no EPA HCL CEMS performance specifications are promulgated before the end of calendar year 2014, the Permittee shall conduct HCL annual performance test, as it is required at section XI. A.11.b.i of this permit.
2. The CEMS for CO, NO<sub>x</sub>, SO<sub>2</sub>, HCL, O<sub>2</sub>, CO<sub>2</sub>, and the COMS shall comply with all requirements of 40 CFR Part 60.58b.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

3. No less than 90 days prior to the date of startup of the municipal waste combustor units, the Permittee shall submit a written report to EPA of a Quality Assurance Project Plan for the certification of each municipal waste combustor units' CEMS and COMS.
4. The Permittee shall conduct performance evaluations of the COMS, CEMS, and all of the continuous monitoring systems required by this permit at a date no later than the date of the initial performance testing required under this permit. These performance evaluations shall be conducted in accordance with the applicable EPA specifications, including but not limited to, 40 CFR Part 60, Appendix B. The Permittee shall notify EPA 15 days in advance of the date upon which demonstration of the continuous monitoring systems' performance will commence (40 CFR Part 60.13(c)).
5. The Permittee shall submit a written report to EPA of the results of all monitor performance specification tests conducted on the monitoring system(s) within 45 days of the completion of the tests. The continuous monitors must meet all the requirements of the applicable performance specification test in order for the monitors to be certified.

#### **XIII. Other Monitoring Requirements**

##### **A. Determination of Actual CO<sub>2</sub>e Emissions - Municipal Waste Combustors Units and Emergency Equipment**

1. The GHG global warming potentials and the default CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O emission factors used for the calculation of the CO<sub>2</sub>e emissions resulting from the municipal waste combustor units, the RSCR units, the emergency diesel generator, and the emergency fire pump shall be equal with those contained in 40 CFR Part 98.
2. The heating values of the RDF, ASR, PUWW, TDF, distillate fuel oil No.2, and propane used for the calculations of the CO<sub>2</sub>e emissions shall equal the following:
  - a. 11.4 MMBtu/ton for RDF;
  - b. 38.0 MMBtu/ton for ASR;
  - c. 15.38 MMBtu/ton for PUWW;

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- d. 26.87 MMBtu/ton for TDF;
  - e. 0.138 MMBtu/gallon for distillate fuel oil No.2;
  - f. 0.091 MMBtu/gallon for propane;
3. During normal operation, the CO<sub>2</sub>e emissions ( without biogenic CO<sub>2</sub>) for each municipal waste combustor unit and the corresponding RSCR unit shall be determined as follows:
- a. Total CO<sub>2</sub> emissions (biogenic + non-biogenic) shall be measured by CEMS.
  - b. The biogenic portion of the CO<sub>2</sub> emissions from each municipal waste combustor unit shall be measured, every calendar quarter, using ASTM.
  - c. The actual CO<sub>2</sub> emissions (without biogenic) shall be determined by subtracting the biogenic CO<sub>2</sub> portion supplied by the quarterly ASTM measurements from the total CO<sub>2</sub> emissions (biogenic + non-biogenic) supplied by CEMS.
  - d. The CH<sub>4</sub> and N<sub>2</sub>O emissions resulting from each municipal combustor unit and the RSCR unit shall be determined by calculations using:
    - i. Actual measured consumption rates of RFD and WDF for Boiler 1, and Boiler 2; and distillate fuel oil No.2 and propane for the RSCR units.
    - ii. CH<sub>4</sub> and N<sub>2</sub>O default emission factors and fuel heating values specified in this permit.
  - e. CO<sub>2</sub>e emissions shall be determined by adding the CO<sub>2</sub> (without biogenic), CH<sub>4</sub>, and N<sub>2</sub>O emissions.
4. During warmup, and shutdown periods, the CO<sub>2</sub>e emissions for each municipal waste combustor unit and the corresponding RSCR unit, while firing distillate fuel oil No.2, shall be determined as follows:
- a. CO<sub>2</sub> emissions shall be measured by CEMS.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- b. CH<sub>4</sub> and N<sub>2</sub>O emissions shall be determined by calculations using:
    - i. Actual measured distillate fuel oil No.2 consumption rate for each municipal waste combustor unit and RSCR unit, and propane for the RSCR unit; and
    - ii. CH<sub>4</sub> and N<sub>2</sub>O default emission factors and fuels heating value specified in this permit.
  - c. CO<sub>2</sub>e emissions shall be determined by adding the CO<sub>2</sub>, CH<sub>4</sub>, and N<sub>2</sub>O emissions.
5. The CO<sub>2</sub>e emissions for the emergency generator (Gen), and the emergency generator fire pump (Fire) shall be determined separately by calculations based on the:
- a. Actual measured distillate fuel oil No.2 consumption rates.
  - b. CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O emission factors and fuel heating value specified in this permit.
  - c. CO<sub>2</sub>e emissions shall be determined by adding the CO<sub>2</sub>, CH<sub>4</sub>, and N<sub>2</sub>O emissions.

#### **B. Storage Tanks**

- 1. Compliance with the ammonia emission limit of the ammonia storage tank shall be determined by calculations using the storage tank manufacturer's emission factors, and assuming 365 operating days per year, and 24 hours/day.
- 2. Compliance with the volatile organic compounds emission limit of the distillate fuel oil No.2 storage tanks shall be determined by calculations using the EPA's Tanks 4.09d program.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### C. Cooling Tower System

1. The Permittee shall calculate the total hourly particulate emissions using the following equation:
  - a. Cooling tower total particulate emissions (lb/hr) =  
Total Circulating Flow Water Rate (gpm) X 60 minutes/hour X Drift Loss X Density Water (8.34 lb/gallon) X Total Dissolved Solids (ppmw) X 1/1,000,000.
  - b. Total Circulating Flow Water, Drift Loss, and Total Dissolved Solids shall be determined as specified in this permit.
2. The PM, PM<sub>10</sub> and PM<sub>2.5</sub> emissions shall be calculated using the following assumptions:
  - a. PM emissions shall not exceed 94.7% of the total particulate emissions; PM<sub>10</sub> emissions shall not exceed 49.8% of the total particulate emissions; and PM<sub>2.5</sub> emissions shall not exceed 0.17% of the total particulate emissions.

#### D. Fugitive Particulate Emissions Sources

1. Compliance with the fugitive PM, PM<sub>10</sub>, and PM<sub>2.5</sub> emission limits shall be determined by using the emission factors, equations, and assumptions in Section 13.2.1 of the AP-42 Emission Factors, January 2011, for paved roadways. These emission limits shall be determined based on the actual vehicle miles traveled on site per day, 365 days of operation per year, and 80% control efficiency for PM, PM<sub>10</sub> and PM<sub>2.5</sub> from using dust suppression measures specified in this permit.

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

**E. Heat input rate, and refuse-derived fuel consumption rate “12-month rolling average” limit.**

1. The "12-month rolling average" limit as used in this permit shall mean the average of the 12 successive calendar months of the municipal waste combustors units' operation.
2. The "12-month rolling average" of heat input rate (MMBTU/hr) shall mean the average MMBTU/hr determined at the conclusion of each calendar month, by calculating:
  - a. For each municipal waste combustor unit, the sum of the hourly heat input rate during the calendar month (while the boiler is operating on RDF or WDF) divided by the number of hours of operation within the month to obtain a monthly heat input (MMBTU/hr) average; and
  - b. The average heat input rate (MMBTU/hr) of the current month and the previous 11 successive months to obtain the 12-month rolling average heat input rate (MMBTU/hr).
3. The "12-month rolling average" RDF consumption rate (TPD) shall mean an average consumption rate determined at the conclusion of each calendar month by calculating:
  - a. For each municipal waste combustor unit the sum of tons of RDF combusted during the calendar month, divided by the number of days within the month to obtain a monthly RDF consumption rate (TPD) average; and
  - b. The average RDF consumption rate(s) of the current month and the previous 11 successive months to obtain the 12-month rolling average RDF consumption rate (TPD).

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

#### **F. Heat rate (MMBtu/MW-hour) and lb of CO<sub>2</sub>e/lb steam “30-day rolling average” limits.**

1. The “30-day rolling average” limit as used in this permit shall mean the average of 30 successive municipal waste combustor units operating days.
2. The term “operating day”, as used in this permit, shall mean any day the municipal waste combustors units combust any RDF or WDF.
3. The “30-day rolling average” of MMBtu/MWh and lb CO<sub>2</sub>e/lb of steam shall be determined by calculating the arithmetic average of all hourly MMBtu/MWh or lb of CO<sub>2</sub>e/lb of steam recordings for the current municipal waste combustor operating day and the previous 29 municipal waste combustor operating days.

#### **XIV. Recordkeeping Requirements**

1. Logs shall be kept and updated daily to record the following:
  - a. Amount of refuse-derived fuel, waste-derived fuel, and each supplementary fuel consumed by each municipal waste combustor unit, in tons per day.
  - b. Amount of the distillate fuel oil No.2 and propane, for Boiler 1, Boiler 2, Gen, Fire, and each RSCR unit, in gallons per day.
  - c. Number of hours of operation for Boiler 1, and Boiler 2.
  - d. Beginning, duration, and completion of each warmup, shutdown, malfunction, and excess emissions events.
  - e. Reason and amount of time (hours per day) the emergency generator, and emergency fire pump was in operation (i.e., emergency service or maintenance or testing).



## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- f. All instances when visible emissions were observed from any emission unit, including the fugitive particulate emission sources, and the corrective actions taken.
  - g. Type and quantity of water treatment chemicals used in the cooling water system on a monthly basis including all material data safety sheets associated with each chemical.
  - h. All checks, inspections, and all maintenance work, repairs, adjustments, and calibrations done for the emission units, air pollution control equipment, and monitoring systems or devices.
  - i. Each pressure drop deviation investigation and corrective action taken.
  - j. Each event of the audible alarm sounds on the bag leak detectors system. The records shall include the date, time, duration, cause, and the action taken in response to the alarm.
  - k. For each distillate fuel oil No.2 and propane delivery, documents from the fuel supplier certifying compliance with the fuel sulfur content limit specified in this permit
  - l. ASR and PUWW supplier's documentation and analysis reports required by this permit.
  - m. All calculations, opacity readings, measurements, and results of all monitoring systems and devices, performance tests, and CEMS summaries and information related to emission determinations, and other parameters required by this permit.
  - n. Logs shall be kept and updated daily to record, for each ammonia delivery, documents from the ammonia supplier certifying compliance with the 19% ammonia by volume specified in this permit.
2. Logs shall be kept and updated periodically to record the following:
- a. For the life of the storage tanks, records that include the dimensions and capacity of each tank authorized by this permit.

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- b. Manufacturer technical documentation that includes:
  - i. Emission factors for the ammonia storage tank.
  - ii. Maximum design air flow rate of each fabric filter.
  - iii. Model year, power output and emission factors of the emergency equipment.
- 3. All recordkeeping requirements required by this permit shall comply with the provisions of 40 CFR Part 60, Subpart A, Eb, and other Subparts as applicable. All records and logs required by this permit, must be maintained for a period of five years after the date of record, and made available upon request.

#### **XV. Reporting Requirements**

- 1. For the purposes of this permit, excess emissions shall be defined as any period in which the facility emissions exceeded the emission limits set forth in this permit. Excess emissions indicated by monitoring systems, source testing or compliance monitoring shall be considered violations of the applicable emission limits.
- 2. The Permittee shall submit a written report of all excess emissions to EPA for every calendar quarter. All quarterly reports shall be postmarked by the 30<sup>th</sup> day following the end of each quarter and shall include the information specified below:
  - a. The magnitude of excess emissions computed in accordance with 40 CFR Part 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions;
  - b. The specific identification of each period of excess emissions that occurs during warmup, shutdown, and malfunctions for Boiler 1 and Boiler 2. The nature and cause of any malfunction and the corrective action taken or preventive measures adopted shall also be reported;

## ENCLOSURE I

### ENERGY ANSWERS ARECIBO, LLC ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT

#### Final Permit

- c. The date and time identifying each period during which the continuous monitoring system was inoperative, except for zero and span checks, and the nature of the system repairs or adjustments.
  - d. When no excess emissions have occurred or the CEM system has not been inoperative, repaired, or adjusted, such information shall be stated in the report.
  - e. Results of quarterly monitor performance audits, as required in 40 CFR Part 60, Appendix F (including the Data Assessment Report) and all reporting specified in 40 CFR Part 60.7 including the submission of excess emissions and CEMS downtime summary sheets.
3. Malfunction means any sudden infrequent and not reasonably preventable failure of an air pollution control equipment, process equipment, or process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.
4. All malfunctions of any emission unit must be reported within 24 hours by telephone or e-mail to the Chief of Inspection and Compliance Division of the PREQB office listed below.
5. A follow-up letter must be submitted within 5 calendar days after each malfunction to the Chief, PREQB at the address listed below. A copy shall be submitted to Director, Caribbean Environmental Protection Division of the U.S. Environmental Protection Agency, Region 2 Office. The letter shall include: a description of the malfunctioning equipment or abnormal operation; the date of the initial failure; the period of time over which emissions were increased due to the failure; the cause of the failure; the estimated resultant emissions in excess of those allowed under this permit; and the methods utilized to restore normal operations. Compliance with this malfunction notification provision shall not excuse or otherwise constitute a defense to any violations of this permit or of any law or regulations, which such malfunction may cause.
6. The quarterly excess emission reports required in this section shall be sent to the following EPA and PREQB personnel:

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

Region 2 CEM Coordinator  
AWQAT MS-220, Monitoring and Management Branch  
U.S.EPA Region 2  
2890 Woodbridge Avenue  
Edison, New Jersey 08837

Director, Caribbean Environmental Protection Division  
U.S. Environmental Protection Agency, Region 2 Office  
City View Plaza III-Suite 7000  
#48 Rd. 165 km 1.2  
Guaynabo, PR 00968-8069  
(787) 977-5870

Chief, Compliance and Inspection Division Air Quality Area  
Puerto Rico Environmental Quality Board  
P.O. Box 11488  
San Juan, PR 00910  
(787)767-8181  
E-mail : [complianceAQA@jca.pr.gov](mailto:complianceAQA@jca.pr.gov)

7. All reporting requirements required by this permit shall comply with the provisions of 40 CFR Part 60, Subpart A, Eb, and other Subparts as applicable. All emission reports, testing reports and start-up notifications required under this permit shall be submitted to Director, Caribbean Environmental Protection Division, U.S. EPA, Region 2 at the address listed above.

**ENCLOSURE I**

**ENERGY ANSWERS ARECIBO, LLC  
ARECIBO PUERTO RICO RENEWABLE ENERGY PROJECT**

**Final Permit**

8. Copies of all reports and Quality Assurance Project Plans shall also be submitted to:

Region 2 CEM Coordinator  
AWQAT MS-220, Monitoring and Management Branch  
U.S.EPA Region 2  
2890 Woodbridge Avenue  
Edison, New Jersey 08837

Chief, Compliance and Inspection Division Air Quality Area  
Puerto Rico Environmental Quality Board  
P.O. Box 11488  
San Juan, PR 00910

**XVI. Other Applicable Requirements**

The Permittee shall construct and operate the facility in compliance with all other applicable provisions of federal and state regulation, including but not limited to those contained in the Puerto Rico State Implementation Plan (SIP), the applicable provisions of the New Source Performance Standards (NSPS) (including 40 CFR Part 60, Subparts A, Da, Eb, and IIII), and the National Emissions Standards for Hazardous Air Pollutants (NESHAP) (including 40 CFR Part 63, Subpart ZZZZ).