



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY
REGION 8

1595 Wynkoop Street
DENVER, CO 80202-1129
Phone 800-227-8917
<http://www.epa.gov/region08>

2011 MAR -4 PM 2: 14

MAR 04 2011

FILED
EPA REGION VIII
HEARING CLERK

Ref: 8ENF-W

CERTIFIED MAIL LETTER
RETURN RECEIPT REQUESTED

Centennial Water and Sewer District
c/o Ron Copenhaver, Chairman
P.O. Box 185
Centennial, WY 82055

Re: Administrative Order #2 Addendum
Docket No. SDWA-08-2011-0016
Centennial Water and Sewer District
Public Water System
PWS ID# WY5601232

Dear Mr. Copenhaver:

According to paragraph 13 of the Administrative Order (Order) EPA issued on January 26, 2011, the Centennial Water and Sewer District (the District) was required to submit a plan for bringing its public water system into compliance with the total coliform maximum contaminant level (MCL) within 30 days after receipt of the Order. On February 16, 2011, EPA received a summary of events and description of system optimization efforts that have occurred since the District exceeded the MCL for total coliform bacteria during August, September, and October of 2010. Specifically, the water system was shock chlorinated and the levels of chlorine were optimized with the help of Mike Sposit from EPA.

At this time, EPA approves of the continuation of these optimization efforts and will not require the District to submit a compliance plan and schedule. However, should the District again exceed the MCL for total coliform while this Order is open, a compliance plan and schedule will be required within 30 days after lab notification of the MCL exceedance.

In addition, in order to ensure that disinfected water is supplied throughout the distribution system, EPA is requiring additional chlorine residual monitoring as described below:


Upon receipt of this Addendum, take chlorine residual measurements at 3 different sampling points in the distribution system once per week for 6 weeks and provide results to EPA within 5 days after the end of every 3rd week. EPA will discuss these results with you and determine if any additional actions may be needed. These chlorine residual measurements are in addition to routine chlorine residual monitoring taken with monthly bacteriological samples.

Please be advised that the District is required to comply with all other provisions of the Order. Penalties for failing to comply are set forth in the Order. Please contact Shawn McCaffrey at (303) 312-6515 if you have any questions. If you are represented by an attorney, please ask your attorney to call Marc Weiner at the above 800 number, extension 6913, or at (303) 312-6913.

Sincerely,



Darcy O'Connor, Acting Director
Water Technical Enforcement Program
Office of Enforcement, Compliance
and Environmental Justice

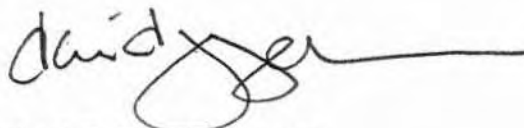

Michael T. Risner, Director
David Janik, Supervisory Attorney
Legal Enforcement Program
Office of Enforcement, Compliance
and Environmental Justice

cc: Dallas Talbott, Operator
Tina Artemis, EPA Regional Hearing Clerk
Wyoming DEQ (via email)
Wyoming DOH (via email)