

Maryland Department of the Environment

Oil Control Program, Suite 620, 1800 Washington Blvd., Baltimore MD 21230-1719
410-537-3442 410-537-3092 (fax) 1-800-633-6101 x3442 <http://www.mde.state.md.us>

MDE

Underground Storage Tank System Compliance Inspection Report

MDE

Instructions: Only a person currently certified by the Maryland Department of the Environment in UST Inspection shall complete this report. Detailed instructions on how to complete this form are provided in MDE's "UST Operations Inspector Reference Handbook," which is available at: Use a

second form for facilities with more than 5 tanks. Type or Print all information with blue or black ink.

Section 1: General Information

Facility Name: Commercial Fuel Systems, Inc.						
Location Address: 930 Port Street						
City: Easton						
Telephone No (410) 310-3553						
Owner Name: Tim Miller						
Mailing Address: 28102 Baileys Neck Road						
City, State, Zip: Easton, MD 21601						
Telephone No.: (410) 310-3553						
Fax No.:						
E-Mail:						
Operator Name:						
Telephone No.:						
Fax No.:						
E-Mail:						
MDE Facility ID Number:	Date of Inspection: mm/dd/yyyy	Current UST Registration Certificate on display or available onsite?	All applicable tanks registered?	Site located in High Risk Groundwater Use Area? *	Site or neighbor supplied by a potable Well? *	Owner/Operator has provided approved documentation to demonstrate Financial Responsibility?
1656	05/01/2015	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No If yes, attach FR proof to this form.

Inspection Summary

Tank System ID Number as listed on MDE UST Registration Form	Section No	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
Owner Tank ID # (if different)						
Fill out the following using these codes: P=Pass Inspection, PC=Pass w/corrections, F=Fail Inspection, NA= Not Applicable						
Status: (Temporarily Out of Use)	(3.)	F	F	F	F	F
Containment Sump Inspection	(4a.)	NA	NA	NA	NA	NA
Dispenser Inspection	(4b.)	F	F	F	F	F
Tank Top Inspection	(5a.)	P	P	P	P	P
Vent Pipe Inspection	(5b.)	F	F	F	F	F
Spill Prevention	(6a.)	F	F	F	F	F
Overfill Prevention	(6b.)	P	P	P	P	P
Stage I Vapor Recovery	(7a.)	NA	P	NA	P	P
Stage II Vapor Recovery	(7b.)	NA	NA	NA	NA	NA
Piping Construction and Corrosion Protection	(8.)	F	F	F	F	F
Tank Construction and Corrosion Protection	(8.)	F	F	F	F	F
Tightness Testing	(9.)	F	F	F	F	F
Facility House Keeping	(10a.)	P	P	P	P	P
Tank Field Monitoring Pipes and Site Wells	(10b.)	F	F	F	F	F
Inventory Control	(11.)	F	F	F	F	F
Tank Release Detection	(12.)	F	F	F	F	F
Piping Release Detection	(12.)	F	F	F	F	F
Operator Training	(14)	F	F	F	F	F
Inspector and Owner/Operator has signed page 2 and initialed page 24				<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Addendum Form Used				<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		

Section 1: General Comment


§ 4- 17 Environment Article, Annotated Code of Maryland

(c) False statements in required documents; tampering with monitoring devices. Any person who knowingly makes any false statement, representation, or certification in any application, record, report, plan, or other document filed or required to be maintained under this title, or by any permit, rule, regulation or order issued under this title, or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this title or by any permit, rule, regulation, or order issued under this title, upon conviction, is subject to a fine not exceeding \$10,000, or by imprisonment not exceeding six months or both.

Certified Inspector: (print) Daniel Outten
Company: Outten Petroleum, inc
Certification No.: MDIC 2012-0083
Expiration. Date 10/01/2016
Telephone No.:
Facsimile No.:
E-mail address:

****High Risk Groundwater Use Area (HRGUA)** means all areas served by individual wells. Existing UST systems installed prior to 1/26/05 in Baltimore, Carroll, Cecil, Frederick and Harford counties or New UST systems installed after 1/26/05 in Anne Arundel, Baltimore, Carroll, Cecil, Charles, Calvert, Frederick, Harford, Howard, Montgomery, and Prince George's counties.

The MDE UST database will be updated with information listed in this inspection report and any amended facility registration form unless additional forms are required by regulation.

<p>Certified Inspector: I, the Maryland Certified Inspector, have performed this UST Inspection and believe the contents of this report to be true and accurate without misrepresentation or falsification. As well, I have no financial interest with this UST Facility.</p> <p>Print Name: Daniel Outten Signature:  Date: 05/01/2015</p>	<p>Owner/Operator or Designated Representative I, the Owner/Operator/Designated Representative (circle one), have read this Inspection Report and understand the condition of my UST facility, including all deficiencies, corrections, and recommendations.</p> <p>Title: _____ Print Name: _____ Signature: _____ Date: 05/01/2015</p>
---	---

<p>Mail REPORT To: MDE Oil Control Program Suite 620 1800 Washington Blvd. Baltimore MD 21230-1719</p>	<p>Questions? Call MDE Oil Control Program at 410-537-3442 See our web page at:</p>
--	--

MDE Use Only	
Certification Section – Reviewed By _____	
Date Reviewed _____	Pass _____ Fail _____
Comments _____	
Data Clerk's Initials _____	Date Entered _____

Section 2: Tank System Information

Fill out the tank number for each tank but only use the MDE Tank ID numbering system. Use (✓) box if information is obtained from facility registration form.

Tank and Piping (MDE ID#)	(✓)	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
Owner Tank ID # (if different)	<input type="checkbox"/>					
Status (I-in use or T-temp. out of use)	<input type="checkbox"/>	T	T	T	T	T
Date of Installation (month/year)	<input checked="" type="checkbox"/>	1-1-1994	1-1-1994	1-1-1994	1-1-1994	1-1-1995
Capacity (gallons)	<input type="checkbox"/>	8,000	8,000	4,000	4,000	8,000
Product (see Chart A below for code and list each compartment tank product separately)	<input type="checkbox"/>	1	2	1	2	2
Tank Construction Material (sec Chart B for code)	<input checked="" type="checkbox"/>	2	2	2	2	2
Compartment Tank (Yes/No) (If Yes, list capacity of each compartment separately)	<input type="checkbox"/>	NO /	NO /	4000 / 4000	4000 / 4000	NO /
Double-Wall Tank (Yes/No)	<input type="checkbox"/>	NO	NO	NO	NO	NO
Piping Type (SS) safe suction; (US) U.S. suction (G) gravity; (P) pressure	<input type="checkbox"/>	P	P	P	P	P
Piping Construction Material (see Chart C for code)	<input type="checkbox"/>	1	1	1	1	1
Double-Wall Piping (Yes/No)	<input type="checkbox"/>	NO	NO	NO	NO	NO
Outer Wall Pipe Construct. Material (see Chart C for code)	<input type="checkbox"/>	NA	NA	NA	NA	NA
Emergency Power Generator UST (Yes/No)	<input type="checkbox"/>	NO	NO	NO	NO	NO
Global Position Signal – Only one set of coordinates is to be collected while standing over the center of each tank field.	Tank Field #1		Tank Field #2		Tank Field #3	
	Latitude:	Longitude:	Latitude:	Longitude:	Latitude	Longitude:
List tank MDE ID # for each tank field according to MDE Registration Form.						

Section 2: Tank System Information continued on Page 4

CHART A

CODE	PRODUCT DESCRIPTION
1	Diesel
2	Gasohol E-10
2a	Ethanol E-85
2b	Methanol
3	Gasoline
4	Hazardous Substance
5	Heating Oil # 2
5a	Heating Oil # 4
5b	Heating Oil # 5
5c	Heating Oil # 6
6	Kerosene
7	Mixture
8	Used Oil
9	Car Wash O/W Separator UST
10	Other (Must Describe)

CHART B

CODE	TANK MATERIAL DESCRIPTION
1	Asphalt Coated or Bare Steel
2	Cathodically Protected Steel
3	Composite (Steel w/FRP)
4	Concrete
5	Epoxy Coated Steel
6	Fiberglass Reinforced Plastic (FRP)
7	Polyethylene Tank Jacket
8	Other (Must Describe)

CHART C


CODE	PIPING MATERIAL DESCRIPTION
1	Bare Steel
2	Galvanized Steel
3	Fiberglass Reinforced Plastic (FRP)
4	Copper
4a	Copper-s/d. in PVC, FRP or Plastic
5	Flexible Plastic
6	No Piping
7	Other (Must Describe)

Section 2: Tank System Information (cont'd.)

Diagram: Show layout of site and all UST systems.

KEY/LEGEND (Include if applicable)

- | | |
|--|---------------------------------------|
| (BLD) Building location | ⊗ Monitoring well |
| (TF) Tank Field | (CP) Cathodic protection test station |
| (T #) Tanks (including all compartments) with MDE tank ID #s | ↑ North arrow |
| (P) Product piping | ≡ Roads bordering property |
| (PS) Piping sumps | (DB) Dry Break/Stage I vapor recovery |
| (D) Dispenser | (STP Sump) Submersible Turbine Pump |
| (V) Vent pipe | (ATG Probe) Automatic Tank Gauge |
| (●) Tank field monitoring pipe | (FP) Fill Pipe |
| (ESO) Emergency Shutoff Switch | (AN) Impressed current anodes |

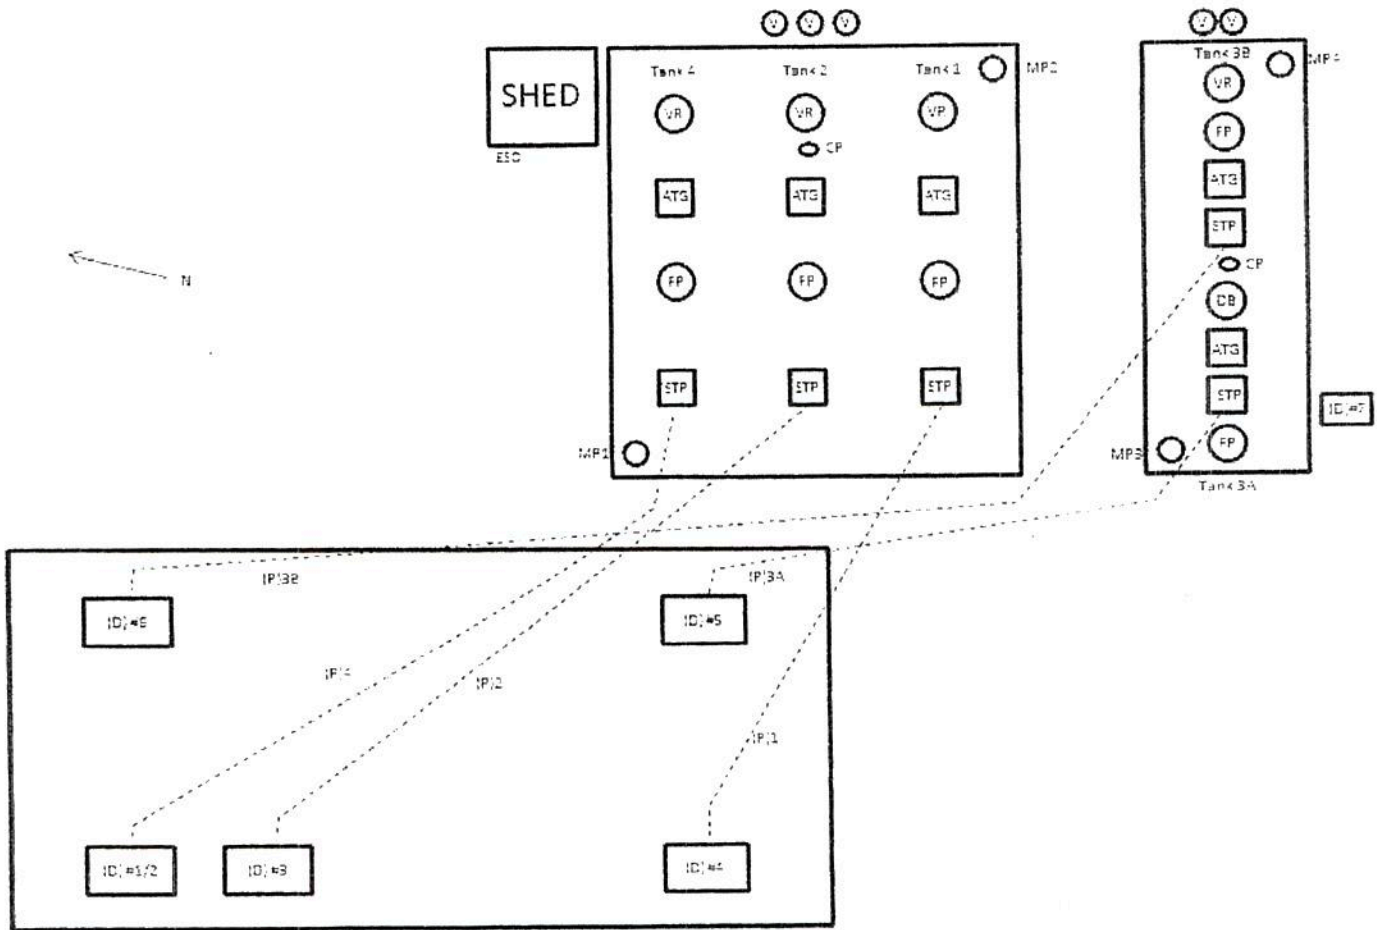

Section 3: Tank Temporarily Closed or Taken Out of Service

Fill out this section for any tank that is "temporarily closed" or "taken out of service" (empty, out of use). A complete inspection of these tanks is required. This section does not apply to a tank that is currently in use or permanently out of use.

Applicable
 Not Applicable

#	Answer all (P)ass, (F)ail (PC), or (NA) for each Tank	Tank #1	Tank #2	Tank #3A	Tank #3B	Tank #4
1	Tank contains less than 1" of product.	F	F	F	F	F
2	Tank vented and fill pipe locked.	P	P	P	P	P
3	Date temp. closed or taken out of service (Month/Day/Year).	F	F	F	F	F
4	UST closed 3 months or more, drain and cap product lines and secure other lines, pumps, and manways (vent line open and operating).	F	F	F	F	F
Temporarily Closed Tank(s) passes inspection.		F	F	F	F	F
Questions 1,2 and 4 are (P) or (PC)		F	F	F	F	F

Section 4: Containment Sump and Dispenser Inspection

Applicable
 Not Applicable

4.a. Containment Sump Inspection

#	Complete 1 and 8. Answer (P)ass, (PC), (F)ail or (NA) for 2 - 7 (each tank)	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	(√)Equipped with containment sump dispenser - tank top - vent riser - Stage two-condensate pod - Other - Specify in comments -	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2	All containment sumps are clean and free of debris, product, and water.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3	All manway covers and containment sump lids are properly fitted and not in contact with cap, piping, or pump.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4	All containment sumps have no visible cracks, holes, or openings.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
5	If sump equipped with liquid sensor the sensor is properly secured and within 1" of sump bottom or meets manufacturer's specifications.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
6	If equipped with double-wall piping, test boot is open to allow product flow to sump.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
7	Containment sump has been tested within past 5 years with passing results.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
8	Enter Date of last containment sump test.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Containment Sump passes inspection.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Questions 2 - 7 are (P) or (PC)		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Note: If answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

Comments:

<input checked="" type="checkbox"/>	Applicable
<input type="checkbox"/>	Not Applicable

Section 4: Containment Sump and Dispenser Inspection (cont'd.)

4.b. Dispenser Inspection

#	Answer (P)ass, (PC), (F)ail or (NA) for each dispenser	Disp. # 1&2	Disp.# 3	Disp.# 4&5	Disp. # 6	Disp. # 7
1	Dispenser in good condition and properly secured to pump island.	P	P	P	P	P
2	Shear valve (pressure system) properly secured and shear section within 1/2" of top of pump island or manufacturer specifications.	P	P	P	F	F
2a.	Fusible link or other thermally actuated device properly connected.	P	P	P	P	P
2b.	Product pipe manifold installed above the shear valves.	Circle one) Y / <input checked="" type="radio"/>	Circle one) Y / <input checked="" type="radio"/>	Circle one) Y / <input checked="" type="radio"/>	Circle one) Y / <input checked="" type="radio"/>	Circle one) Y / <input checked="" type="radio"/>
3.	Shear valve (Stage II piping) properly secured and shear section within 1/2" of top of pump island by manufacturer specifications or with flex connector.	NA	NA	NA	NA	NA
4	Dispenser hose in good condition with no cuts, or holes and equipped with breakaway device.	P	P	P	P	P
5	Dispenser hose properly secured and not subject to damage from vehicle traffic (hose retractor).	P	P	P	P	P
6	Emergency shut-off present.	P	P	P	P	P
6a.	Emergency shut-off properly identified.	P	P	P	P	P
6b.	Emergency shut-off in correct location.	P	P	P	P	P
7	Dispenser is not leaking product.	P	P	P	P	P
8	Flex connector observed under dispenser. If in contact with soil, complete Section 8.	(Circle one) Y / <input checked="" type="radio"/>	(Circle one) Y / <input checked="" type="radio"/>	(Circle one) Y / <input checked="" type="radio"/>	(Circle one) Y / <input checked="" type="radio"/>	(Circle one) Y / <input checked="" type="radio"/>
9	Marina Hold open device has been removed from nozzle.	NA	NA	NA	NA	NA
Dispenser passes inspection. Questions 1 – 7 and 9 are (P) or (PC) and 2b. No		P	P	P	F	F

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

If more than 5 dispensers include additional copies of this page.

Comments:

SHEAR VALVE IS NOT SECURE. U BOLT IS AROUND THE PIPE AN NOT THE SHEAR VALVE. NOTE STEAL PIPE UNDER SHEAR VALVES. FOUND NO FIBERGLASS OR FLEX CONNECTORS.

Section 5: Tank Top Components and Vent Pipe Inspection

5.a. Tank Top Inspection

#	Complete 1-3. Answer (P)ass, (PC), (F)ail or (NA) for 1a, 1b, and 4 -7 for each tank	Tank #	Tank #	Tank #	Tank #	Tank #
		1	2	3A	3B	4
1	Storage tank equipped with ATG? If Yes, complete 1a., 1b.	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N
1a.	ATG riser is capped and electrical connection secure with proper grommet.	P	P	P	P	P
1b	ATG manway lid properly fitted and not in contact with riser or electrical wires.	P	P	P	P	P
2	Flex connector present on STP? If in contact with soil complete Section 8.	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0
3	Interstice monitoring system (double wall tank) or inspection station present?	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0	(Circle one) Y / 0
4	Ball Float riser and other riser pipes are fitted with proper caps; manway covers are not in contact with cap or riser pipe.	P	P	P	P	P
5	No petroleum vapors present during ATG, Ball Float, or Vent riser inspection, or STP without sump.	P	P	P	P	P
6	Note all vapor field readings if taken for ATG, Ball Float, or Vent riser, or STP without sump.	0	0	0	0	0
7	Marina. Each pipeline has a readily accessible shut-off valve grouped at one location on shore near approach to pier or dock and marked "emergency shut-off"?	NA	NA	NA	NA	NA
Tank Top Components passes inspection. Questions 1a., 1b. and 4 - 7 are (P) or (PC) and 3 yes or component not required		P	P	P	P	P

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

Comments:

NOTE FOUND NO FLEX CONNECTORS AT THE STP'S. FOUND STEEL PIPE LEAVING BOX. FOUND NO FIBERGLASS PIPE.

5.b. Vent Pipe Inspection

#	Answer (P)ass, (PC), (F)ail or (NA) for each vent	Tank#	Tank#	Tank #	Tank #	Tank #
		1	2	3A	3B	4
1	Vent pipe riser is constructed of steel?	P	P	P	P	P
2	Vent pipe is properly anchored and protected from vehicle traffic (bollards or secured to building)?	F	F	F	F	F
3	Vent pipe is proper height (flammable liquids 12 feet above ground surface and 2 feet above any attached building). (Combustible liquids minimum 3 feet above ground surface)?	P	P	P	P	P
4	Equipped with vent cap (flammable liquid with Stage I vapor recovery must have pressure vent cap)?	P	P	P	P	P
Vent passes inspection. Questions 1 - 4 are (P) or (PC)		F	F	F	F	F

Note: If the answer to any questions is (F), explain below. List any problems noted during inspection. Note corrections.

Comments:

VENTS STACKS ARE SECURED BUT ARE NOT PROTECTED FROM TRAFFIC.

Section 6: Spill and Overfill

6.a. Spill Device

#	Answer (P)ass, (PC), (F)ail or (NA)	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	Equipped with minimum 5-gallon catch basin. (Note: Used oil and heating oil USTs installed, upgraded, or replaced after 11-4-96 require catch basin).	P	P	P	P	P
2	Basin clean and free of debris and water.	P	P	P	P	P
3	Basin has no cracks or holes observed.	P	P	P	P	P
4	No abnormalities observed in fill pipe. (No bent drop tubes, no cracks or holes observed in basin especially at connection to tank and spill device).	P	P	P	P	P
5	Basin lid fits properly and not in contact with fill cap.	P	P	P	P	P
6	Fill pipe marked to indicate size of tank/type of product stored or Lid contains API color symbol w/posted sign to indicate tank size and type of product within delivery driver view.	P	P	P	P	P
7	Catch basin tested within past year with passing results in accordance with Maryland Containment System Testing Protocol.	F	F	F	F	F
7a.	Date of last test:					
8	Spill device not required: (Tank receives less than 25-gallons of petroleum per delivery or heating oil UST installed prior to 11-4-96 is not required to have a spill device). If not required indicate (P).	NA	NA	NA	NA	NA
Spill device passes inspection. Questions 1 – 8 are (P) or (PC)		F	F	F	F	F

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

Comments:

NO CURRENT TEST RESULTS AT TIME OF INSPECTION.

Section 6: Spill and Overfill (cont'd.)

6.b. Overfill Device

#	Complete 2 – 4. Answer (P)ass, (PC), (F)ail or (NA) for 1 and 5 – 9	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	Fill drop tube required and observed.	P	P	P	P	P
2	Overfill device present (list all present): Flapper Valve (FV), Ball Float Valve (BFV), High Level Alarm (HLA), Other Describe.	BFV	BFV	BFV	BFV	BFV
3	Indicate delivery method—gravity (G) or pump flow (PF).	G	G	G	G	G
4	Owner/Operator ensures releases due to spilling or overfilling do not occur? For example, product is measured prior to each delivery to ensure enough room in tank for product and all fuel deliveries are monitored.	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N
5	Visually observed overfill device housing, documentation of installation provided, OR certification provided from a certified UST installer attesting to overfill device operability.	P	P	P	P	P
6	Tank receives less than 25-gallons of petroleum per delivery or heating oil UST installed prior to 11-4-96 is not required to have an overfill device.	NA	NA	NA	NA	NA
7	Drop Tube Flapper Valve Visual observation indicated flapper valve is present, with no obstruction in the drop tube that would render the device ineffective. *					
8	Ball Float Valve / Vent Restrictor Compatible with UST system configuration, delivery, and use. **	P	P	P	P	P
9	Audible External high level alarm only Visual and audible alarm present to the driver at the point of transfer.					
Overfill device passes inspection. Question 4 is yes and 1 and 5–9 (as applicable) are (P) or (PC)		P	P	P	P	P

Note: If the answer to any question is No (N) or (F), explain below. List any problems noted during inspection. Note corrections.

*A fill pipe that utilizes a flapper valve in the drop tube for overfill purposes and receives a pressure delivery product drop, shall have a specific flapper valve designed for that use.

** If a UST system has one or more of the following, the owner or operator of the system shall not use a ball float valve on that system: (1) a tank that receives a pumped delivery; (2) suction piping with air eliminator; (3) remote fill pipes and gauge openings; (4) an emergency generator tank; (5) coaxial drop fill adapter.

Comments:

Section 7: Stage I and II Inspection

Note: Stage I and II vapor recovery inspections also include completing and submitting Section 7c. forms to MDE's Air and Radiation Management Administration.

7.a. Stage I Vapor Recovery

<input checked="" type="checkbox"/> Applicable
<input type="checkbox"/> Not Applicable

#	Complete 1 & 2 Answer (P)ass, (PC), (F)ail or (NA) for 3 - 6a. for each tank	Tank #1	Tank #2	Tank #3A	Tank #3B	Tank #4
1	Is tank equipped with vapor recovery? (Yes) / (No) or (N/A). (If Yes for any tank, complete 2 through 6a. and section 7c.). Stage I required Statewide	NA	YES	NA	YES	YES
2	Type of vapor recovery: A - Coaxial B - 2 point system	NA	B	NA	B	B
3	Dry break vapor cap and gasket in good condition?	NA	P	NA	P	P
4	Poppet valve in dry break moves easily and closes tight?	NA	P	NA	P	P
5	Vapor recovery connection equipped with minimum 5-gallon catchment basin. (If installed after July 1, 1998). (If 5 is N/A complete 5a. & 5b.).	NA	NA	NA	NA	NA
5a.	There are no petroleum vapors or staining in soil or pea gravel around vapor recovery riser pipe.	NA	P	NA	P	P
5b.	Note all field readings if taken.	0	0	NA	0	0
6	Catchment basin tested within the past year with passing results.	NA	NA	NA	NA	NA
6a.	Date of last test.	NA	NA	NA	NA	NA
Stage I Passes Inspection. Question 1 is Y or NA and Questions 3 - 6a. are (P) or Stage I not applicable or (PC)		NA	P	NA	P	P

Comments:

7.b. Stage II Vapor Recovery

<input type="checkbox"/> Applicable
<input checked="" type="checkbox"/> Not Applicable

#	Answer for each tank	Tank #1	Tank #2	Tank #3A	Tank #3B	Tank #4
1	Does the storage system have Stage II? Yes or No. (If Yes, complete 2 and 3 and Section 7c, If No and Stage II is decommissioned complete 4 - 4.b and 7c).	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N	(Circle one) Y / N
2	Type of vapor recovery: Balance System -(BS) Vacuum Assist -(VA)					
3	UST system equipped with pressure control system and continuously monitors tank pressures.	Y / N	Y / N	Y / N	Y / N	Y / N
4	Stage II vapor recovery system decommissioned on all gasoline USTs?	Y / N	Y / N	Y / N	Y / N	Y / N
4a.	MDE Notification of Intent to Decommission or Not Install Stage II System form is available?	Y / N	Y / N	Y / N	Y / N	Y / N
4b.	Date of Stage II Decommission. (mm/dd/yy)					
Stage II Passes Inspection. Question 1 is (Y) complete 2 or Question 1 is No and 4, 4a. and 4b. is complete or Stage II not applicable						

Comments:

Section 7: Stage I and II Inspection (cont'd.)

7.c. Air and Radiation Management Administration Inspection Report
 (Submit completed copy of pages 11 & 12 to Air and Radiation Management Administration)

Maryland Department of the Environment
 Air and Radiation Management Administration
 Suite 715, 1800 Washington Boulevard
 Baltimore MD 21230
 410-537-3231

**STAGE I AND II VAPOR RECOVERY SYSTEMS
 INSPECTION REPORT**

Owner: Tim Miller	Operator/Lessee:
Address: 28102 Baileys Neck Road	Address:
Telephone: (410) 310-3553	Telephone:

Stage I Vapor Recovery System

Condition of Fill:	Tank Vent Condition: Location, height, protected from traffic and weather? Yes <input type="checkbox"/> No <input type="checkbox"/>
Witness Fuel Drop: Yes <input type="checkbox"/> No <input type="checkbox"/>	Fill and Vapor Swivel Adaptor Installed: Y <input type="checkbox"/> N <input type="checkbox"/>
Comments:	Comments:

Stage II Vapor Recovery System

EQUIPMENT (No. Present)	Vapor Balance System / Vacuum Assist System (Circle One)	
	MANUFACTURER	MODEL NUMBER
Nozzles:		
Hoses:		
Dispensers:		
Date Stage II Installed:		

TEST REQUIREMENTS

Balance System
 Liquid Blockage: Pass Fail Date _____
 Leak Test: Pass Fail Date _____
 Dynamic Back Pressure: Pass Fail Date _____

Vacuum Assist System
 Liquid Blockage: Pass Fail Date _____
 Leak Test: Pass Fail Date _____
 Air to Liquid Ratio: Pass Fail Date _____

Frequency
 Liquid Blockage: Every 5 years
 Dynamic Backpressure: Annually
 Leak Test: Annually
 Air to Liquid Ratio: Annually

Notify the MDE in writing within 5 days of ANY TEST FAILURE, including pre-tests.

Healy Vacuum Assist System: Model 400 - Nozzle Regulation Test: Pass Fail Date _____
 Vapor Return Line Tightness Test: Pass Fail Date _____
 Model 600 & 800 - Air to Liquid Ratio Test: Pass Fail Date _____
 Vapor Return Line Vacuum Integrity Test: Pass Fail Date _____

Equipment Inspection (include description, i.e. good, ok, cracked hose, etc.)

MPD #1	#5
#2	#6
#3	#7
#4	#8
Comments:	Comments:

*** Operator must inspect equipment daily. Verify log is being kept.**

**Section 7.c.: Air and Radiation Management Administration Inspection Report
RECORDKEEPING**

Operator shall keep daily inspection logs, test reports, permits, violation notices, Department correspondence, training records, and other relevant information on-site (5-year retention).
Complete Incomplete

Maintenance Records (2-year retention)
Complete Incomplete

Comments

INSTRUCTIONAL SIGNS ("Do Not Top Off", "MDE Toll Free Number" 1-800-633-6101)
Complete Incomplete

Comments

TRAINING CERTIFICATES

One employee must be trained at an approved training course. This employee may assist in the training of other employees. Include the name on the Stage II training certificate in the Comments section.

Complete Incomplete

Comments

STAGE II DECOMMISSIONING

Has the site decommissioned the Stage II Vapor Recovery System? Yes No

If "yes", please list date of decommissioning (mm/dd/yy): _____

If "yes", enter the last date of the following tests (tests required upon decommissioning and annually after decommissioning):

Pressure Decay Test (mm/dd/yy): _____

Vapor Tie-In Test (mm/dd/yy): _____

P/V Vent Valve Test (mm/dd/yy): _____

Follow-up Required

Inspector Daniel Outten

Date 05/01/2015

**Vapor Recovery Questions? Call MDE Air and Radiation Management Administration at
410-537-3231**

Section 8: Corrosion Protection

Applicable
 Not Applicable

A buried metal tank and piping (including fittings, flex-connectors, etc.) must be isolated from soil and cathodically protected. Commercial Heating Oil UST systems installed after March 15, 1985 require corrosion protection.

Non-Metal Construction Material

Answer (P)ass, (PC), (F)ail or (NA) for each tank and pipe		Tank #1	Pipe #1	Tank #2	Pipe #2	Tank #3A	Pipe #3A	Tank #3B	Pipe #3B	Tank #4	Pipe #4
1	Tank: Outer wall made of non-metallic material such as fiberglass or plastic jacket or coating.	F	N/A	F	N/A	F	N/A	F	N/A	F	N/A
2	Pipe: Outer wall made of non-metallic material such as fiberglass or flexible plastic.	N/A	F	N/A	F	N/A	F	N/A	F	N/A	F
Non-Metal Construction passes inspection. Questions 1 and 2 are (P) or (PC) Go to Section 9		F	F	F	F	F	F	F	F	F	F

Galvanic Cathodic Protection (Tank and Piping)

#	Check (✓) type of corrosion protection for each tank and pipe, and answer (P)ass, (PC), (F)ail or (NA) for each tank and pipe	Tank #1	Pipe #1	Tank #2	Pipe #2	Tank #3A	Pipe #3A	Tank #3B	Pipe #3B	Tank #4	Pipe #4
3	Tank: CP on (sti-P ₃ [®]) tested within past 3 years and passed test in accordance with NACE Code of Practice Standard. If supplemental anodes were installed or added, complete 3a.		N/A		N/A		N/A		N/A		N/A
3a.	UST CP tested annually.										
4	Pipe: CP tested within past year and passed test in accordance with NACE Code of Practice Standard.	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
5	Record of last two cathodic protection tests on file with Owner or Operator.										
6	Cathodic protection system failure was inspected/repared within 60 days of test.										
Galvanic Cathodic Protection passes inspection. Questions 3 – 6 are (P) or (PC) or 6 (NA)											

Impressed Current Cathodic Protection (Tank and Piping)



7	Date impressed current system installed. (M/Y).										
8	Assessment performed at 5-year intervals.										
9	System has power and is turned on.	F	F	F	F	F	F	F	F	F	F
10	Hour meter present? If (Y) complete 11.	F	F	F	F	F	F	F	F	F	F
11	Record hours:	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N	(Circle one) 0 / N
12	60-day inspection log is present and properly filled out.	F	F	F	F	F	F	F	F	F	F
13	Tank tested within past year and passed test in accordance with NACE Code of Practice Standard.	F	N/A	F	N/A	F	N/A	F	N/A	F	N/A
14	Pipe tested within past year and passed test in accordance with NACE Code of Practice Standard.	N/A	F	N/A	F	N/A	F	N/A	F	N/A	F
15	Records available for last two Impressed Current Cathodic Protection tests.	F	F	F	F	F	F	F	F	F	F
16	Cathodic protection system failure was inspected/repared within 60-days of test.	N A	N A	N A	N A	N A	N A	N A	N A	N A	N A
Impressed Current Cathodic Protection passes inspection. Questions 8&9 and 12-16 are (P) or (PC)		F	F	F	F	F	F	F	F	F	F

Section 8: Corrosion Protection (cont'd.)

	Internally Lined Tank	Tank # 1	Pipe 1	Tank # 2	Pipe 2	Tank #3A	Pipe 3A	Tank #3B	Pipe 3B	Tank # 4	Pipe 4
17	Documentation available and tank was less than 10 years old prior to installing liner.										
18	Documentation available and internal inspection performed to determine tank is structurally sound and free of corrosion holes prior to installing impressed current cathodic protection and liner.		N/A		N/A		N/A		N/A		N/A
19	Site assessment performed before installing liner.										
20	Date liner installed (Month / Year).										
21	Date of last internal inspection. (Month / Year).										
22	Internal inspection performed within 10 years of installation and every 5 years thereafter.										
Internal Liner passes inspection. Questions 17 – 19 and 22 are (P) or (PC)											
<i>Note: If the answer to any question in section 8 is (F), explain below. List any problems noted during inspection. Note corrections.</i>											

Comments:

OPERATOR PROVIDED LAST CP TEST FOR 9-24-2009
 PIPING IS STEEL FOUND DRIVE ANODES UNDER DISPENSERS.

	<p>IF A METALLIC TANK OR PIPE HAS NO CATHODIC PROTECTION NOTIFY MDE OIL CONTROL PROGRAM AT 410-537-3442.</p>	
---	---	---

Section 9: Tightness Testing Inspection

9. Tightness Testing (Tanks and Piping)

Complete this section if tank and/or pipe used periodic tightness testing.

#	Answer (P)ass, (PC), (F)ail or (NA) for each tank and pipe	Tank #1	Pipe #1	Tank #2	Pipe #2	Tank #3A	Pipe #3A	Tank #3B	Pipe #3B	Tank #4	Pipe #4
1	Test method on NWGLDE. Method Name: Method Name:	F	F	F	F	F	F	F	F	F	F
2	Last tightness test results available and passed.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
3	Tightness testing conducted within specified time frames: at installation, at 15 years, and every 5 years thereafter for tanks NOT doing inventory control; annually for pressurized piping; every 2 years for non-exempt suction piping or be monitored monthly by approved leak detection method.	F	F	F	F	F	F	F	F	F	F
4	High Risk Groundwater Use Area** – Helium vapor test performed within past two years with passing results.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
4a.	Date of last test.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Tightness Testing passes inspection.		F	F	F	F	F	F	F	F	F	F
Questions 1 – 4 are (P) or (PC)		F	F	F	F	F	F	F	F	F	F

Note: If the answer to any question is (F), please explain below. List any problems noted during inspection. Note corrections.
 (National Work Group on Leak Detection Evaluations)

****High Risk Groundwater Use Area (HRGUA) means all areas served by individual wells. Existing UST systems installed prior to 1/26/05 in Baltimore, Carroll, Cecil, Frederick and Harford counties or New UST systems installed after 1/26/05 in Anne Arundel, Baltimore, Carroll, Cecil, Charles, Calvert, Frederick, Harford, Howard, Montgomery, and Prince George's counties.*

Comments:

OPERATOR COULD NOT PROVIDE TEST RESULTS AT TIME OF INSPECTION.

Questions regarding Helium Testing, call MDE Oil Control Program at 410-537-3442

Section 10: House Keeping and Monitoring Pipe/Well Inspection

10.a. Facility House Keeping

#	Answer (P)ass, (PC), (F)ail or (NA)	
1	Facility is clean with no sign of spillage or open containers of oil.	P
2	ASTs (if present) are clean and properly maintained.	P
3	Pump island area is clean with no indication of surface spillage.	P
4	Garage area (if present) is maintained with no indication of surface spillage.	P
House Keeping passes inspection. Questions 1 – 4 are (P) or (PC) or (NA)		P

Note: If the answer to any questions is (F), explain below. List any problems noted during inspection. Note corrections.

<input checked="" type="checkbox"/>	Applicable
<input type="checkbox"/>	Not Applicable

10.b. Tank Field Monitoring Pipes

#	Answer (P)ass, (PC), (F)ail or (NA)	MP-1	MP-2	MP-3	MP-4
1	Storage systems installed after March 15, 1985 have PVC monitoring pipes installed on opposing corners of the tank field.	P	P	P	P
1a.	Gasoline storage systems installed after January 26, 2005 +>2,000-gallons or multiple tanks in a shared excavation used to fuel motor vehicles located in HRGUA* have four monitoring pipes (each corner of the tank field).	NA	NA	NA	NA
2	Monitoring pipes are screened to within 2ft. of the surface and the remaining 2ft. being solid pipe and sealed to prevent entrance of surface runoff.	F	F	F	F
3	Monitoring pipe has liquid-tight cap, protected from traffic with manhole cover and locked or bolted closed.	P	P	P	P
4	Monitoring pipe cover is clearly marked "monitoring well-do not fill" or identified using API color code symbol.	P	P	P	P
5	Monitoring pipes checked for the presence of petroleum contamination and if present complete 5a.	P	P	P	P
5a.	Record product thickness if taken.	0	0	0	0
	Record field vapor reading if taken.	0	0	0	0

Site wells for Facilities located in HRGUA* Answer (P)ass, (PC), (F)ail or (NA)

6	Facility or immediate neighbor on either side supplied by potable well?	(Circle one) Y / 0				
7	Three or more groundwater monitoring wells installed outside of tank excavation area.					
8	Monitoring wells have liquid-tight cap, protected from traffic with manhole cover and locked or bolted closed.					
9	Groundwater has been sampled within past year and sample results available?					
10	Site potable well has been sampled within past year.					
Monitoring Pipes and Site Wells Pass Inspection. Questions 1 – 5 and 7 – 10 are (P) or (PC) or (NA)			F	F	F	F

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

*"High Risk Groundwater Use Area" (HRGUA) means all areas served by individual wells. Existing UST systems installed prior to 1/26/05 in Baltimore, Carroll, Cecil, Frederick and Harford counties or New UST systems installed after 1/26/05 in Anne Arundel, Baltimore, Carroll, Cecil, Charles, Calvert, Frederick, Harford, Howard, Montgomery, and Prince George's counties.

Comments:

MP1 SLOTS @ 28" WATER @ 30". MP2 SLOTS @ 34.5" WATER @ 30.5". MP3 SLOTS @ 27" WATER @ 30"
MP4 SLOTS @ 32" WATER @ 30"

Section 11: Inventory Control

<input checked="" type="checkbox"/> Applicable
<input type="checkbox"/> Not Applicable

For metered storage systems: complete items 1 – 10.

For non-metered storage systems: complete items 3 – 6.

For tanks using Inventory Control combined with SIR: also complete Section 12d.

#	Answer (P)ass, (PC), (F)ail or (NA) for each tank	Tank #1	Tank #2	Tank #3A	Tank #3B	Tank #4
1	Readings recorded each day of operation.	F	F	F	F	F
2	Inventory records are reviewed daily and reconciled monthly. Note: Seven consecutive days of shortage totaling 80-gallons or more must be reported to owner and investigated.	F	F	F	F	F
3	Appropriate calibration tank chart is used for calculating volume to nearest 1/8 inch.	F	F	F	F	F
4	Stick readings recorded before and after each delivery.	F	F	F	F	F
5	Gauge stick is marked so the owner is capable of determining product level to the nearest 1/8 inch and stick is in good condition and not worn.	F	F	F	F	F
6	Stick capable of measuring full height of tank.	F	F	F	F	F
7	Monthly water readings checked to the nearest 1/8 inch and used in calculating inventory balances.	F	F	F	F	F
8	Prior 12 months of inventory data available.	F	F	F	F	F
9	Inventory variations do not exceed 1% + 130 gallons of the metered quantity (sales).	F	F	F	F	F
10	Existing inventory results show no evidence of a release, and no water intrusion.	F	F	F	F	F
Inventory Control Passes Inspection		F	F	F	F	F
Questions 1 – 10 are (P) or (PC) or not applicable		F	F	F	F	F

If using Statistical Inventory Reconciliation (SIR), also complete Section 12.d.

Note: If answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

Comments:

TANKS HAVE BEEN OUT OF SERVICE FOR A YEAR. NO INVENTORY

Section 12: Release Detection Summary

This section indicates the method or methods of release detection present. Proceed to the section identified in the last column. Emergency power generator UST systems and heating oil (on-site consumptive use) UST systems are exempt from release detection.

Tank Method: Complete for each tank	Indicate primary (PR) method and, if applicable, secondary (S) method for each tank					If using as primary method, proceed to section:
	Tank # <u>1</u>	Tank # <u>2</u>	Tank # <u>3A</u>	Tank # <u>3B</u>	Tank # <u>4</u>	
Automatic Tank Gauging	PR	PR	PR	PR	PR	12.a.
Vapor Monitoring						12.b.
Interstitial Monitoring						12.c.
Statistical Inventory Reconciliation						12.d.
Groundwater Monitoring						12.e.
Manual Tank Gauging						12.f.
None needed (Explain)						Skip section 12

Pipe Method: Complete for each pipe run	Indicate primary (PR) method and, if applicable, secondary (S) method for each pipe run					If using as primary method, proceed to section:
	Pipe # <u>1</u>	Pipe # <u>2</u>	Pipe # <u>3A</u>	Pipe # <u>3B</u>	Pipe # <u>4</u>	
Pressurized piping only						
Automatic line leak detector (ALLD) will detect 3-gph release, double-wall pipe with containment sump and liquid sump sensor.						12.c. and 12.h.
ALLD will detect 3-gph release, double-wall pipe with containment sump and manual interstitial monitoring.						12.c. and 12.h.
Electronic ALLD will perform 3-gph continuous test plus 0.2-gph monthly test.						12.h.
Mechanical ALLD will detect 3-gph release in conjunction with annual line tightness test.	PR	PR	PR	PR	PR	9 and 12.h.
Other combination: (Explain in comments)						
Suction piping only						
Line tightness test every 2 years.						9
Double wall piping with containment sumps utilizing electronic or manual interstitial monitoring.						12.c.
Safe Suction.						12.g.
None needed (Explain)						Skip Section 12

Comments:

Section 12: Release Detection (cont'd.)

<input checked="" type="checkbox"/> Applicable
<input type="checkbox"/> Not Applicable

Section 12.a. Automatic Tank Gauging (Tank Only)

#	Complete 1 and 4. Answer (P)ass, (PC), or (F)ail for 2,3,5 – 10.	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	Console Make and Model Make: VEEDER Model: ROOT	VEEDER	ROOT	TLS	350	
2	Monitoring console is working.	F	F	F	F	F
3	Owner's manual for console and probes is available at site.	F	F	F	F	F
4	Frequency ATG performs test (D) daily, (W) weekly, or (M) monthly.	F	F	F	F	F
5	Device is calibrated, operated, and maintained per manufacturer's instructions in addition to limitations listed on evaluation summary NWGLDE* list.	F	F	F	F	F
6	System setup reviewed and system capable of verifying probe(s) are functioning and documenting results.	F	F	F	F	F
6a.	Attach copy of print out for the last monthly ATG tank leak test to this page.	F	F	F	F	F
7	Tank is filled to proper capacity and test run for proper duration of time for last 2 months per NWGLDE* list.	F	F	F	F	F
8	Verification that console and probe are third party approved and on the NWGLDE* list.	P	P	P	P	P
9	Monthly release detection records are available and reviewed for past 12 months.	F	F	F	F	F
10	Existing release detection results reviewed shows no failure.	F	F	F	F	F
ATG passes inspection.		F	F	F	F	F
Questions 2, 3 and 5 – 10 are (P) or (PC)		F	F	F	F	F

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.
 *www.mwglde.org (National Work Group on Leak Detection Evaluations).

Comments:

SYSTEM IS NOT WORKING

Section 12: Release Detection (cont'd.)

<input type="checkbox"/> Applicable
<input checked="" type="checkbox"/> Not Applicable

Section 12.b. Vapor Monitoring (Tanks and/or Piping)

#	Complete 1. Answer (P)ass, (PC), (F)ail or (NA) for 2 – 11.	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	Console Make and Model Make: Model:					
2	Monitoring panel and/or control box is working.					
3	Verification that the Vapor Monitoring device is third-party approved and on the NWGLDE* list.					
4	Owner's manual for the Vapor Monitoring device is available at the site.					
5	The material used as backfill is sufficiently porous, such as pea gravel or sand, to readily allow diffusion of vapors from releases into the excavation zone.					
6	Vapor Monitors are designed, calibrated, and operated to detect an increase in concentration of the regulated substance, a component of the regulated substance, or a tracer compound placed in the tank system and maintained per manufacturer's instructions in addition to limitations listed on evaluation summary NWGLDE* list.					
7	Site evaluation report is on site and verifies the above information and that background contamination will not interfere with vapor monitoring. Attach evaluation cover page.					
8	System setup reviewed and proper settings confirmed correct. Verification all probes functioning.					
9	Vapor Monitors are checking portion of tank and piping that routinely contain product.					
10	Monthly release detection records are available for last 12 months.					
11	Existing release detection results show no evidence of a release.					
Vapor Monitoring passes inspection. Questions 2 – 11 are (P) or (PC)						

*Note: If the answer to any question is (F), please explain below. List any problems noted during inspection. Note corrections.
* www.nwglde.org (National Work Group on Leak Detection Evaluations).*

Comments:

Section 12: Release Detection (cont'd.)

<input type="checkbox"/>	Applicable
<input checked="" type="checkbox"/>	Not Applicable

Section 12.c. Interstitial Monitoring (Tank and Piping)

#	Complete 1 and 3 for Electronic and Answer (P)ass, (PC), (F)ail or (NA) 2&4-10 for each Tank and Pipe	Tank	Pipe	Tank	Pipe	Tank	Pipe	Tank	Pipe	Tank	Pipe
		#	#	#	#	#	#	#	#	#	#
1	Type of interstitial monitoring: i.e. Liquid (L), Air Space (AS), or Pressure/vacuum (PV). List each if different.	1	1	2	2	3A	3A	3B	3B	4	4
Manual /Visual Inspection Only											
2	Interstitial space is monitored and a written log is maintained monthly.										
Electronic System Only											
3	Console make/ model	Make:									
		Model:									
4	Console and sensor on NWGLDE* list										
5	Monitoring console is operational.										
6	Interstitial space monitored monthly. **										
7	Device is calibrated, operated, and maintained per manufacturer's instructions in addition to limitations listed on evaluation summary NWGLDE* list.										
Summary											
8	Monthly release detection records are available for prior 12 months with passing results.										
9	No evidence of liquid in sump or interstitial space of air filled system. No evidence of loss or gain of brine in brine filled system. Operation of partial vacuum or over pressure system is within manufacturer's design specifications.										
10	No visible leaks or holes in secondary containment.										
Interstitial Monitoring passes inspection. Questions 2 and 8 - 10 are (P) for Manual Questions 4 - 10 are (P) or (PC) for Electronic											

Note: If the answer to any question is (F), please explain below. List any problems noted during inspection. Note corrections.
 **Monitor interstitial space at lowest point of secondary containment for air filled or at highest point of secondary containment for brine filled and is positioned so that other equipment will not interfere with its proper operation. See manufacture specifications and NWGLDE listing limitations for continual partial vacuum or overpressure interstitial monitoring.
 *www.nwglde.org (National Work Group on Leak Detection Evaluations).

Comments:

Section 12: Release Detection (cont'd.)

<input type="checkbox"/> Applicable
<input checked="" type="checkbox"/> Not Applicable

Section 12.d. Statistical Inventory Reconciliation

Complete this section and Section 11 (Inventory Control) if you use Statistical Inventory Reconciliation (SIR).

Answer (P)ass, (PC), (F)ail for each tank system.	Tank # 1	Pipe # 1	Tank # 2	Pipe # 2	Tank # 3A	Pipe # 3A	Tank # 3B	Pipe # 3B	Tank # 4	Pipe # 4
1 SIR method on NWGLDE* list. Method Name:		NA		NA		NA		NA		NA
2 Inventory records are submitted to the SIR vendor within 5 days of the 30 day monitoring period.		NA		NA		NA		NA		NA
2a SIR results are received by owner from vendor within 15 days of submittal of data.		NA		NA		NA		NA		NA
3 SIR results indicate sufficient amount of data was used to perform leak check.		NA		NA		NA		NA		NA
4 Existing release detection results show no evidence of a failure for the previous 12 months.		NA		NA		NA		NA		NA
Statistical Inventory Reconciliation (SIR) Passes Inspection. Questions 1 – 4 are all (P) or (PC).		NA		NA		NA		NA		NA

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.

*www.nwglde.org (National Work Group on Leak Detection Evaluations)

Comments:

<input type="checkbox"/> Applicable
<input checked="" type="checkbox"/> Not Applicable

Section 12.e. Groundwater Monitoring

#	Answer (P)ass, (PC), (F)ail for each tank system	Tank # 1	Pipe # 1	Tank # 2	Pipe # 2	Tank # 3A	Pipe # 3A	Tank # 3B	Pipe # 3B	Tank # 4	Pipe # 4
1	Groundwater at site is not more than 15 feet from ground surface during inspection.										
2	Slotted casing is properly screened across the water table to allow entry of product.										
3	Monitoring wells intercept the UST excavation zone or positioned as close as technically feasible.										
4	Regulated substance is immiscible in water and has a specific gravity of less than one.										
5	Site evaluation report on site and verifies above information and background contamination will not interfere with groundwater monitoring. Attach evaluation cover page.										
6	Monitoring device is capable of detecting 1/8 inch of free product and wells are monitored monthly with results recorded.										
Groundwater Monitoring passes inspection. Questions 1 – 6 are all (P) or (PC)											

Note: If the answer to any question is (F), please explain below. List any problems noted during inspection. Note corrections.

Comments:

Section 12: Release Detection (cont'd.)

Section 12.f. Manual Tank Gauging (Tank Only)

Applicable
 Not Applicable

#	Answer 1-5 (P)ass, (PC), (F)ail or (NA) for each Tank	Tank # 1	Tank # 2	Tank # 3A	Tank # 3B	Tank # 4
1	Tank is 550-gallons or less.					
2	Tank is 551 to 2,000-gallons. Note: Must be combined with tightness testing.					
3	Gauging stick is capable of measuring the full height of the tank to the nearest 1/8" in conjunction with the appropriate tank calibration chart on site.					
4	Monthly log is maintained. *					
5	Last 12 months of records show no failure.					
Manual Tank Gauging passes inspection.						
Questions 1 or 2 and 3-5 are (P) or (PC)						

Note: If the answer to any question is (F), explain below. List any problems noted during inspection. Note corrections.
 * See Inspector guidance book or COMAR 26.10.05.04C. for weekly and monthly variation standard.

Comments:

Section 12.g. Safe Suction (Suction Piping Only)

Applicable
 Not Applicable

#	Answer (P)ass, (F)ail, or (PC) for each pipe	Pipe # 1	Pipe # 2	Pipe # 3A	Pipe # 3B	Pipe # 4
1	The piping slope is back to the tank and operates under atmospheric pressure or less.					
2	Confirm a single check valve is located directly under the dispensing pump.					
Safe Suction passes inspection.						
Questions 1 and 2 are (P) or (PC)						

Note: If the answer for 1 or 2 is (F), another type of release detection must be used and inspected. Fill out the applicable section on piping release detection. List any problems noted during inspection. Note corrections.

Comments:

Applicable
 Not Applicable

Section 12.h. Automatic Line Leak Detectors (Pressurized Piping Only)

#	Complete 1 Answer questions 2-7 (P)ass, (F)ail or (PC)	Pipe # 1	Pipe # 2	Pipe # 3A	Pipe # 3B	Pipe # 4
1	Mechanical or Electronic (M - Mechanical or E - Electronic)	M	M	M	M	M
2	Is the equipment on the NWGLDE* list.	P	P	P	P	P

Section 12: Release Detection (cont'd.)

3	All ALLDs pass an annual field operability test for detection of a 3.0-gph leak.	F	F	F	F	F
4	Device is calibrated, operated, and maintained per manufacturer's instructions in addition to limitations listed on evaluation summary NWGLDE* list.	F	F	F	F	F
5	Line Leak Detector shows no evidence of a visual release.	P	P	P	P	P
6	Is the entire piping system covered by the ALLD (including satellite pipe if present)?	P	P	P	P	P
7	For an electronic ALLD, last record of passing 3.0-gph test result for each pipe is within the previous 72 hours.	NA	NA	NA	NA	NA
8	Does the STP shut off when the dispensers are not pumping?	P	P	P	P	P
ALLD Passes Inspection. Questions 2 – 8 are (P) or (PC)		F	F	F	F	F



Note: If the answer to any question is (F), please explain below. List any problems noted during inspection. Note corrections

*www.nwglde.org (National Work Group on Leak Detection Evaluations)

COMMENTS: NO CURRENT TEST RESULTS AT TIME OF INSPECTION.

Section 13 Suspected Release Answer (Y)es or (N)o for 1 and if yes answer 2

1	Do you suspect or have you detected a release during this inspection?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
2	Did you report this suspected or detected release to the Department?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	DATE: _____ TIME: _____

	<p>Report all known or suspected spills or leaks Call Maryland Department of the Environment 410-537-3442 Or call: 1-866-633-4686 after business hours</p>	
---	---	---

GENERAL COMMENTS:

OPERATOR STATED THEY HAVE NOT PUMPED IN ALMOST A YEAR. REGULAR TANK HAS 2.5" PLUS HAS 1" OF PRODUCT. DIESEL 1.5" OF PRODUCT. REGULAR 2" OF PRODUCT. DIESEL 1.5" OF PRODUCT.

Inspector's Initials: PO
 Date: 05/01/2015

Owner/Operator's Initials: _____
 Date: 05/01/2015

Section 14 Operator Training

Answer Yes or No for 1, 2 and 5; complete 3; answer Yes, No, or NA for 4

1	A list of Class A, B, and C operators is available and reviewed?	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No									
2	A training certificate is available and reviewed for each Class A, B, and C operator(s).	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No									
3	List the name of the A and B operator(s) designated for this facility.	<table border="1"> <thead> <tr> <th></th> <th>Operator Name</th> <th>Date Certified</th> </tr> </thead> <tbody> <tr> <td>A</td> <td></td> <td></td> </tr> <tr> <td>B</td> <td></td> <td></td> </tr> </tbody> </table>			Operator Name	Date Certified	A			B		
	Operator Name	Date Certified										
A												
B												
4	Manned facility – Class C operator is on-site. Unmanned facility – Class C operator was contacted for immediate consultation.	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No									
5	Written operator instruction manual available on site?	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No									
Operator Training Passes Inspection. Questions 1, 2, 4, 5 are Yes and 3 completed with at least one A and B.		<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No									
		F	Name:									

GENERAL COMMENT:
NO A,B,,C @ TIME OF INSPECTION.

Please return original report no later than thirty (30) days after inspection date.	MDE Oil Control Program Suite 620 1800 Washington Blvd. Baltimore, MD 21230-1719
---	--

Internet: **Questions? Call MDE Oil Control Program at 410-537-3442**