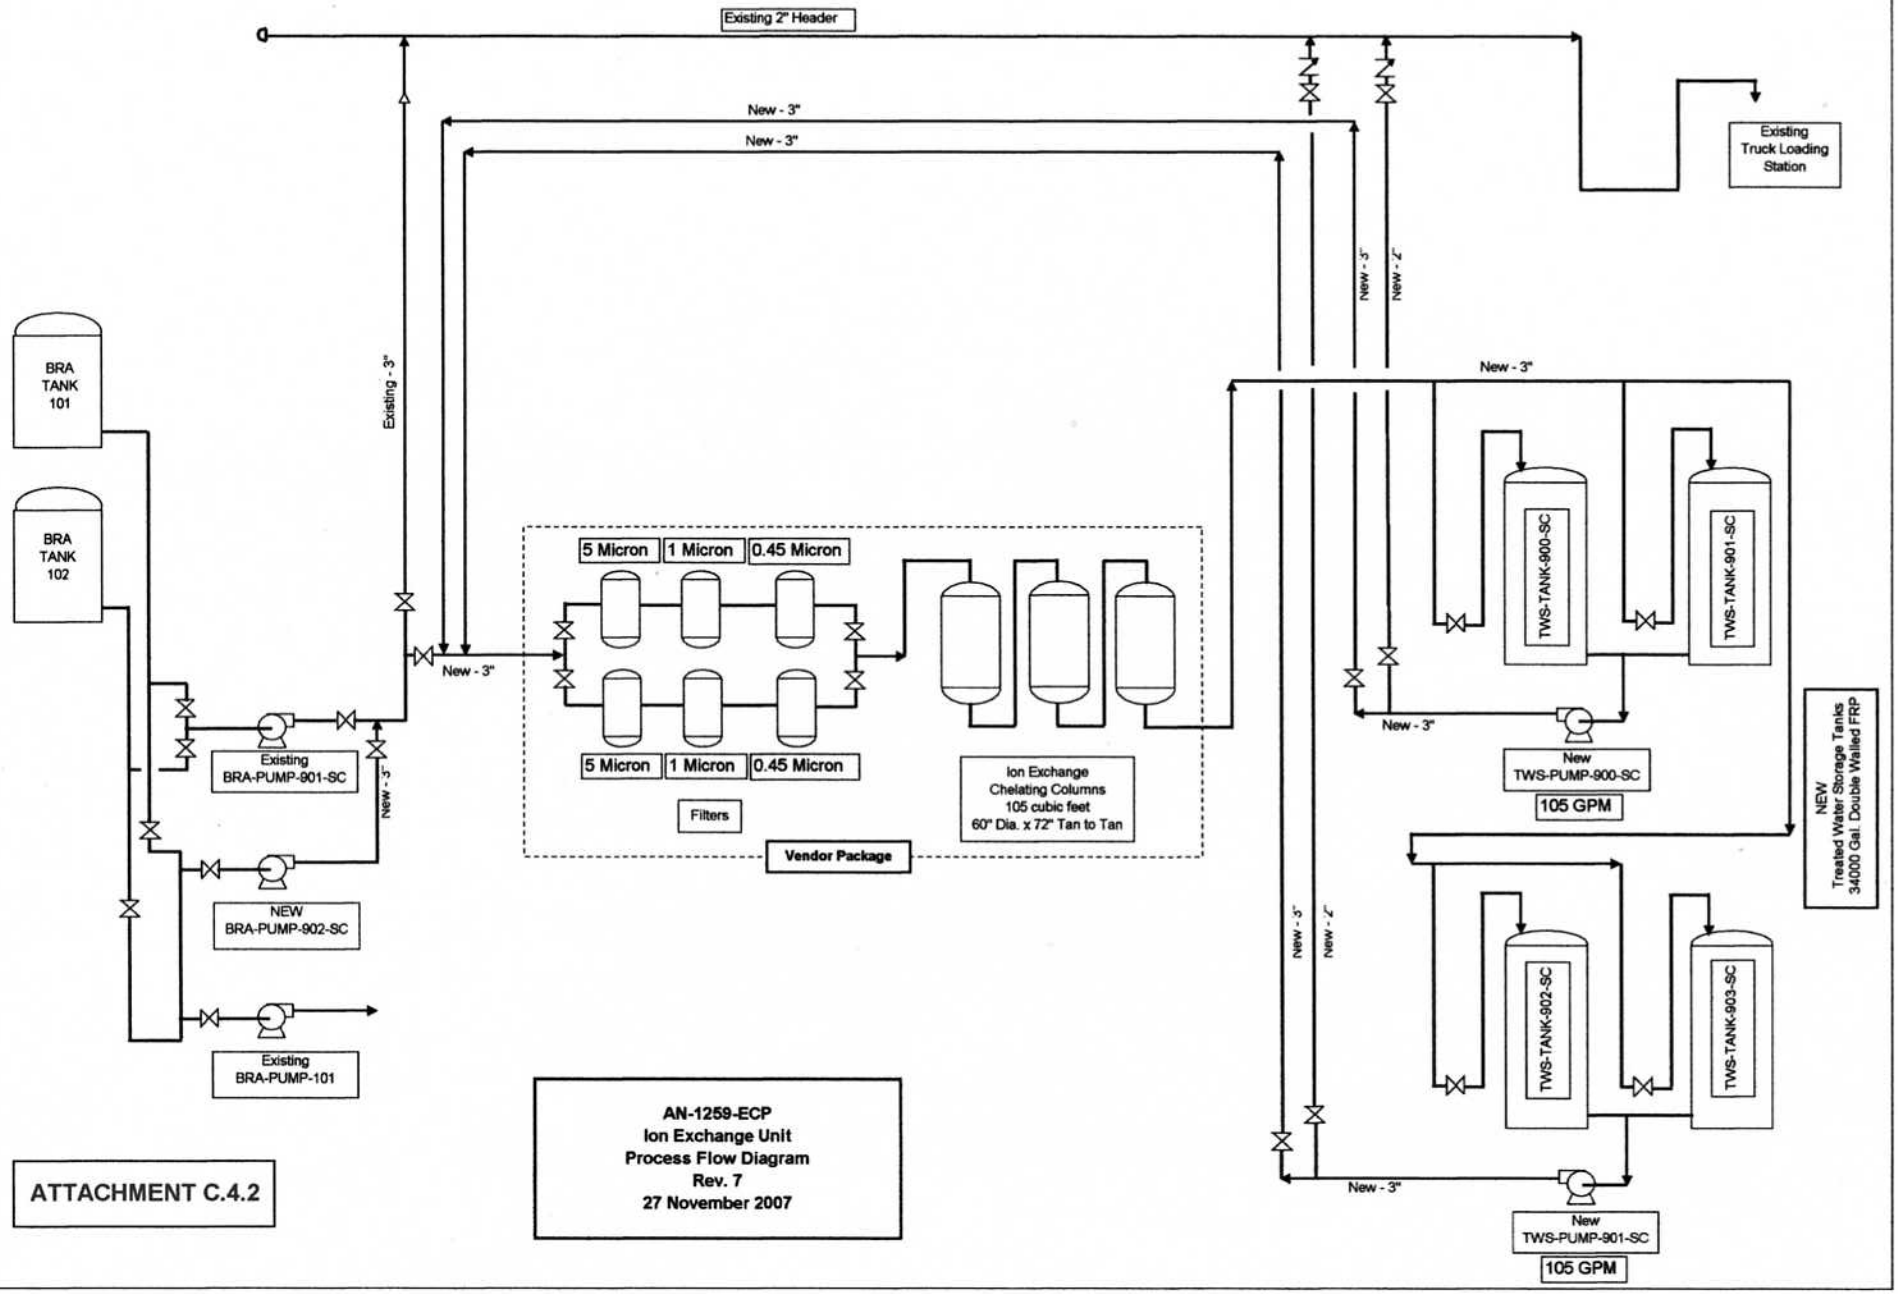
Existing 2" Header
New - 3"
New - 3"
Existing Truck Loading Station
BRA TANK 101
BRA TANK 102
Existing - 3"
New - 3"
New - 3"
New - 2"
New - 3"
5 Micron
1 Micron
0.45 Micron
5 Micron
1 Micron
0.45 Micron
Filters
Vendor Package
Ion Exchange Chelating Columns 105 cubic feet 60" Dia. x 72" Tan to Tan
TWS-TANK-900-SC
TWS-TANK-901-SC
New - 3"
New TWS-PUMP-900-SC
105 GPM
NEW Treated Water Storage Tanks 34000 Gal. Double Walled FRP
Existing BRA-PUMP-901-SC
New - 3"
NEW BRA-PUMP-902-SC
Existing BRA-PUMP-101
New - 3"
New - 2"
TWS-TANK-902-SC
TWS-TANK-903-SC
New - 3"
New TWS-PUMP-901-SC
105 GPM
AN-1259-ECP
Ion Exchange Unit
Process Flow Diagram
Rev. 7
27 November 2007
ATTACHMENT C.4.2