Marshall Environmental Management Inc.
1145 SW 74th Street E-300
Oklahoma City, Oklahoma 73139

Oklahoma City Xerox #100
Cooling Pumps Noise Data

Area Monitorng
State: Noise abatement curtains hung around pumps about 6-8 inches off the floor
Open Top
Open NW Corner

Testing Data 3/20/2006
Metrosonic DB-3100
S.N. # 2442
Cal. Date 3/20/2006
Dos Threshold (dBA)
102.0 - 38.7 dBA

Noise Level @ O Feet above the ground dBA

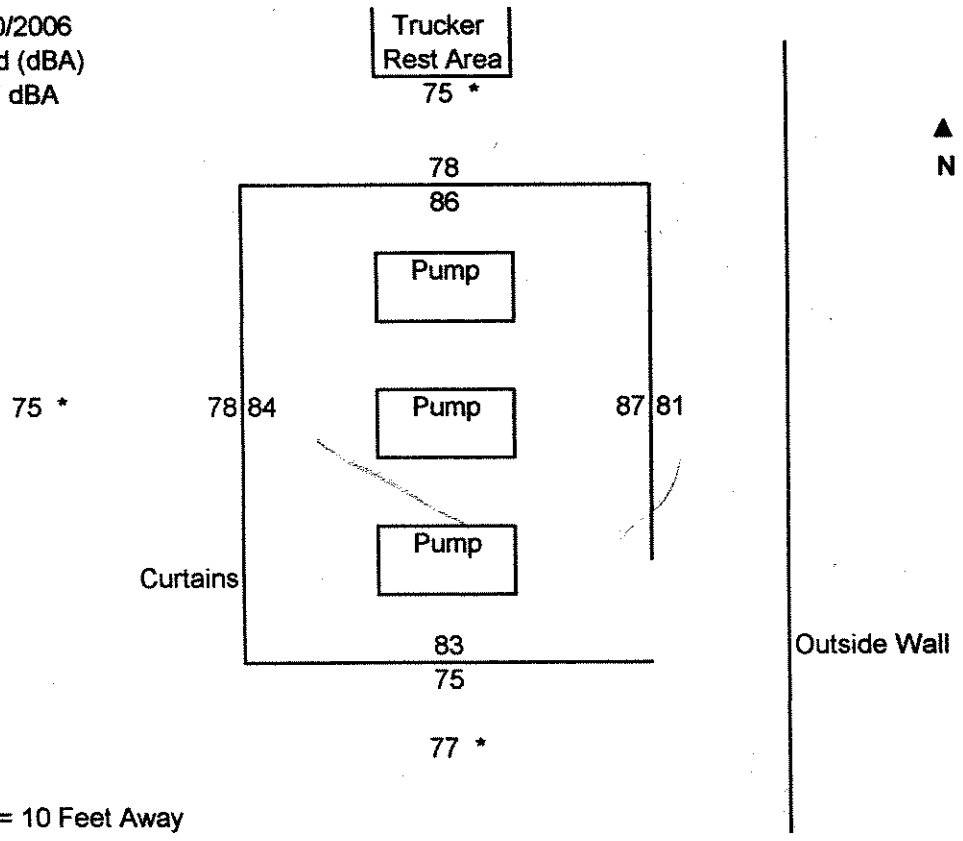

* = 10 Feet Away

Average Inside @ 85 dBA
Average Outside @ 78 dBA
Average 10' Away @ 76 dBA

Sampled by: _____
Brice Semrad, Saftey / Industrial Hygiene Tech

Marshall Environmental Management Inc.
1145 SW 74th Street E-300
Oklahoma City, Oklahoma 73139

Oklahoma City Xerox #100
Cooling Pumps Noise Data

Area Monitorng
State: Noise abatement curtains hung around pumps about 6-8 inches off the floor
Open Top
Open NW Corner

Testing Data 3/20/2006
Metrosonic DB-3100
S.N. # 2442
Cal. Date 3/20/2006
Dos Threshold (dBA)
102.0 - 38.7 dBA

Noise Level @ 5 Feet above the ground dBA

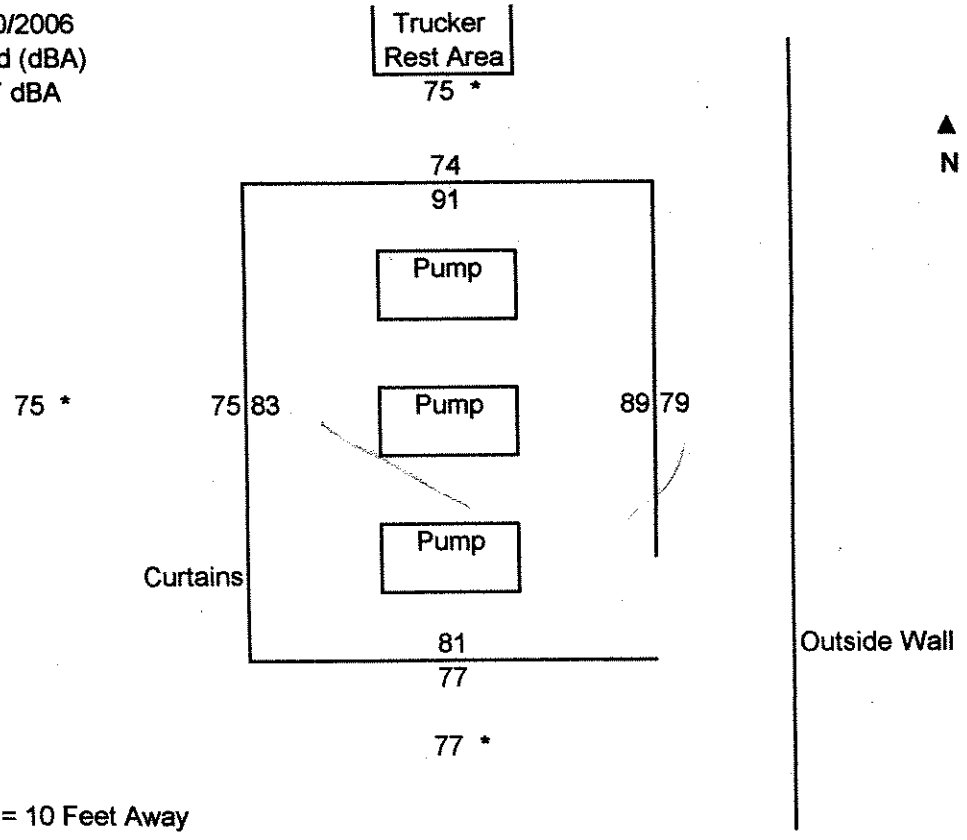

* = 10 Feet Away

Average Inside @ 86 dBA
Average Outside @ 76 dBA
Average 10' Away @ 76 dBA

Sampled by: _____
Brice Semrad, Saftey / Industrial Hygiene Tech