

Particulate Emission Calculations – Pinal Power

This analysis provides a calculation of particulate emissions from the cooling tower proposed for the Pinal Power, LLC Biomass Energy Project in Maricopa County, AZ. Emissions are based on site-specific parameters, including estimated cooling tower drift rates and total dissolved solids (TDS).

Emissions of PM are calculated based on the following equation:

$$E = Q \times \text{TDS}/10^6 \times \% \text{ drift}/100 \times \rho_{\text{H}_2\text{O}} \times 60 \text{ minutes/hour} \times \text{annual operating hours}$$

Where:

E = annual emissions, lbs/year

Q = cooling tower circulating water rates (gallons/min)

TDS = concentration of total dissolved solids in circulating water (ppm)

% drift = drift loss of circulating water (%)

$\rho_{\text{H}_2\text{O}}$ = density of water, 8.34 lbs/gal

It was assumed that the cooling tower could operate a maximum of 8760 hours/year. The cooling tower circulating water rate is 46,262 gallons/min (gpm), and the TDS would be from 100 to 2000 ppm, and it was assumed that the cooling tower would run from 3 to 7 cycles of concentration. Based on preliminary design information, drift eliminators would reduce drift to 0.001%. The emission calculations are shown in the attached spreadsheet for PM10 and PM2.5. The emission calculations are based on the following information:

PM10 emissions are calculated based on the Reisman and Frisbee reference (attached), which provides a more accurate means of calculating PM10 from cooling towers than EPA's AP-42 methodology, which is rated "E". According to the California Air Resources Board's CEIDARS database, PM2.5 is 60% of PM10 from cooling towers.

The modeling analysis demonstrates that the impact from the site sources, including the impact from the cooling tower, will be below $4 \mu\text{g}/\text{m}^3$ provided the emissions from the cooling tower are below 0.30 lbs/hr. The permit condition for the cooling tower should specify this emission rate, which can be calculated based on the attached spreadsheet, and the drift rate of 0.001%.

Calculating Realistic PM₁₀ Emissions from Cooling Towers

Abstract No. 216 Session No. AM-1b

Joel Reisman and Gordon Frisbie

Greystone Environmental Consultants, Inc., 650 University Avenue, Suite 100, Sacramento, California 95825

ABSTRACT

Particulate matter less than 10 micrometers in diameter (PM₁₀) emissions from wet cooling towers may be calculated using the methodology presented in EPA's AP-42¹, which assumes that all total dissolved solids (TDS) emitted in "drift" particles (liquid water entrained in the air stream and carried out of the tower through the induced draft fan stack.) are PM₁₀. However, for wet cooling towers with medium to high TDS levels, this method is overly conservative, and predicts significantly higher PM₁₀ emissions than would actually occur, even for towers equipped with very high efficiency drift eliminators (e.g., 0.0006% drift rate). Such over-prediction may result in unrealistically high PM₁₀ modeled concentrations and/or the need to purchase expensive Emission Reduction Credits (ERCs) in PM₁₀ non-attainment areas. Since these towers have fairly low emission points (10 to 15 m above ground), over-predicting PM₁₀ emission rates can easily result in exceeding federal Prevention of Significant Deterioration (PSD) significance levels at a project's fence line. This paper presents a method for computing realistic PM₁₀ emissions from cooling towers with medium to high TDS levels.

INTRODUCTION

Cooling towers are heat exchangers that are used to dissipate large heat loads to the atmosphere. Wet, or evaporative, cooling towers rely on the latent heat of water evaporation to exchange heat between the process and the air passing through the cooling tower. The cooling water may be an integral part of the process or may provide cooling via heat exchangers, for example, steam condensers. Wet cooling towers provide direct contact between the cooling water and air passing through the tower, and as part of normal operation, a very small amount of the circulating water may be entrained in the air stream and be carried out of the tower as "drift" droplets. Because the drift droplets contain the same chemical impurities as the water circulating through the tower, the particulate matter constituent of the drift droplets may be classified as an emission. The magnitude of the drift loss is influenced by the number and size of droplets produced within the tower, which are determined by the tower fill design, tower design, the air and water patterns, and design of the drift eliminators.

AP-42 METHOD OF CALCULATING DRIFT PARTICULATE

EPA's AP-42¹ provides available particulate emission factors for wet cooling towers, however, these values only have an emission factor rating of "E" (the lowest level of confidence acceptable). They are also rather high, compared to typical present-day manufacturers' guaranteed drift rates, which are on the order of 0.0006%. (Drift emissions are typically

expressed as a percentage of the cooling tower water circulation rate). AP-42 states that “a *conservatively high* PM₁₀ emission factor can be obtained by (a) multiplying the total liquid drift factor by the TDS fraction in the circulating water, and (b) assuming that once the water evaporates, all remaining solid particles are within the PM₁₀ range.” (Italics per EPA).

If TDS data for the cooling tower are not available, a source-specific TDS content can be estimated by obtaining the TDS for the make-up water and multiplying it by the cooling tower cycles of concentration. [The cycles of concentration is the ratio of a measured parameter for the cooling tower water (such as conductivity, calcium, chlorides, or phosphate) to that parameter for the make-up water.]

Using AP-42 guidance, the total particulate emissions (PM) (after the pure water has evaporated) can be expressed as:

$$\text{PM} = \text{Water Circulation Rate} \times \text{Drift Rate} \times \text{TDS} \quad [1]$$

For example, for a typical power plant wet cooling tower with a water circulation rate of 146,000 gallons per minute (gpm), drift rate of 0.0006%, and TDS of 7,700 parts per million by weight (ppmw):

$$\text{PM} = 146,000 \text{ gpm} \times 8.34 \text{ lb water/gal} \times 0.0006/100 \times 7,700 \text{ lb solids}/10^6 \text{ lb water} \times 60 \text{ min/hr} = \underline{3.38 \text{ lb/hr}}$$

On an annual basis, this is equivalent to almost 15 tons per year (tpy). Even for a state-of-the-art drift eliminator system, this is not a small number, especially if assumed to all be equal to PM₁₀, a regulated criteria pollutant. However, as the following analysis demonstrates, only a very small fraction is actually PM₁₀.

COMPUTING THE PM₁₀ FRACTION

Based on a representative drift droplet size distribution and TDS in the water, the amount of solid mass in each drop size can be calculated. That is, for a given initial droplet size, assuming that the mass of dissolved solids condenses to a spherical particle after all the water evaporates, and assuming the density of the TDS is equivalent to a representative salt (e.g., sodium chloride), the diameter of the final solid particle can be calculated. Thus, using the drift droplet size distribution, the percentage of drift mass containing particles small enough to produce PM₁₀ can be calculated. This method is conservative as the final particle is assumed to be perfectly spherical; hence as small a particle as can exist.

The droplet size distribution of the drift emitted from the tower is critical to performing the analysis. Brentwood Industries, a drift eliminator manufacturer, was contacted and agreed to provide drift eliminator test data from a test conducted by Environmental Systems Corporation (ESC) at the Electric Power Research Institute (EPRI) test facility in Houston, Texas in 1988 (Aull², 1999). The data consist of water droplet size distributions for a drift eliminator that achieved a tested drift rate of 0.0003 percent. As we are using a 0.0006 percent drift rate, it is reasonable to expect that the 0.0003 percent drift rate would produce smaller droplets, therefore,

this size distribution data can be assumed to be conservative for predicting the fraction of PM₁₀ in the total cooling tower PM emissions.

In calculating PM₁₀ emissions the following assumptions were made:

- Each water droplet was assumed to evaporate shortly after being emitted into ambient air, into a single, solid, spherical particle.
- Drift water droplets have a density (ρ_w) of water; 1.0 g/cm³ or 1.0 * 10⁻⁶ $\mu\text{g} / \mu\text{m}^3$.
- The solid particles were assumed to have the same density (ρ_{TDS}) as sodium chloride, (i.e., 2.2 g/cm³).

Using the formula for the volume of a sphere, $V = 4\pi r^3 / 3$, and the density of pure water, $\rho_w = 1.0 \text{ g/cm}^3$, the following equations can be used to derive the solid particulate diameter, D_p , as a function of the TDS, the density of the solids, and the initial drift droplet diameter, D_d :

$$\text{Volume of drift droplet} = (4/3)\pi(D_d/2)^3 \quad [2]$$

$$\text{Mass of solids in drift droplet} = (\text{TDS})(\rho_w)(\text{Volume of drift droplet}) \quad [3]$$

substituting,

$$\text{Mass of solids in drift} = (\text{TDS})(\rho_w)(4/3)\pi(D_d/2)^3 \quad [4]$$

Assuming the solids remain and coalesce after the water evaporates, the mass of solids can also be expressed as:

$$\text{Mass of solids} = (\rho_{\text{TDS}})(\text{solid particle volume}) = (\rho_{\text{TDS}})(4/3)\pi(D_p/2)^3 \quad [5]$$

Equations [4] and [5] are equivalent:

$$(\rho_{\text{TDS}})(4/3)\pi(D_p/2)^3 = (\text{TDS})(\rho_w)(4/3)\pi(D_d/2)^3 \quad [6]$$

Solving for D_p :

$$D_p = D_d [(\text{TDS})(\rho_w / \rho_{\text{TDS}})]^{1/3} \quad [7]$$

Where,

TDS is in units of ppmw

D_p = diameter of solid particle, micrometers (μm)

D_d = diameter of drift droplet, μm

Using formulas [2] – [7] and the particle size distribution test data, Table 1 can be constructed for drift from a wet cooling tower having the same characteristics as our example; 7,700 ppmw TDS and a 0.0006% drift rate. The first and last columns of this table are the particle size distribution derived from test results provided by Brentwood Industries. Using straight-line interpolation for a solid particle size 10 μm in diameter, we conclude that approximately 14.9 percent of the mass emissions are equal to or smaller than PM₁₀. The balance of the solid

particulate are particulate greater than 10 μm . Hence, PM_{10} emissions from this tower would be equal to PM emissions x 0.149, or 3.38 lb/hr x 0.149 = 0.50 lb/hr. The process is repeated in Table 2, with all parameters equal except that the TDS is 11,000 ppmw. The result is that approximately 5.11 percent are smaller at 11,000 ppm. Thus, while total PM emissions are larger by virtue of a higher TDS, overall PM_{10} emissions are actually lower, because more of the solid particles are larger than 10 μm .

Table 1. Resultant Solid Particulate Size Distribution (TDS = 7700 ppmw)

EPRI Droplet Diameter (μm)	Droplet Volume (μm^3) [2] ¹	Droplet Mass (μg) [3]	Particle Mass (Solids) (μg) [4]	Solid Particle Volume (μm^3)	Solid Particle Diameter (μm) [7]	EPRI % Mass Smaller
10	524	5.24E-04	4.03E-06	1.83	1.518	0.000
20	4189	4.19E-03	3.23E-05	14.66	3.037	0.196
30	14137	1.41E-02	1.09E-04	49.48	4.555	0.226
40	33510	3.35E-02	2.58E-04	117.29	6.073	0.514
50	65450	6.54E-02	5.04E-04	229.07	7.591	1.816
60	113097	1.13E-01	8.71E-04	395.84	9.110	5.702
70	179594	1.80E-01	1.38E-03	628.58	10.628	21.348
90	381704	3.82E-01	2.94E-03	1335.96	13.665	49.812
110	696910	6.97E-01	5.37E-03	2439.18	16.701	70.509
130	1150347	1.15E+00	8.86E-03	4026.21	19.738	82.023
150	1767146	1.77E+00	1.36E-02	6185.01	22.774	88.012
180	3053628	3.05E+00	2.35E-02	10687.70	27.329	91.032
210	4849048	4.85E+00	3.73E-02	16971.67	31.884	92.468
240	7238229	7.24E+00	5.57E-02	25333.80	36.439	94.091
270	10305995	1.03E+01	7.94E-02	36070.98	40.994	94.689
300	14137167	1.41E+01	1.09E-01	49480.08	45.549	96.288
350	22449298	2.24E+01	1.73E-01	78572.54	53.140	97.011
400	33510322	3.35E+01	2.58E-01	117286.13	60.732	98.340
450	47712938	4.77E+01	3.67E-01	166995.28	68.323	99.071
500	65449847	6.54E+01	5.04E-01	229074.46	75.915	99.071
600	113097336	1.13E+02	8.71E-01	395840.67	91.098	100.000

¹ Bracketed numbers refer to equation number in text.

The percentage of PM_{10} /PM was calculated for cooling tower TDS values from 1000 to 12000 ppmw and the results are plotted in Figure 1. Using these data, Figure 2 presents predicted PM_{10} emission rates for the 146,000 gpm example tower. As shown in this figure, the PM emission rate increases in a straight line as TDS increases, however, the PM_{10} emission rate increases to a maximum at around a TDS of 4000 ppmw, and then begins to decline. The reason is that at higher TDS, the drift droplets contain more solids and therefore, upon evaporation, result in larger solid particles for any given initial droplet size.

CONCLUSION

The emission factors and methodology given in EPA's AP-42¹ Chapter 13.4 *Wet Cooling Towers*, do not account for the droplet size distribution of the drift exiting the tower. This is a critical factor, as more than 85% of the mass of particulate in the drift from most cooling towers will result in solid particles larger than PM_{10} once the water has evaporated. Particles larger than PM_{10} are no longer a regulated air pollutant, because their impact on human health has been shown to be insignificant. Using reasonable, conservative assumptions and a realistic drift

droplet size distribution, a method is now available for calculating realistic PM₁₀ emission rates from wet mechanical draft cooling towers equipped with modern, high-efficiency drift eliminators and operating at medium to high levels of TDS in the circulating water.

Table 2. Resultant Solid Particulate Size Distribution (TDS = 11000 ppmw)

EPRI Droplet Diameter (μm)	Droplet Volume (μm ³) [2] ¹	Droplet Mass (μg) [3]	Particle Mass (Solids) (μg) [4]	Solid Particle Volume (μm ³)	Solid Particle Diameter (μm) [7]	EPRI % Mass Smaller
10	524	5.24E-04	5.76E-06	2.62	1.710	0.000
20	4189	4.19E-03	4.61E-05	20.94	3.420	0.196
30	14137	1.41E-02	1.56E-04	70.69	5.130	0.226
40	33510	3.35E-02	3.69E-04	167.55	6.840	0.514
50	65450	6.54E-02	7.20E-04	327.25	8.550	1.816
60	113097	1.13E-01	1.24E-03	565.49	10.260	5.702
70	179594	1.80E-01	1.98E-03	897.97	11.970	21.348
90	381704	3.82E-01	4.20E-03	1908.52	15.390	49.812
110	696910	6.97E-01	7.67E-03	3484.55	18.810	70.509
130	1150347	1.15E+00	1.27E-02	5751.73	22.230	82.023
150	1767146	1.77E+00	1.94E-02	8835.73	25.650	88.012
180	3053628	3.05E+00	3.36E-02	15268.14	30.780	91.032
210	4849048	4.85E+00	5.33E-02	24245.24	35.909	92.468
240	7238229	7.24E+00	7.96E-02	36191.15	41.039	94.091
270	10305995	1.03E+01	1.13E-01	51529.97	46.169	94.689
300	14137167	1.41E+01	1.56E-01	70685.83	51.299	96.288
350	22449298	2.24E+01	2.47E-01	112246.49	59.849	97.011
400	33510322	3.35E+01	3.69E-01	167551.61	68.399	98.340
450	47712938	4.77E+01	5.25E-01	238564.69	76.949	99.071
500	65449847	6.54E+01	7.20E-01	327249.23	85.499	99.071
600	113097336	1.13E+02	1.24E+00	565486.68	102.599	100.000

Figure 1: Percentage of Drift PM that Evaporates to PM10


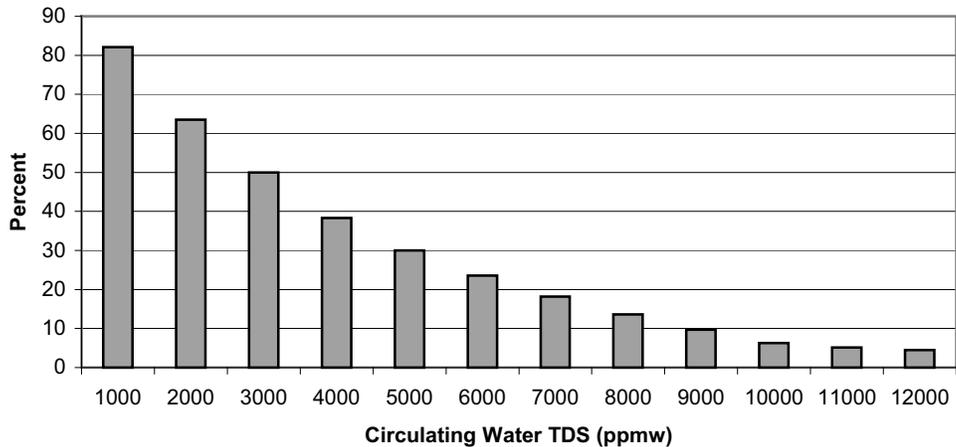


Figure 2: PM₁₀ Emission Rate vs. TDS

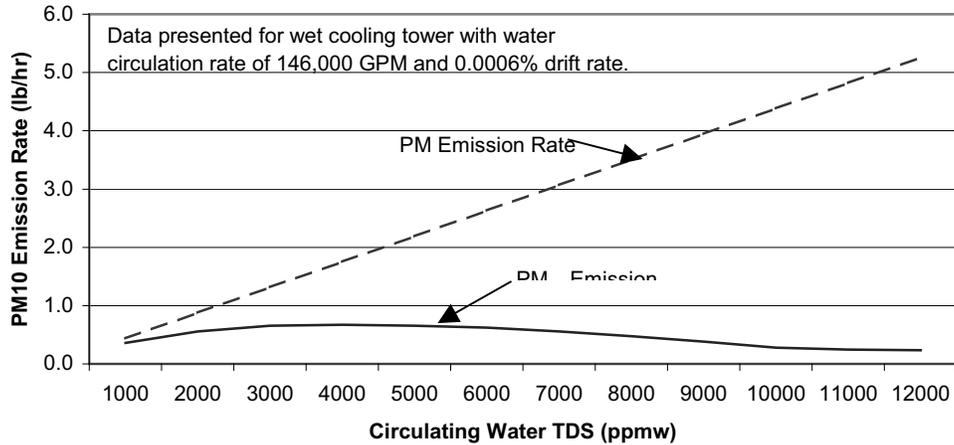

REFERENCES

1. EPA, 1995. Compilation of Air pollutant Emission Factors, AP-42 Fifth edition, Volume I: *Stationary Point and Area Sources*, Chapter 13.4 Wet Cooling Towers, <http://www.epa.gov/ttn/chief/ap42/>, United States Environmental Protection Agency, Office of Air Quality Planning and Standards, January.
2. Aull, 1999. Memorandum from R. Aull, Brentwood Industries to J. Reisman, Greystone, December 7, 1999.

KEY WORDS

Drift
Drift eliminators
Cooling tower
PM₁₀ emissions
TDS