

TABLE 1  
 LIST OF WELLS IDENTIFIED FOR THE SELF-MONITORING PROGRAM  
 FOR  
 APPLIED MATERIALS, INC.  
 3050 BOWERS AVENUE BUILDING 1 FACILITY  
 SANTA CLARA

Onsite Wells

<u>Extraction</u>	<u>Monitoring</u>	<u>Piezometers</u>
AM1-1	AM1-2	P-1
AM1-5E	AM1-3	P-2
AM1-EP	AM1-4	P-3
	AM1-5 & AM1-5B	
	AM1-6	
	AM1-7	
	AM1-8	
	AM1-9	

Offsite Wells

HP-1  
 HP-6

Refer to Figure 1 for the location of the Applied Materials, Inc. 3050 Bowers Avenue facility in Santa Clara, and Figure 2 for the locations of all wells identified in Table 1.

TABLE 2  
FINAL CLEANUP LEVELS

APPLIED MATERIALS, INC.  
3050 BOWERS AVENUE BUILDING 1 FACILITY  
SANTA CLARA

<u>Chemical</u>	<u>Level (ppb or ug/l)</u>
1,1-DCA *	5
1,2-DCA *	0.5
1,1-DCE *	5
1,2-DCE	
cis	5
trans	10
1,2-DCP	5
PCE *	5
1,1,1-TCA	200
1,1,2-TCA *	5
TCE *	3
Freon 113	1,200
Freon 11	150
Chloroform *	5
Methylene chloride *	5
Vinyl chloride *	0.5
Acetone	3,000

\* The combined total concentration of all carcinogens shall not exceed 5.0 ppb or ug/l, based upon an aggregate excess cancer risk of  $1 \times 10^{-4}$  through ingestion of drinking water. At the same time, the total HI calculated for non-carcinogens shall not exceed one.

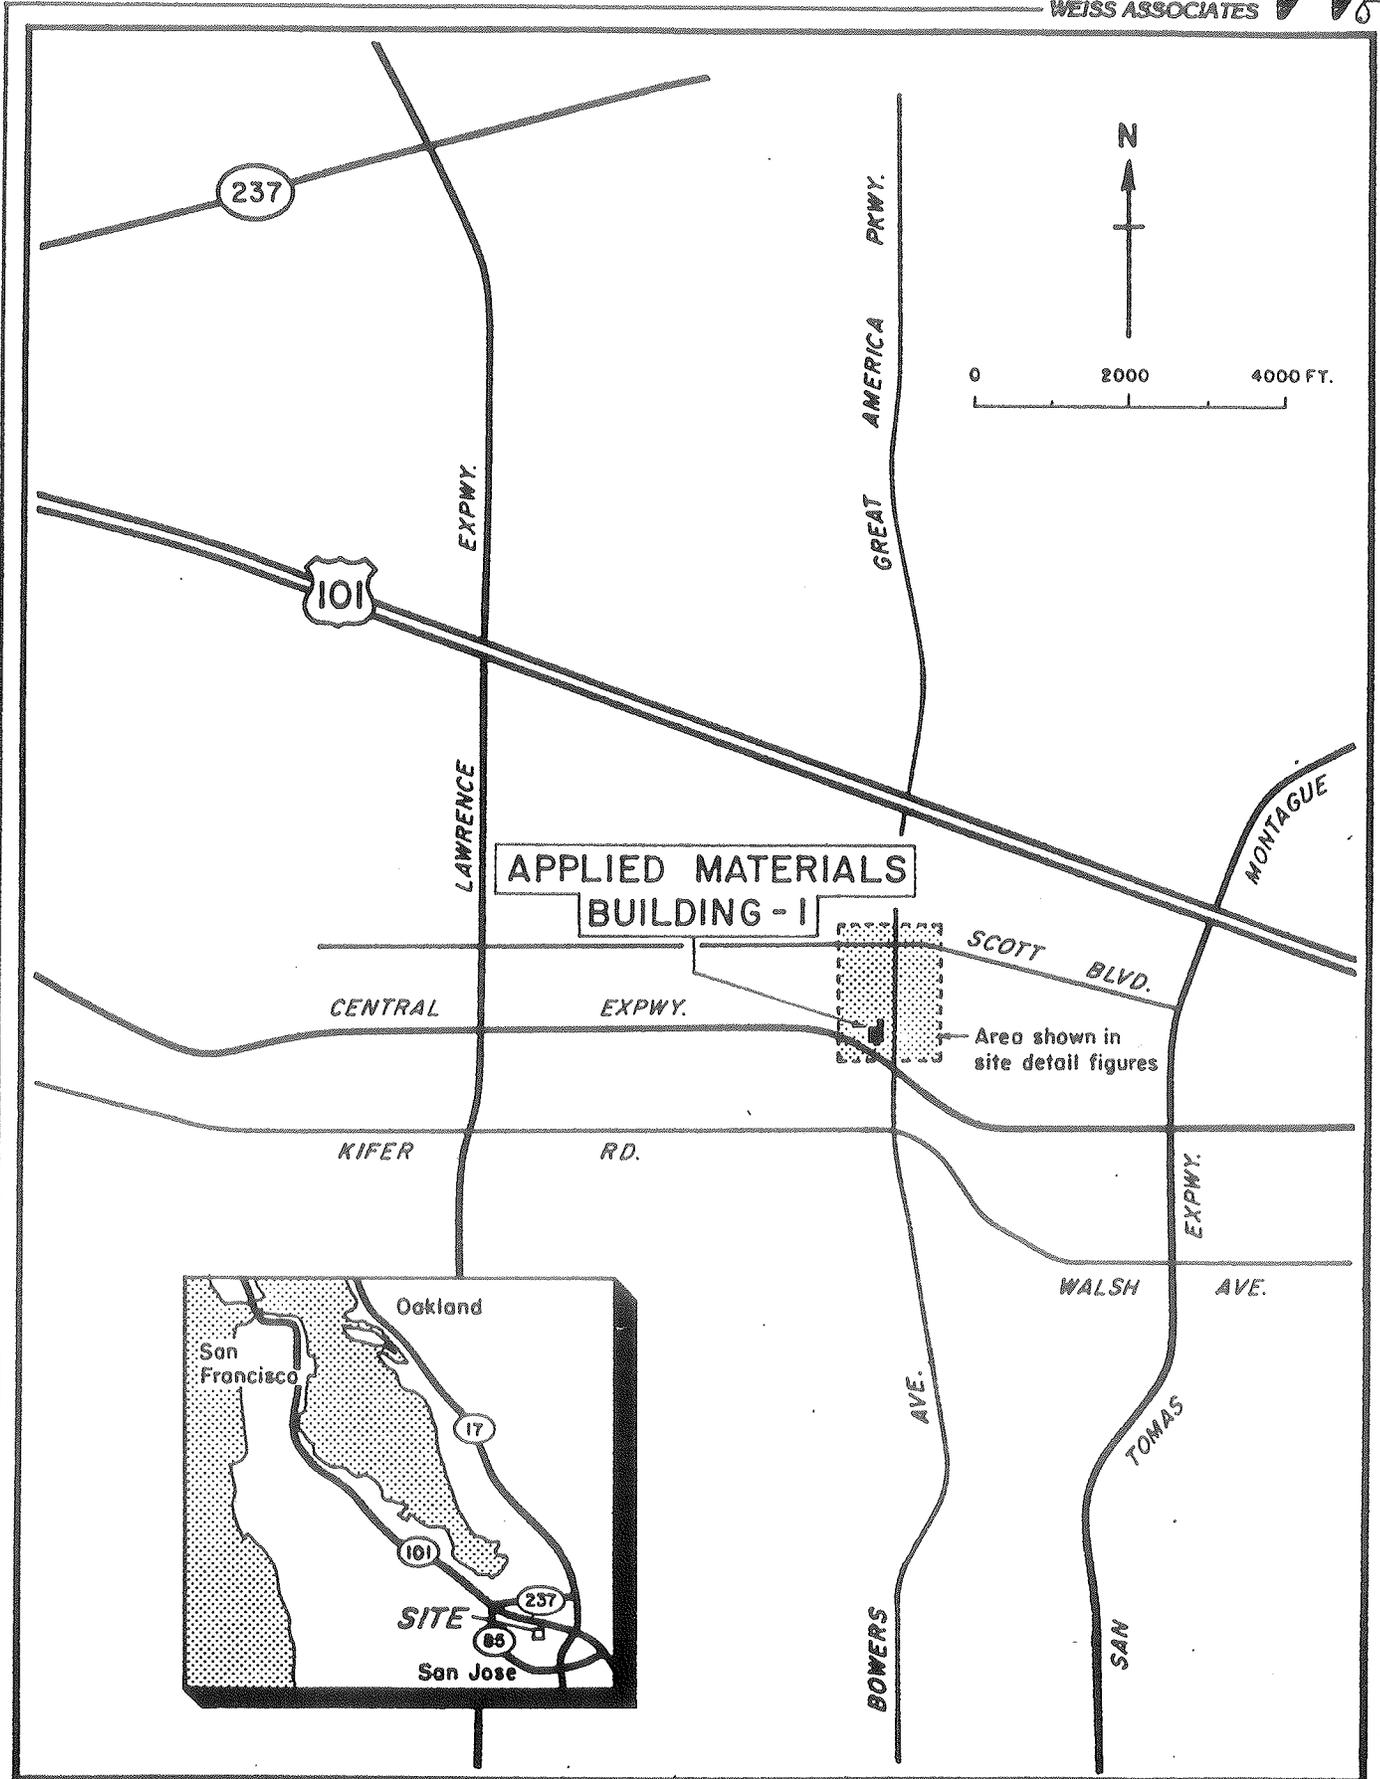


Figure 1. Location of Applied Materials Building 1

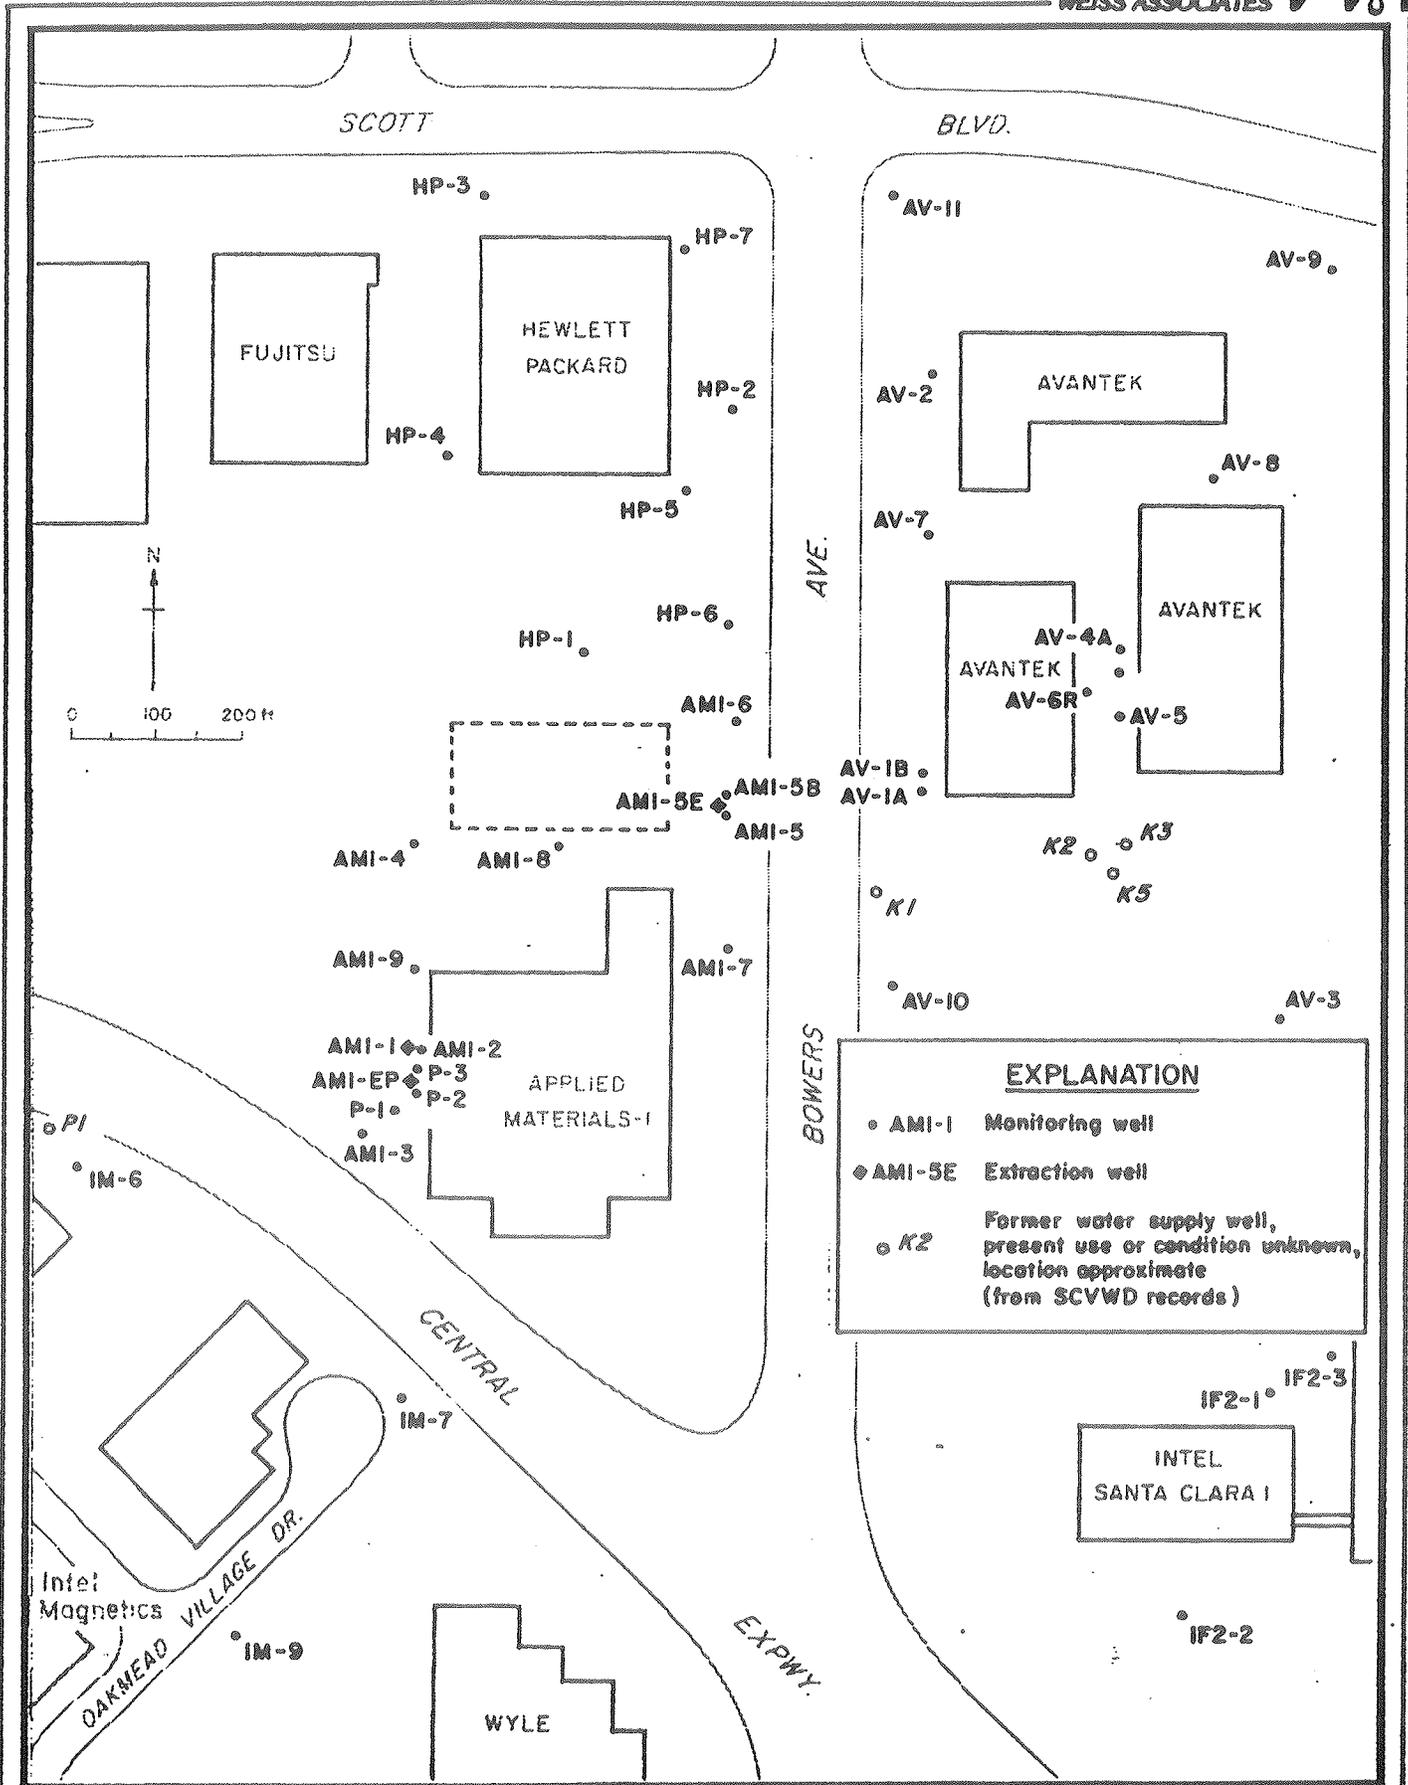


Figure 2. Well Locations - Applied Materials Building 1 and Vicinity